LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 10/28/2016 Expiration Date: 10/28/2017

Property Owner: John Bader c/o:

Address: PO BOX 1039, Troy, MT 59935

Telephone: (Home) [redacted] (Work)

Installer: Dustin Welch License No. 155

____ New Installation ____ Existing System

____ Repair __xx__ Replacement ____ Extension ____ Other

Describe: Two 50' laterals and 1000 gallon primary treatment

Parcel Description:

Legal: S6 T30 R33

Address or Location: 1041 Kern Rd, Troy TR 7A1A

Geo/Assessors code: 0000005674

Approved Design Criteria:

Bedrooms 1 Septic Tank Size: 1000 gallons Drainfield Size: 100 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442


DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

LOT LAYOUT

200ft from well

well

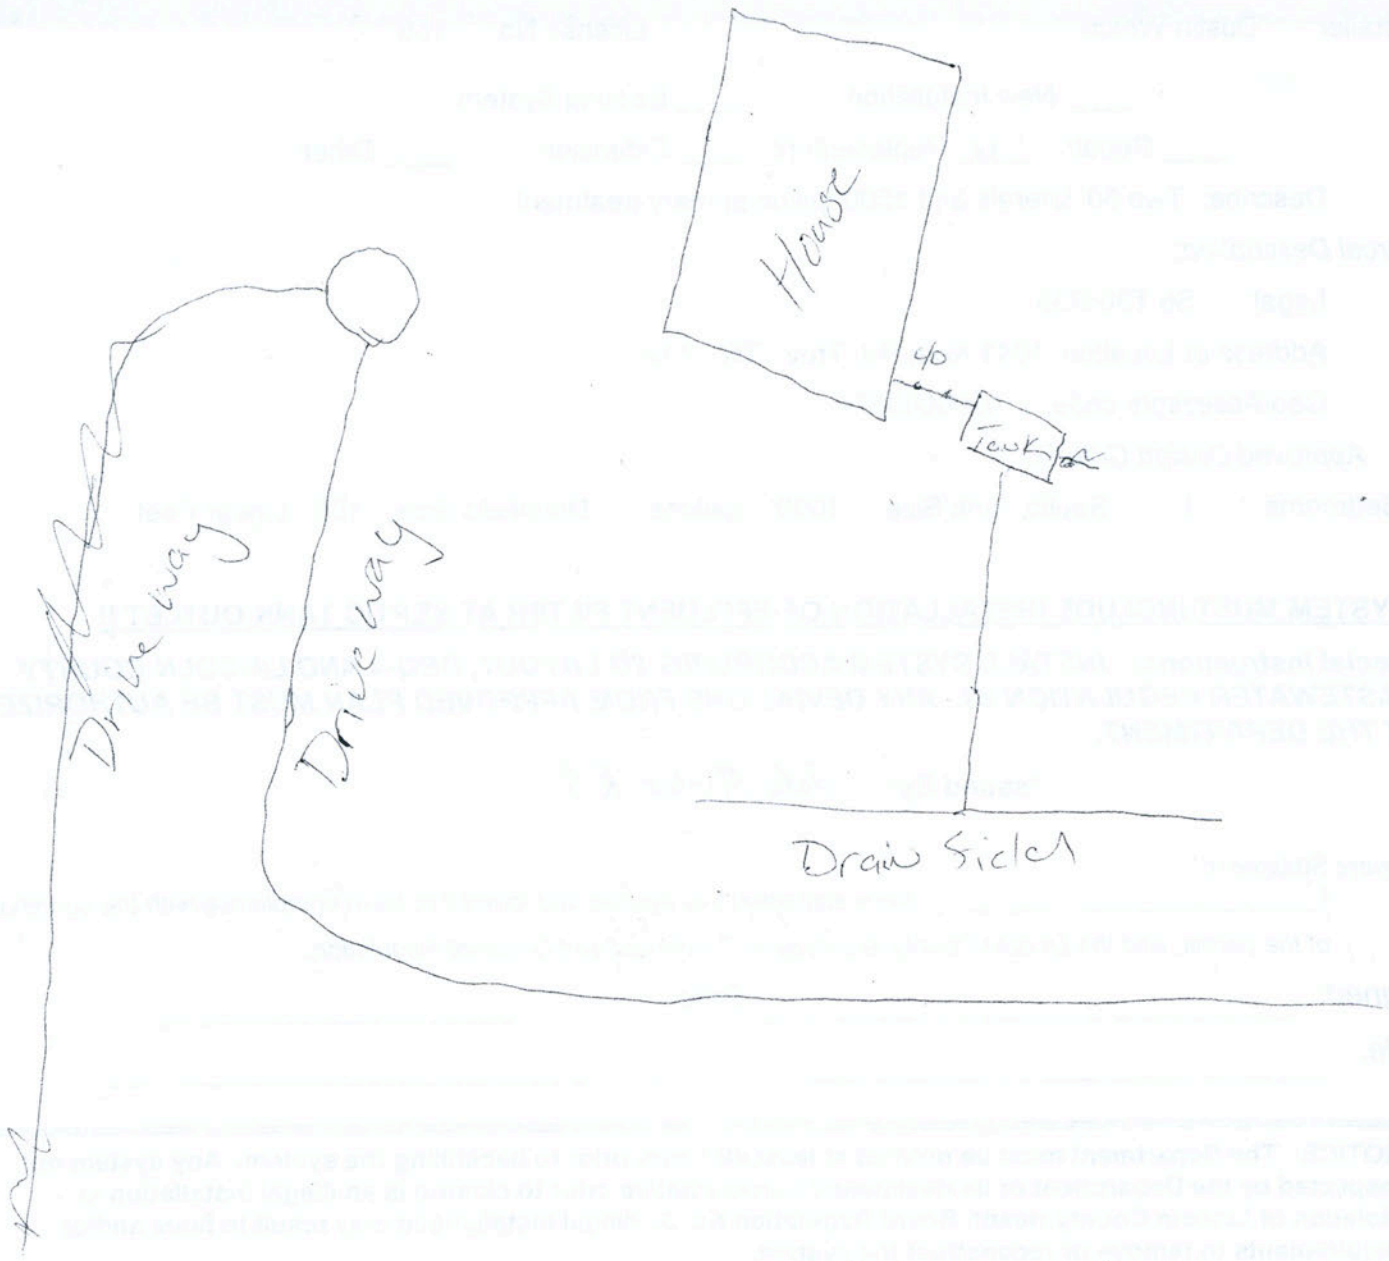

Insulator tube system