LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 7/18/2017

Expiration Date: 7/18/2018

Property Owner: Bill Bartel

c/o: Koocanusa Excavating, Inc.

Address: [redacted]

Telephone: (Home) [redacted]

(Work)

Installer: Koocanusa Excavating, Inc.

License No. 135

__xx__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Three 67' laterals using drain rock and perf pipe.

Parcel Description:

Legal: S19 T35 R25

Address or Location: Crystal Lakes Unit 1 Lot 27

Geo/Assessors code: 0000000935

Approved Design Criteria:

Bedrooms 2 Septic Tank Size: 1000 gallons Drainfield Size: 200 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, BUCK SCHERMERHORN, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Buck Schermerhorn *Date:* 10-10-17

Title: PRESIDENT - #135


NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

REV	DESCRIPTION	BY/DATE	APPD.

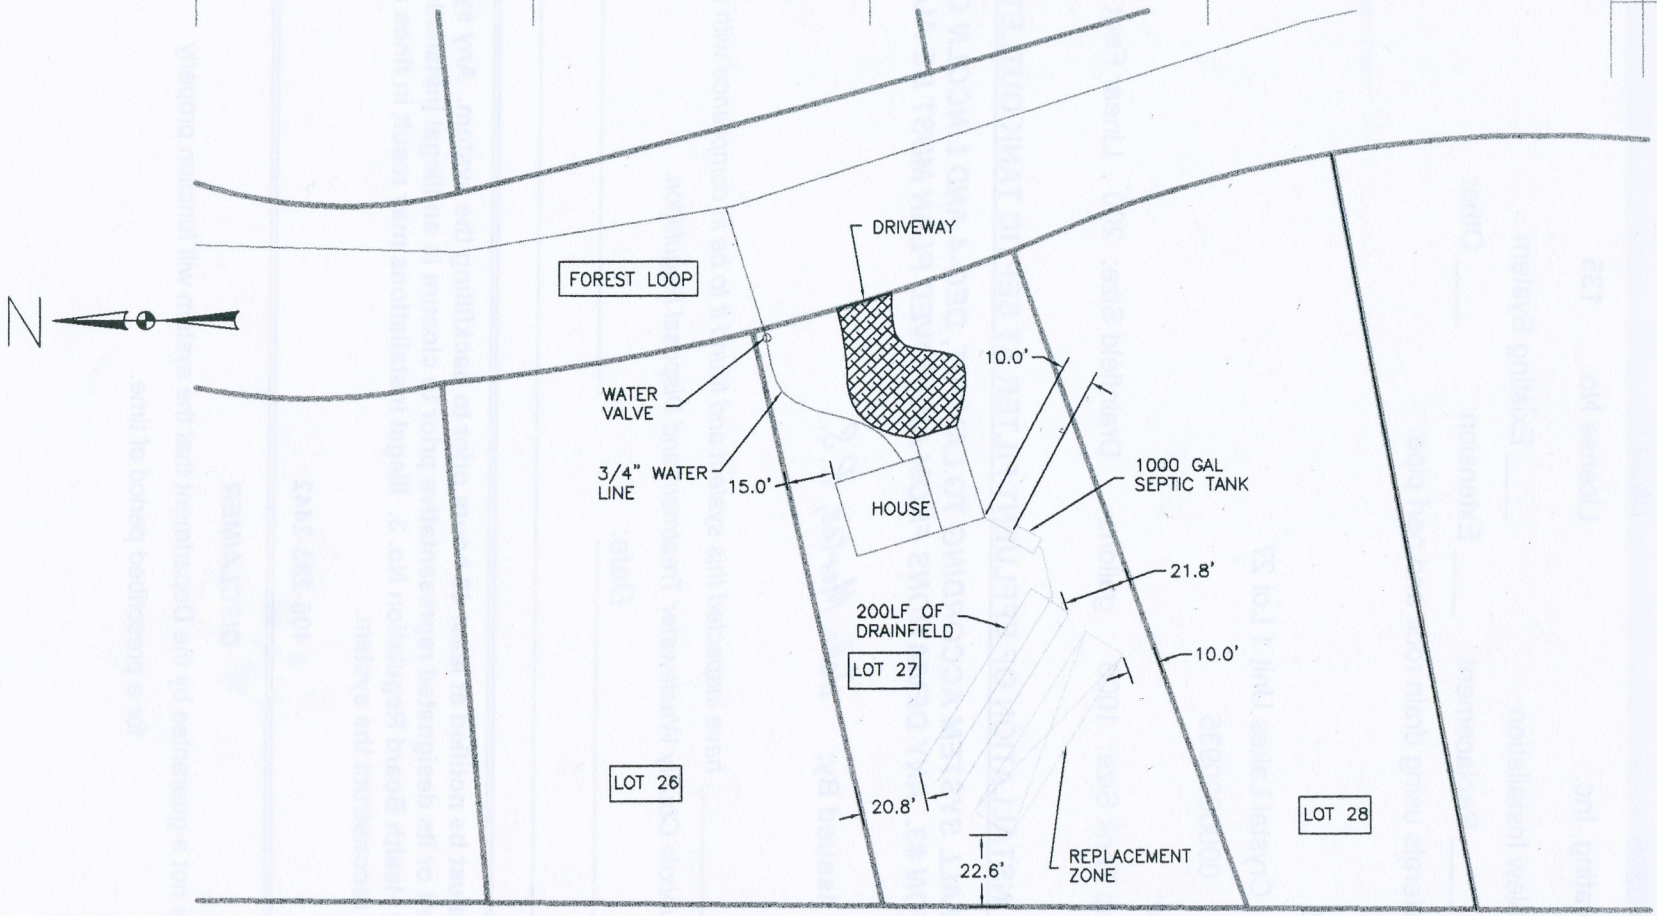

BARTEL LOT LAYOUT

REV	DATE			
		1	SITE MAP	
		COMPANY: CRYSTAL LAKES	SCALE: 1/16 = NOTED	ADDRESS: ACADEMY SURVEY SERVICES, P.C. P.O. BOX 1555 BARRE, VT 05677
		CONTRACT: VERBAL	DATE: 6/16/17	DIM. TOLERANCES:
		PLOT FILE: RL-0001	WEIGHT:	FINISH

KEI
BARTEL LOT LAYOUT
SITE MAP
B. BARTEL
03017-001
6/20
6/XX
1

6 5 4 3 2