LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 5/20/2016 Expiration Date: 5/20/2017

Property Owner: Wes Black c/o: Gideon Yutzy

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: Gideon Yutzy License No. 113

__xx__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Three 64' pressure dosed trenches using 3' gravelless chambers

Parcel Description:

Legal: S27 T37 R28

Address or Location: Tract 2B 2280 NFS RD 7220, Rexford, MT 59930

Geo/Assessors code: 0000011608

Approved Design Criteria:

Bedrooms 4 Septic Tank Size: 1500 gallons Drainfield Size: 192 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Gideon Yutzy, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Gideon Yutzy *Date:* 6-5-2016

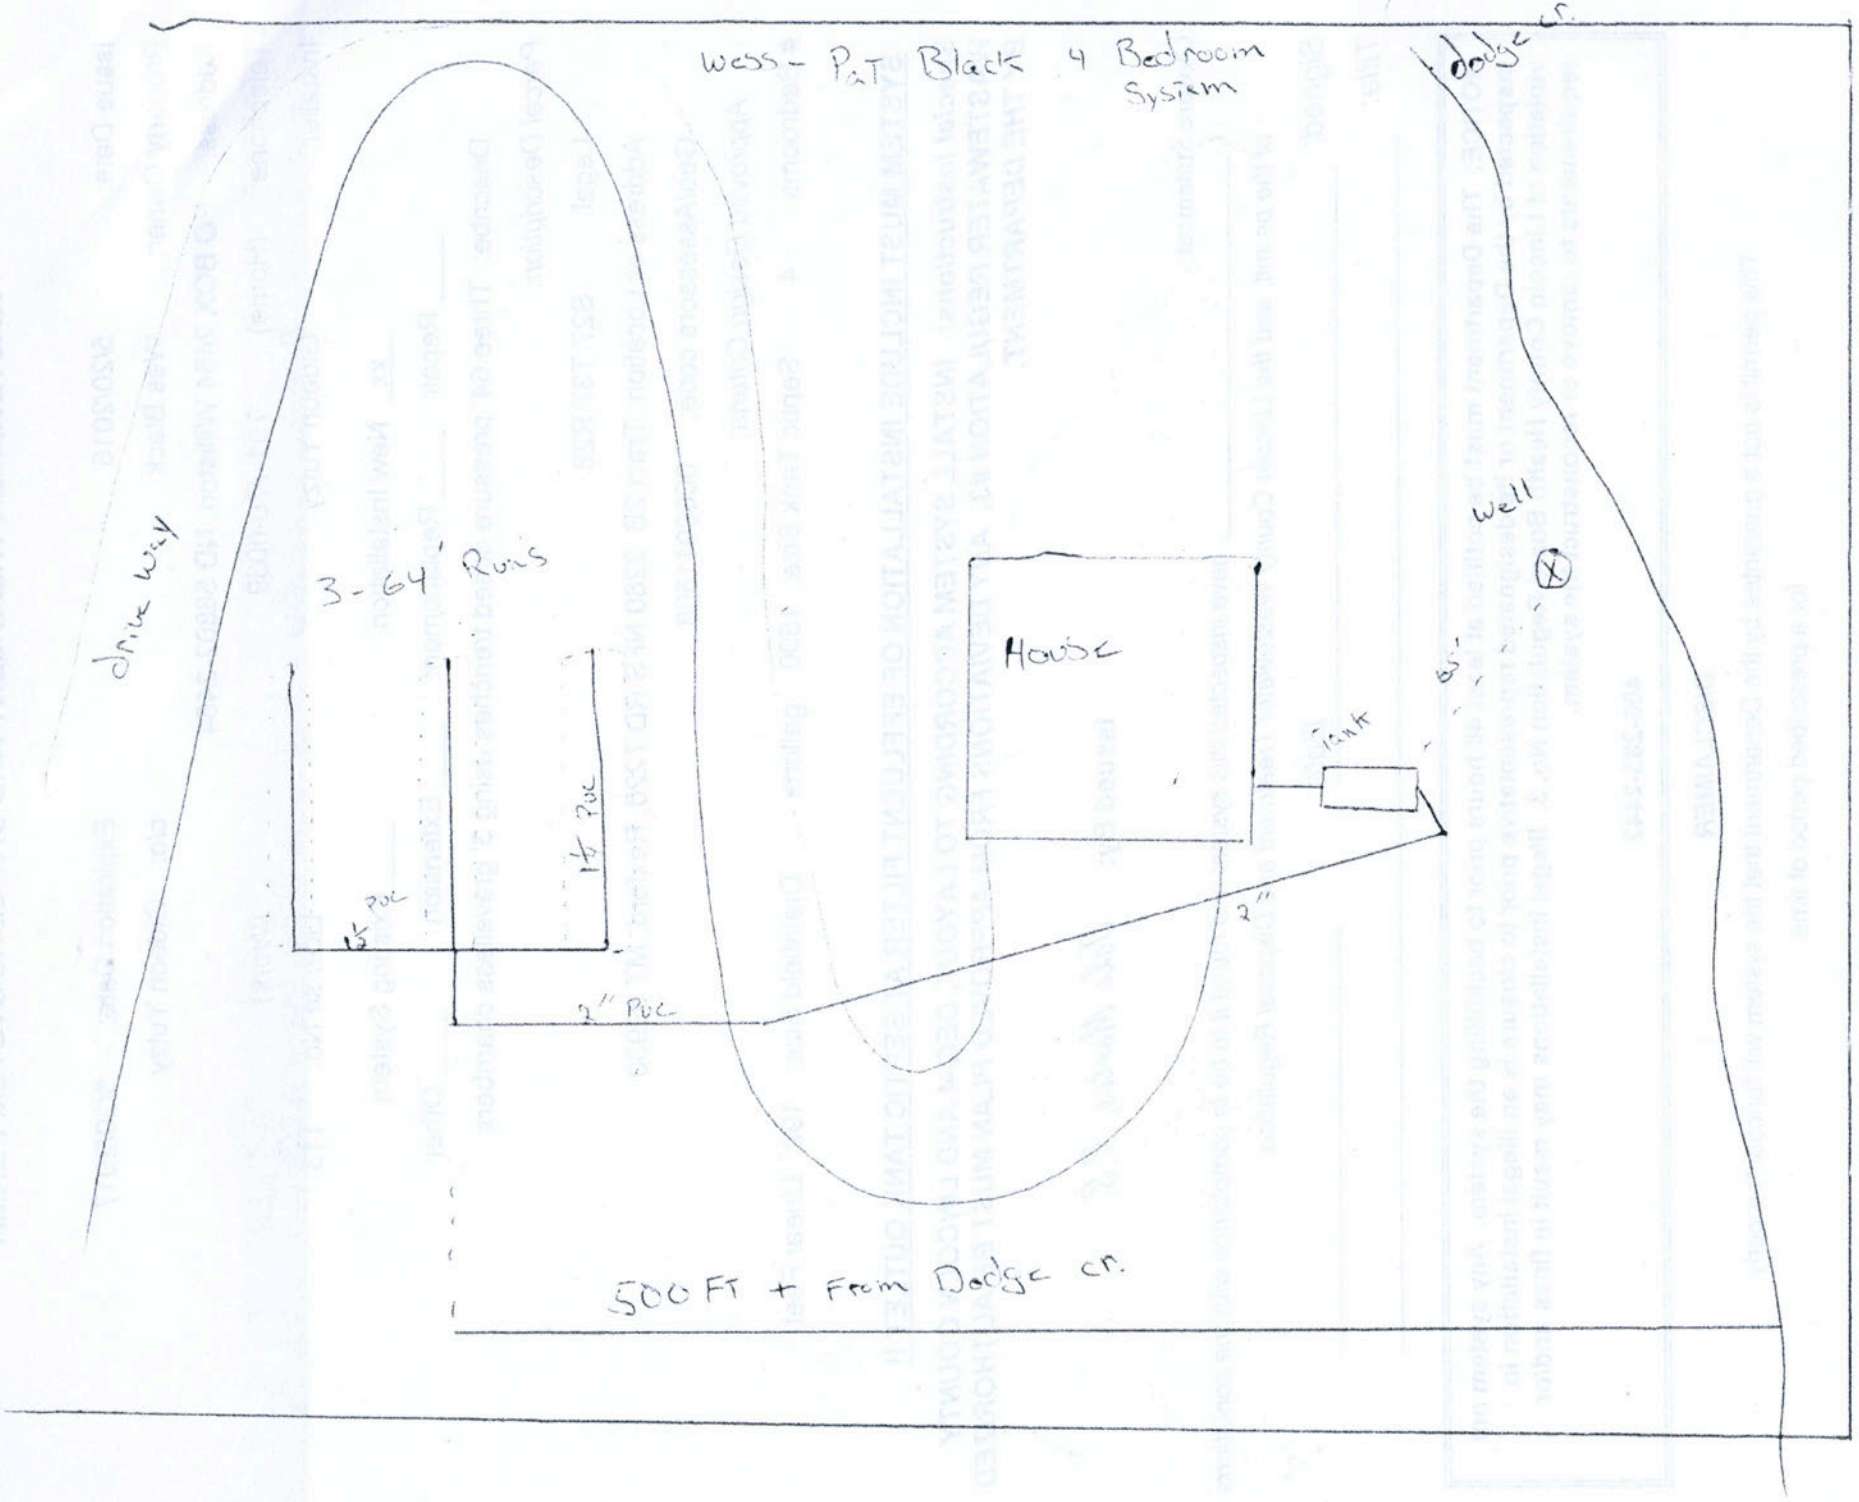
Title: Licensed installer; Lic # 113

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


Wass - P&T Black 4 Bedroom System
Dodge Cr.
Drive Way
3 - 64' Runs
House
Well
Tank
1½ PVC
1½ PVC
2" PVC
2"
500 FT + From Dodge Cr.