LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 6/10/2016 Expiration Date: 6/10/2017

Property Owner: Dean & Bev Carlson c/o: Koocanusa Excavating, Inc.

Address: PO Box 1142, Okotoks, AB Canada T1S 1B2

Telephone: (Home) [redacted] (Work) [redacted]

Installer: Koocanusa Excavating, Inc. License No. 135

__xx__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: 445 lineal foot pressure dosed drainfield in 3' trenches

Parcel Description:

Legal: S26 T36 R26

Address or Location: Timber Glen III Lot #1

Geo/Assessors code: 0000054799

Approved Design Criteria:

Bedrooms 5 Septic Tank Size: 1500/500 gallons Drainfield Size: 445 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, BUCK SCHERMERHORN, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: Buck Schermerhorn Date: 6/22/16

Title: PRESIDENT

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442


DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

REV	DESCRIPTION	BY/DATE	APPD/DATE

ELEVATIONS:
Z = Ø AT CENTER OF PARKING AREA

A (FUTURE HOUSE ENTRY) = -1.Ø'
B (NORTH PAD) = -Ø.76'
C (BOTTOM OF BASEMENT) = -12.7'
D (SE GARAGE) = -4.42'
E (SW GARAGE) = -6.82'
F (NW GARAGE) = -9.32'
G (NE GARAGE) = -7.82'

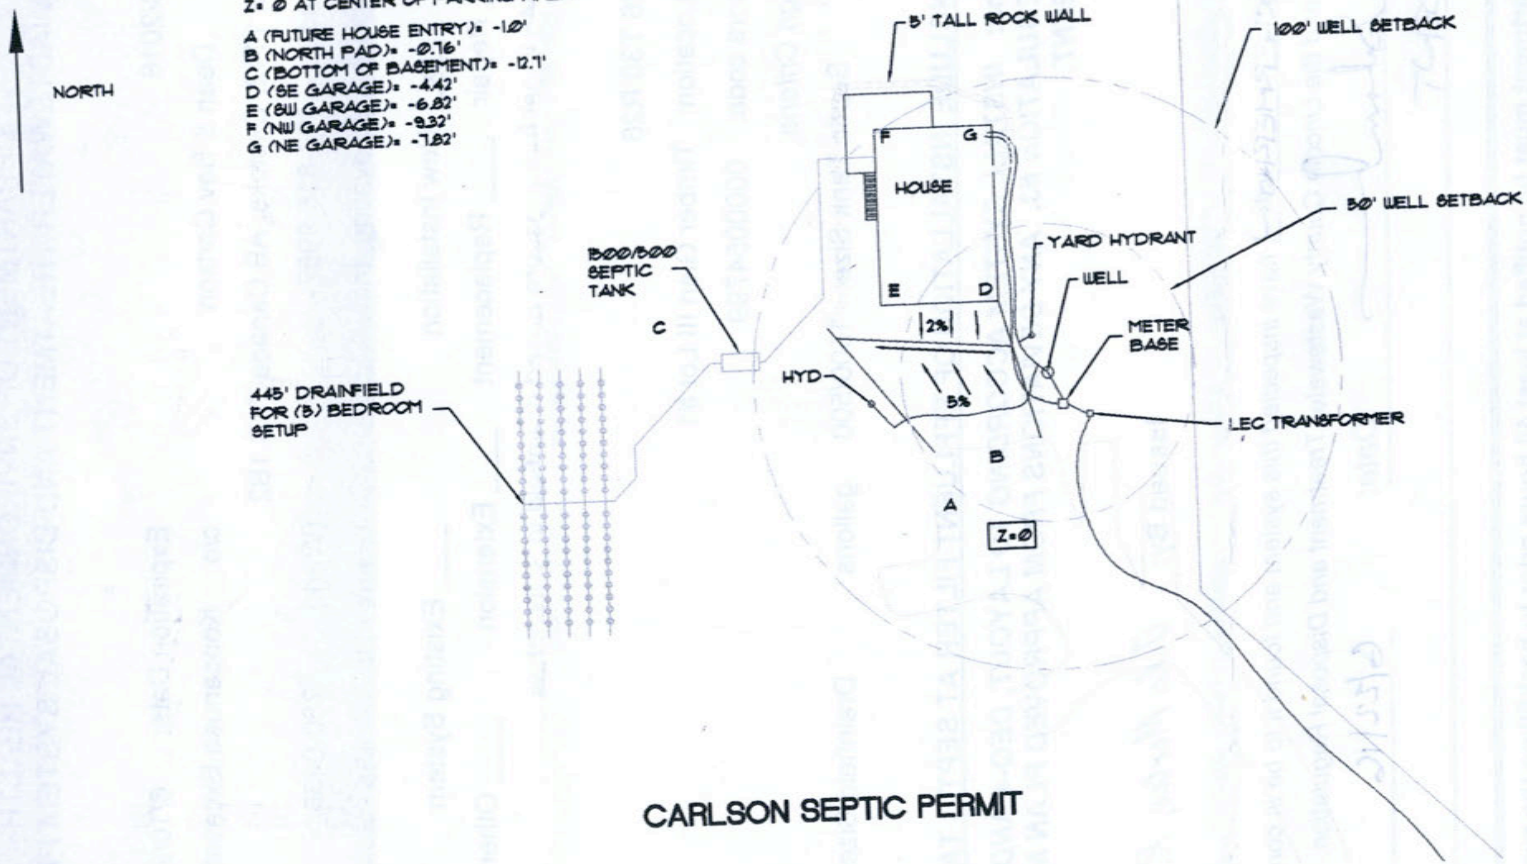

CARLSON SEPTIC PERMIT

REV	DATE	COMPANY	SCALE	KODIAK EXCAVATING CARLSON PROJECT
		KEI	1/16 = 1'-0"	SITE LAYOUT
		CONTRACT	DATE	DRAWN BY: 5/9/16
		K000615	3/14/16	CHECKED BY: 5/9/16
		PLOT FILE	REVISED	D. CARLSON
		PHL-0001	----	Finish 00715-002 1

THIS DRAWING IS PROPERTY OF KEI (PHL COMPANY) AND SHALL BE USED ONLY FOR THE PROJECT AND SITE SPECIFIED HEREIN UNLESS OTHERWISE AGREED TO IN WRITING BY KEI (PHL COMPANY). IF USED FOR ANY OTHER PURPOSE WITHOUT WRITTEN APPROVAL FROM KEI (PHL COMPANY), KEI (PHL COMPANY) SHALL BE RELEASED FROM ALL DESIGN LIABILITY.

6 5 4 3 2