LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 5/23/2016 Expiration Date: 5/23/2017

Property Owner: Nick Chamberlain ~~c/o: Oedewaldt Const.~~

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: Terry Oedewaldt License No. 2

xx New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Two 100' trenches using gravelless chambers, Size reduced per .6gpd app rate.

Parcel Description:

Legal: S14 T27 R28

Address or Location: Lot 31 Parkside at Fisher River 272 Rogers Mountain Loop

Geo/Assessors code: 0000056139

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000 gallons Drainfield Size: 200 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, TERRY OEDEWALDT, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: [signature] *Date:* 5/25/2016

Title: PRESIDENT


NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

LOT LAYOUT

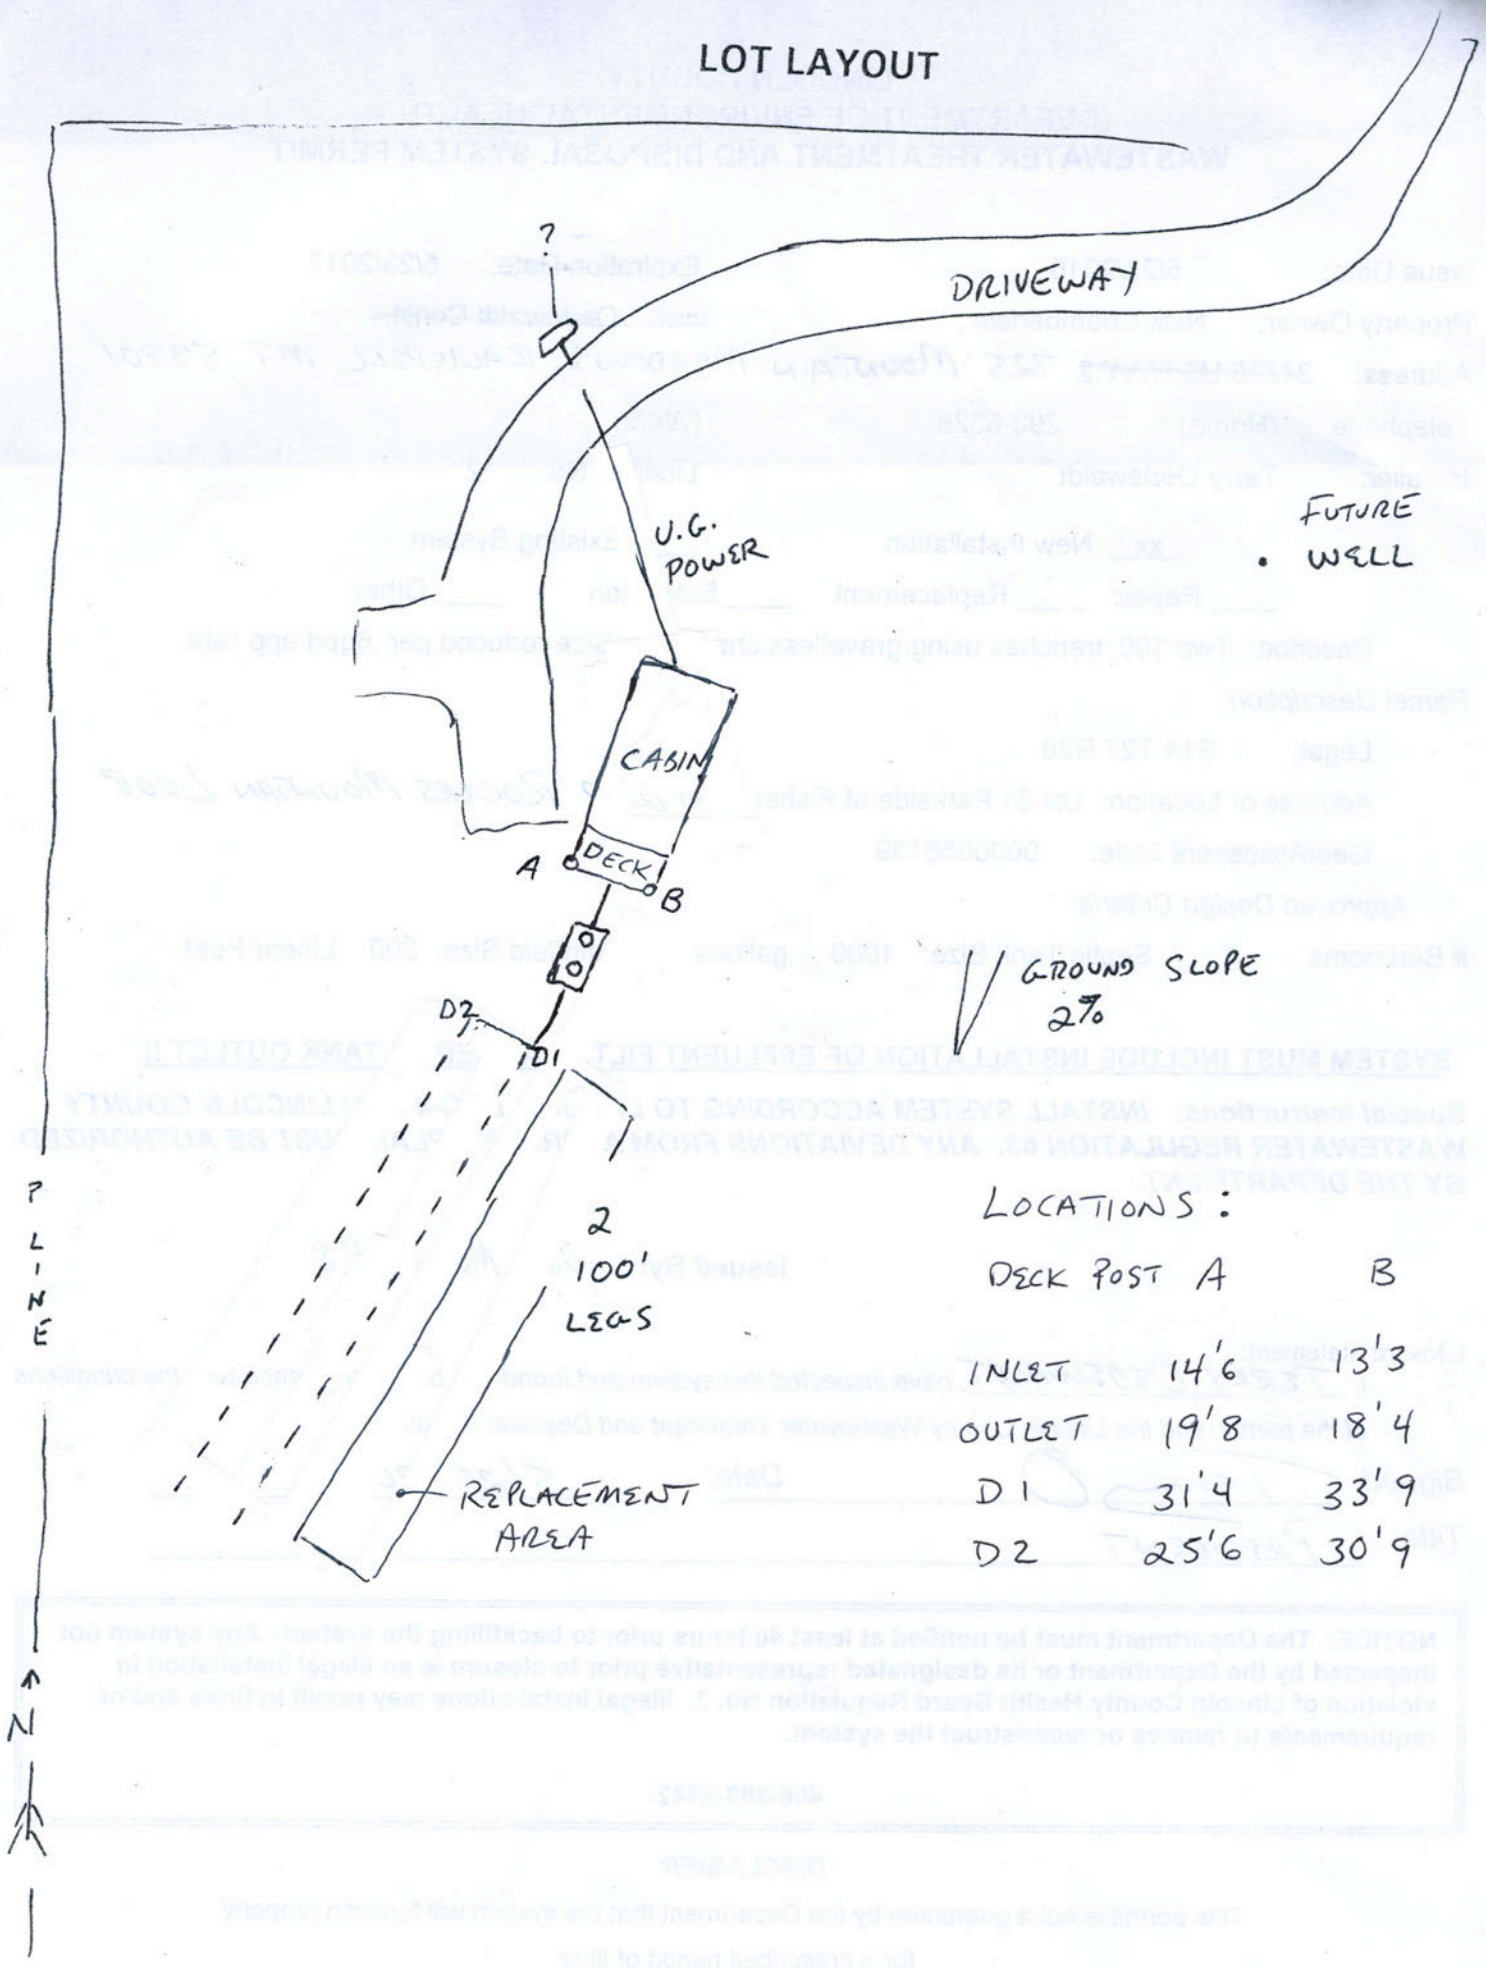

LOCATIONS:

DECK POST	A	B
INLET	14'6	13'3
OUTLET	19'8	18'4
D1	31'4	33'9
D2	25'6	30'9