13
Back of Front

LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 5/19/2016 Expiration Date: 5/19/2017

Property Owner: Geoff Chene c/o: Barb Renkema

Address: PO BOX 1693

Telephone: (Home) [redacted] (Work)

Installer: Barb Renkema License No. 78

__xx__ New Installation ___ Existing System

____ Repair ____ Replacement ___ Extension ____ Other

Describe: Five 90' trenches using gravelless chambers

Parcel Description:

Legal: S23 T36 R28

Address or Location: Doffing FT Tract 3

Geo/Assessors code: 0000054834

Approved Design Criteria:

Bedrooms 4 Septic Tank Size: 1500 gallons Drainfield Size: 450 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Barb Renkema, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Barb Renkema *Date:* 9-13-16

Title: Insp 78


NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

Doffing F/T Tr. 2
S 23 T 36 N R 28 W

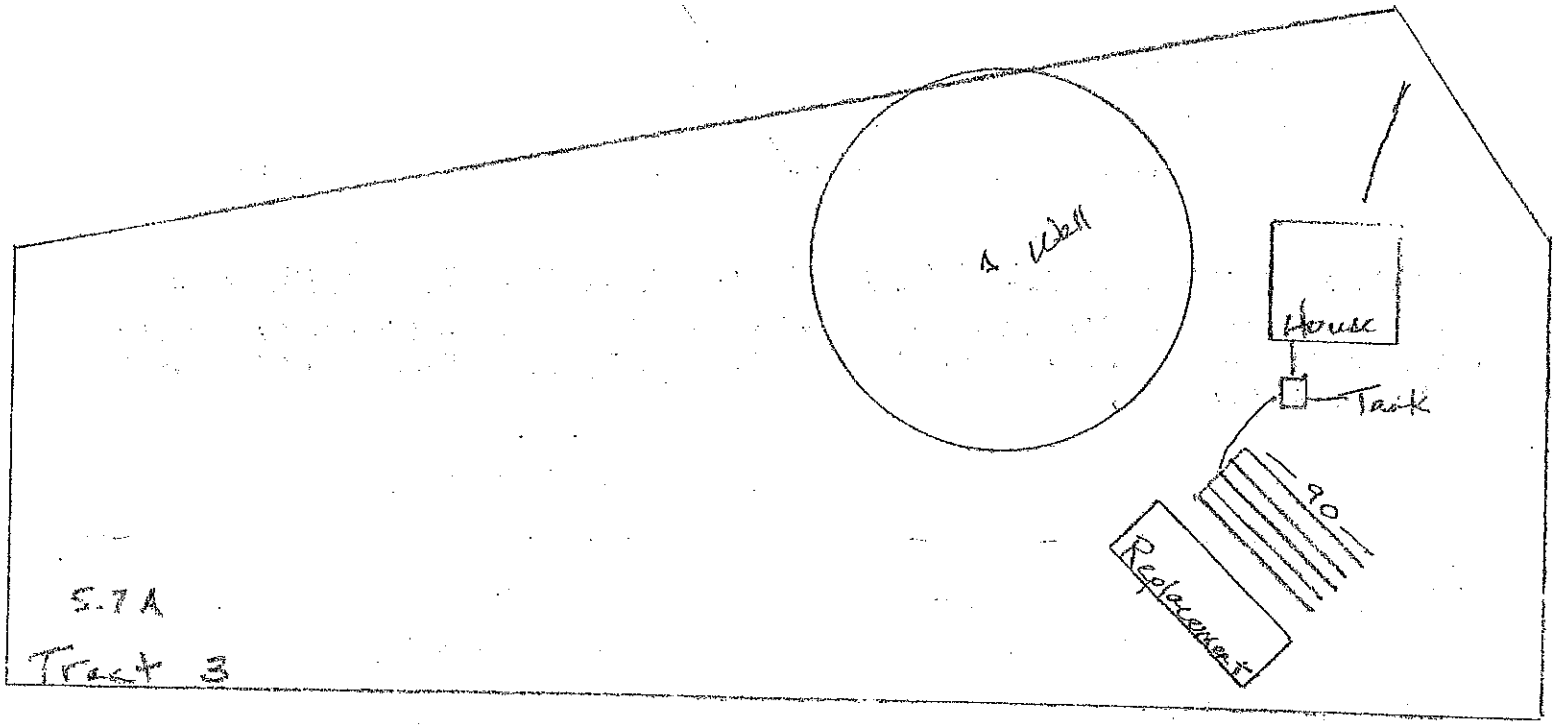

1" = 100'

N