County

LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 2/18/2016 Expiration Date: 2/19/2017

Property Owner: Cymon "Tony"Curtiss c/o: Tally Hoe

Address: [redacted]

Telephone: (Home) [redacted] (Work) 293-5485

Installer: Tally Hoe License No. 1

___ New Installation ____ Existing System

__XX__ Repair ____ Replacement ____ Extension ____ Other

Describe: Repair 2 ring drywell and concrete septic tank

Parcel Description:

Legal: S4 T30 R31 Shady Rest Block 2 Lot 24

Address or Location: 473 Parmenter Drive

Geo/Assessors code: 0000009725

Approved Design Criteria:

Bedrooms 2 Septic Tank Size: 1000 gallons Drainfield Size: 150eq. Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Thomas J Cole *have inspected this system and found it to be in compliance with the conditions of the permit and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: [signature] *Date:* 5-11-16

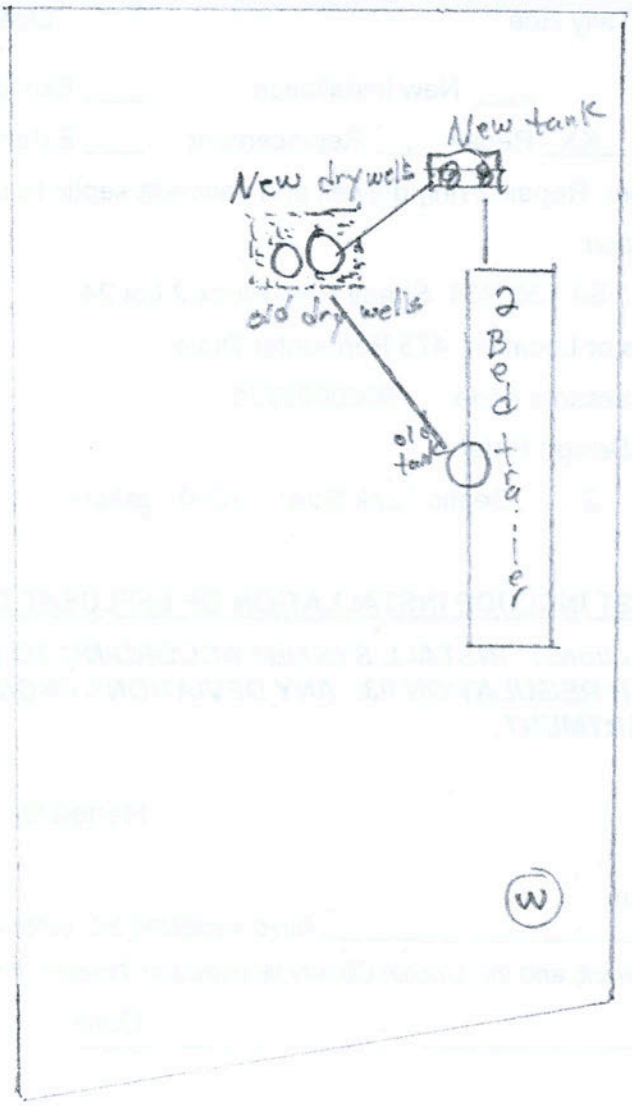
Title: owner

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


New tank
New drywells
old dry wells
old tank
2 Bed trailer
W