LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 9/8/2016 Expiration Date: 9/8/2017

Property Owner: Rod Delaney c/o: Tom Cole

Address:

Telephone: (Home) [redacted] (Work)

Installer: Tom Cole License No. 1

__xx__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Three 56' laterals using gravelless chambers. Size reduced per 0.8 gpd app rate

Parcel Description:

Legal: S26 T30 R31

Address or Location: Pioneer Junction Lots 29-32 of Block 18

Geo/Assessors code: 0000003156

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000 gallons Drainfield Size: 168 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

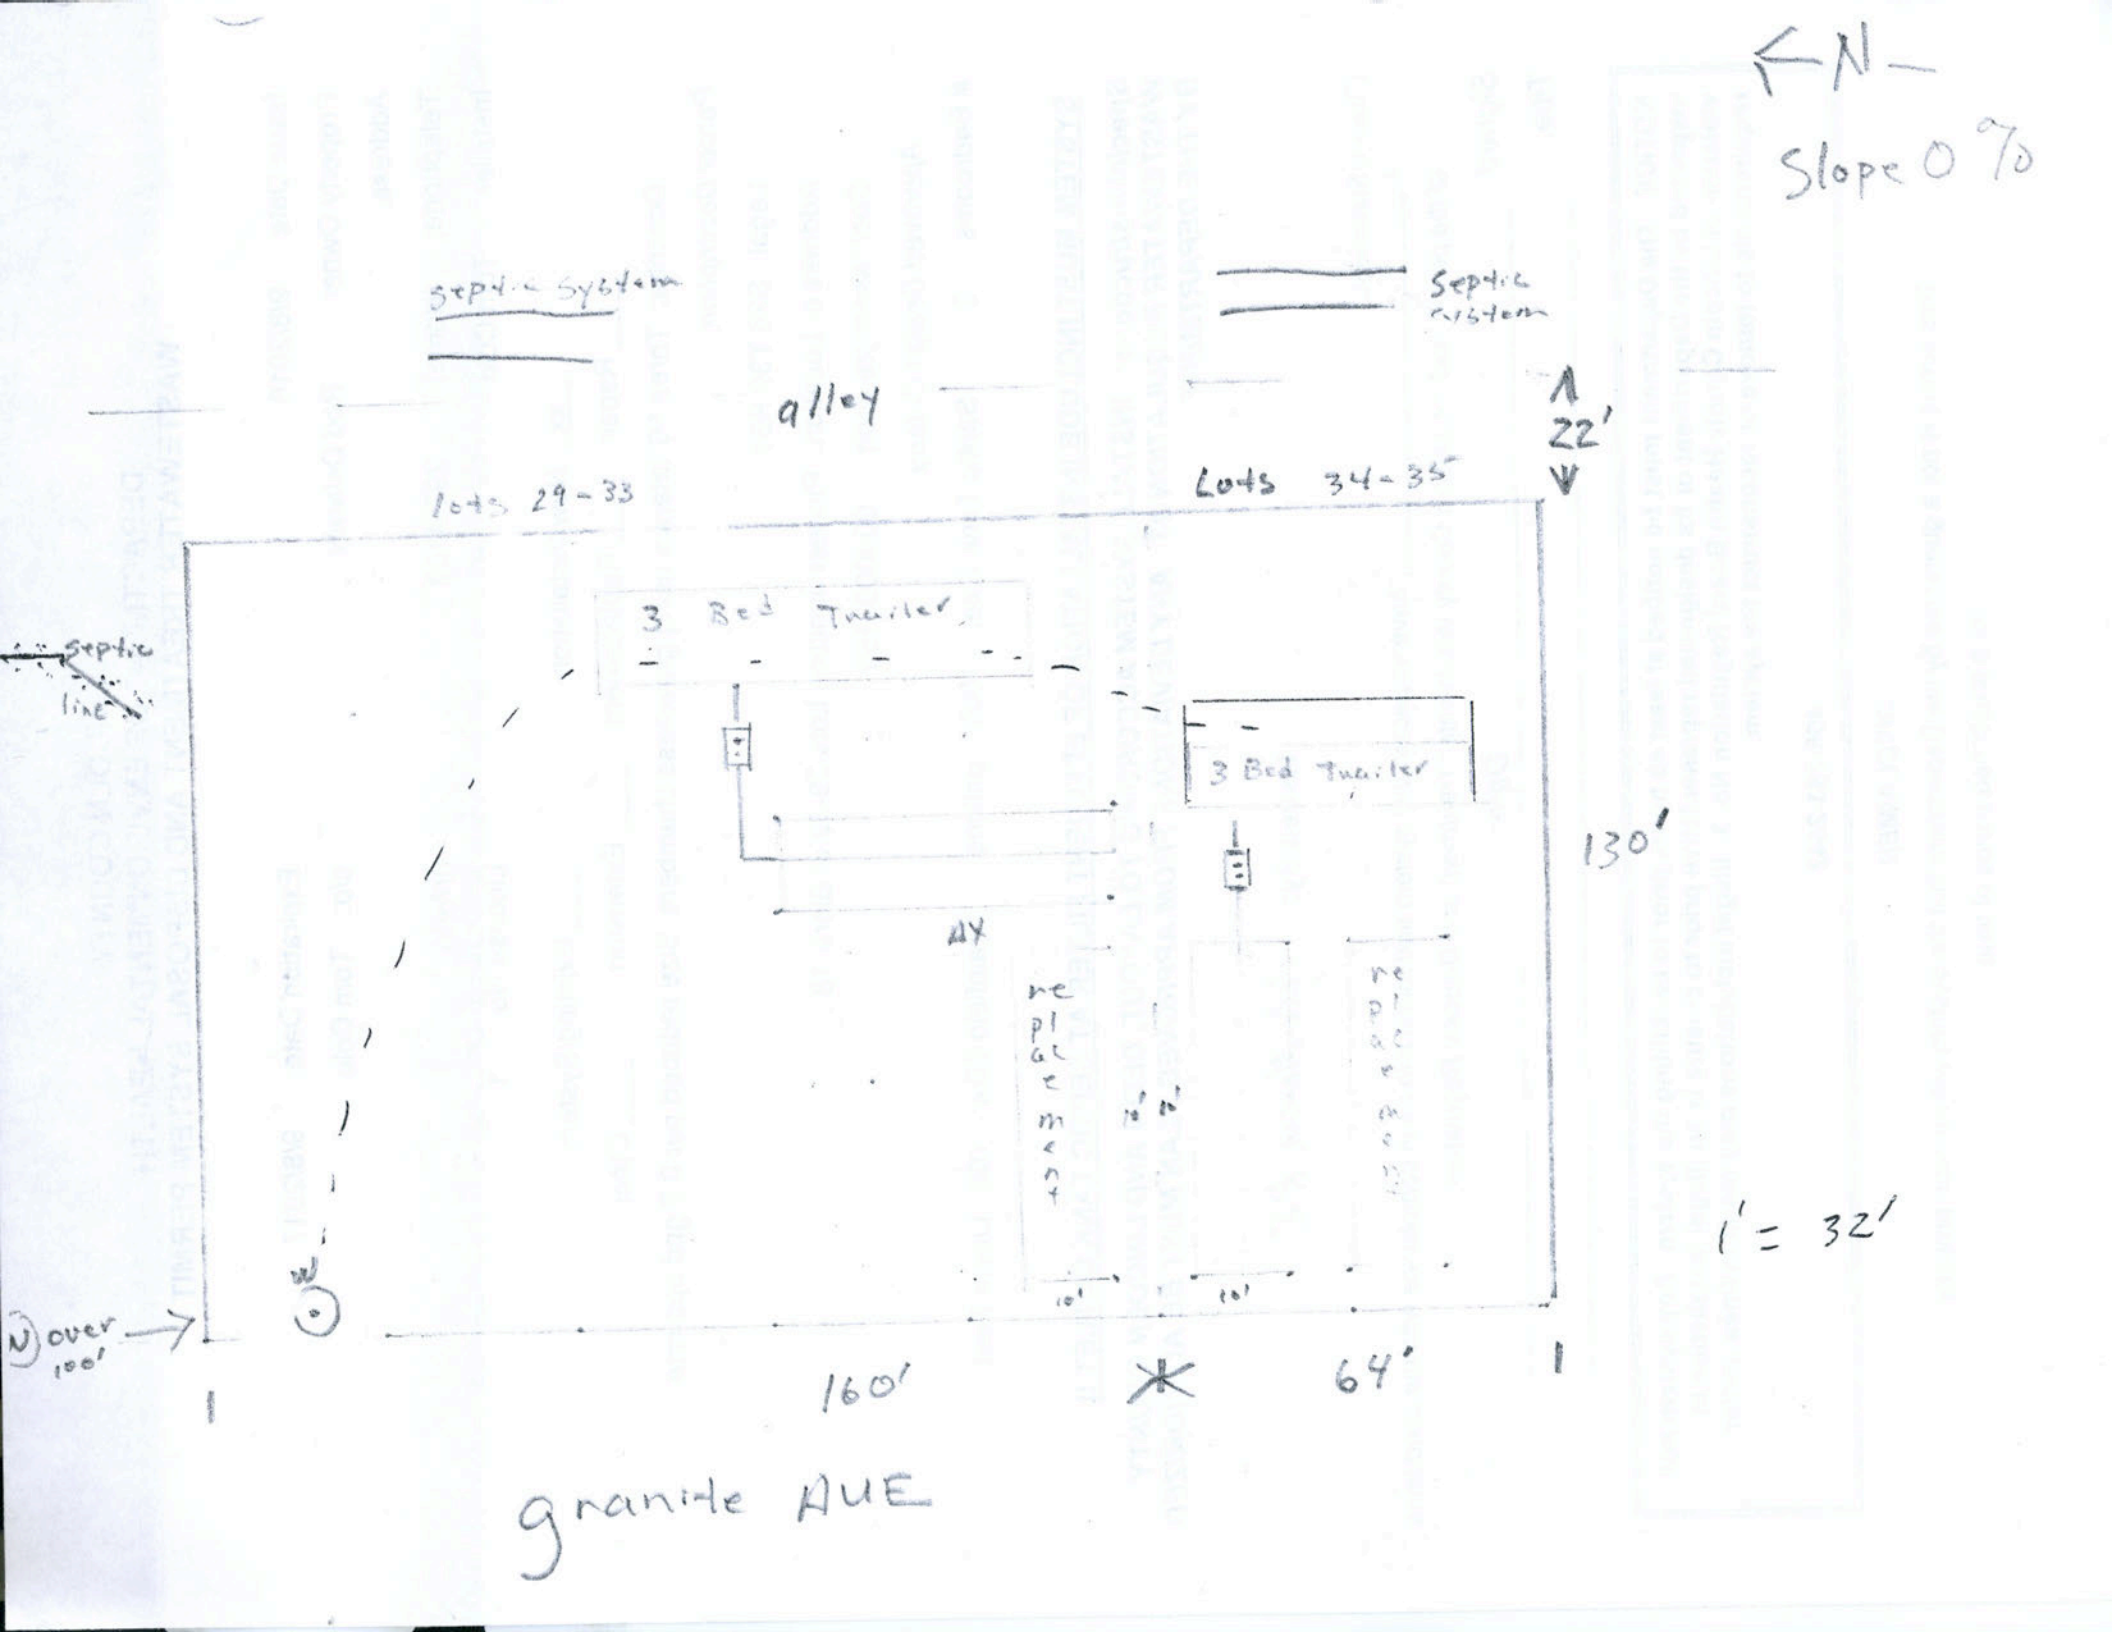
Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


N
Slope 0 %
Septic System
Septic System
alley
22'
Lots 29-33
Lots 34-35
3 Bed Trailer
3 Bed Trailer
Septic line
130'
40'
replacement
replacement
10'
10'
10'
N over 100'
160'
64'
granite AVE
1' = 32'