LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 7/28/2017 Expiration Date: 7/28/2018

Property Owner: Chris Dietzen c/o: Koocanusa Plumbing

Address: PO BOX 2045, Eureka, MT 59917

Telephone: (Home) [redacted] (Work)

Installer: Koocanusa Plumbing License No. 8

__xx__ New Installation _____ Existing System

_____ Repair _____ Replacement _____ Extension _____ Other

Describe: Three 68' laterals using gravelless chambers. Size reduced per 0.6 app rate.

Parcel Description:

Legal: S22 T36 R22

Address or Location: Driftwood Cove Lot 10

Geo/Assessors code: 0000012680

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000 gallons Drainfield Size: 204 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Michael Nelson, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: [signature] *Date:* 16 Aug 2017

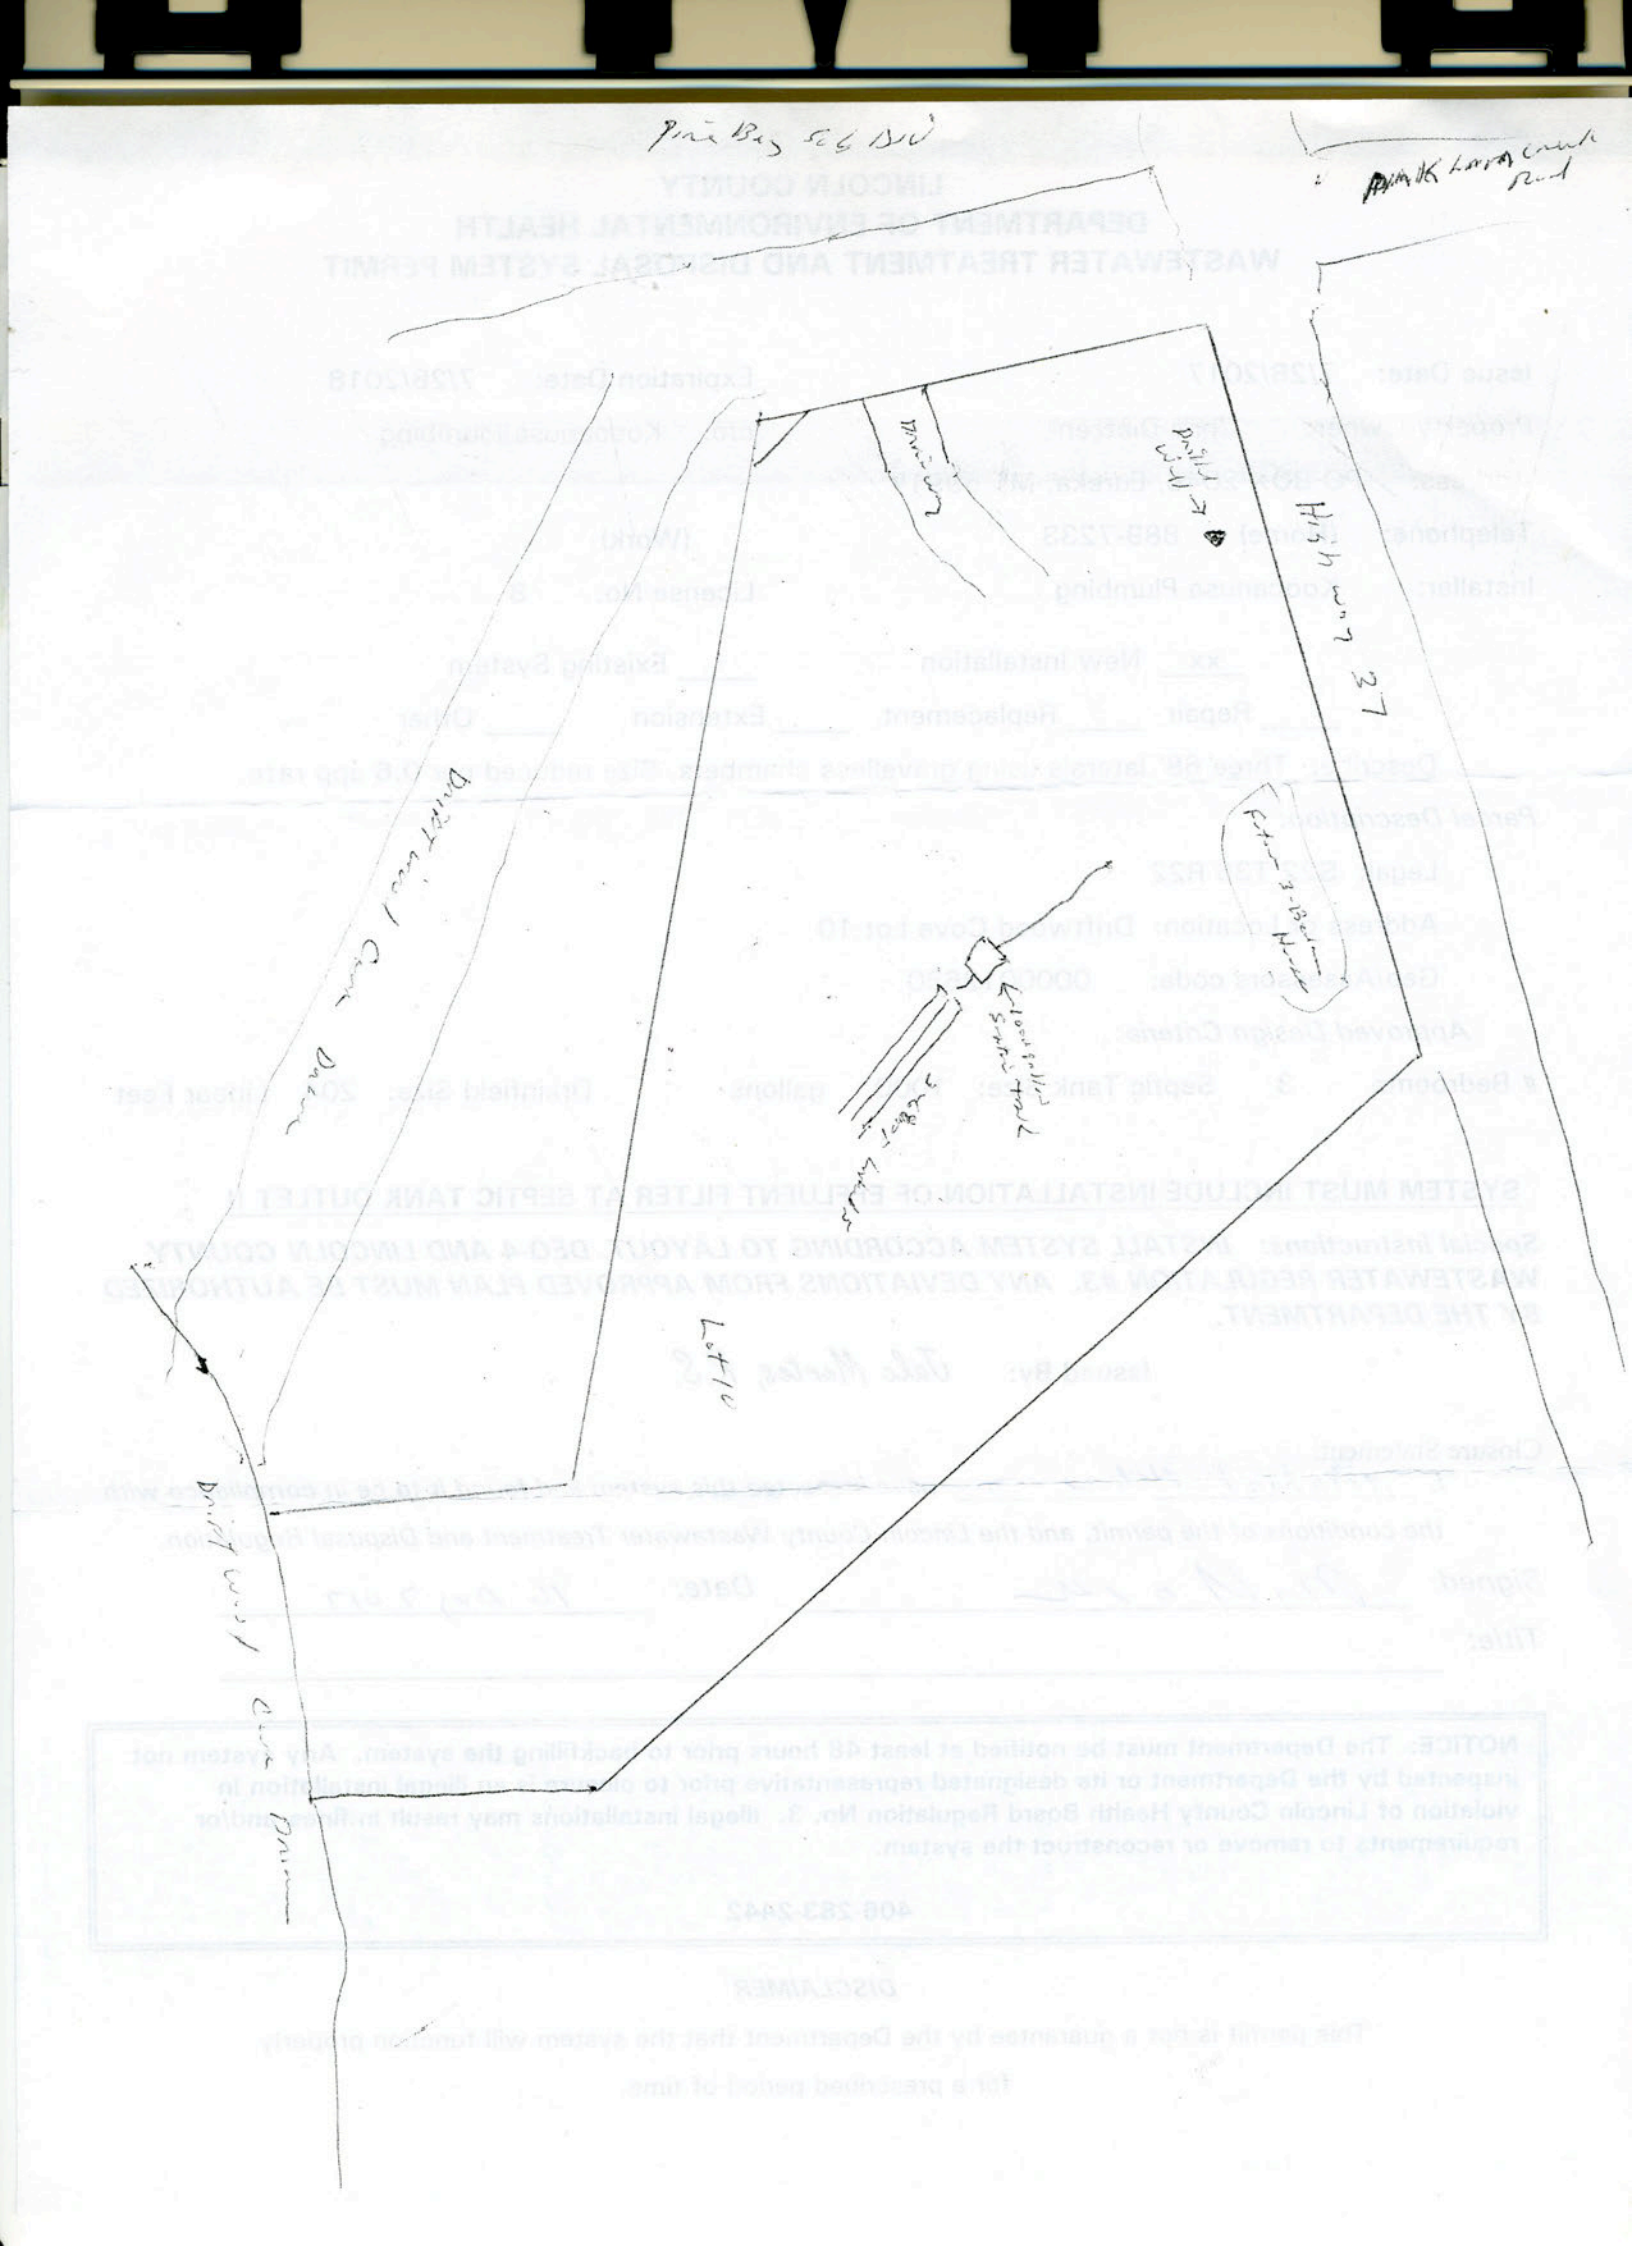
Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


Pine Bay 506 Blvd
Hwy 37
Lot 10
Driveway
Future 3-Bedroom Home
Existing Shed
Existing Well
Existing Septic Tank
Existing Drainfield
Existing Power Pole
Driveway