LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 8/9/2016 Expiration Date: 8/9/2017

Property Owner: Jacob Graham c/o:

Address: [redacted]

Telephone: (Home) (Work)

Installer: Terry Oedewaldt License No. 2

xx New Installation ____ Existing System

Repair ____ Replacement ____ Extension ____ Other

Describe: Two 75' laterals using gravelless chambers. Size reduced per 0.6 app rate.

Parcel Description:

Legal: S34 T31 R31

Address or Location: Parcel C of COS#4424

Geo/Assessors code: 0000002972

Approved Design Criteria:

Bedrooms 2 Septic Tank Size: 1000 gallons Drainfield Size: 150 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:


I, TERRY OEDEWALDT *, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: [signature] *Date:* 8/12/2016

Title: PRESIDENT

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly

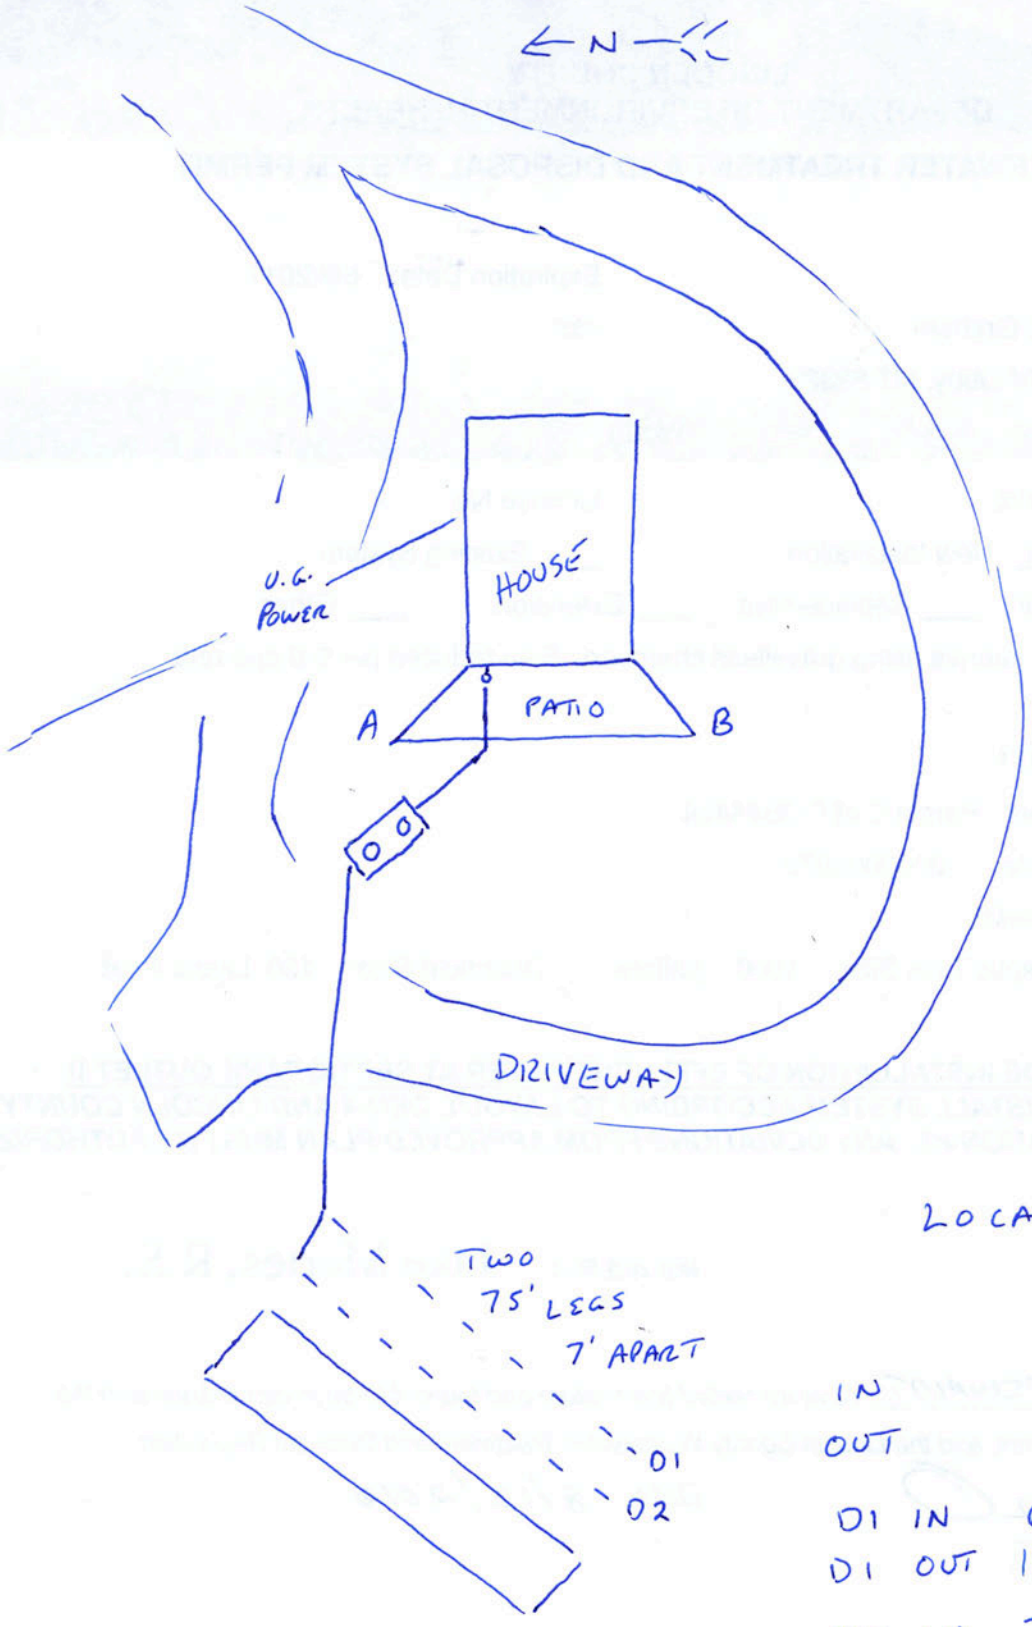

LOCATIONS

	A	B
IN	9'	49'4
OUT	11'9	54'5
D1 IN	66'9	86'
D1 OUT	122'4	104'4
D2 IN	73'6	92'10
D2 OUT	126'8	110'6