LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 5/19/2017 Expiration Date: 5/19/2018

Property Owner: Lyndee Griffith c/o: Koocanusa Plumbing

Address: PO BOX 2045

Telephone: (Home) [redacted] (Work)

Installer: Koocanusa Plumbing License No. 8

___ New Installation ___xx_ Existing System

____ Repair ___xx_ Replacement ____ Extension ____ Other

Describe: Two 68' trenches using gravelless chambers, size reduced per app rate.

Parcel Description:

Legal: S33 T36 R26

Address or Location: Tract 1C4 COS 1711

Geo/Assessors code: 0000013076

Approved Design Criteria:

Bedrooms 2 Septic Tank Size: 1000 gallons Drainfield Size: 136 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Michael Nelson, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: [signature] *Date:* 23 May 2017

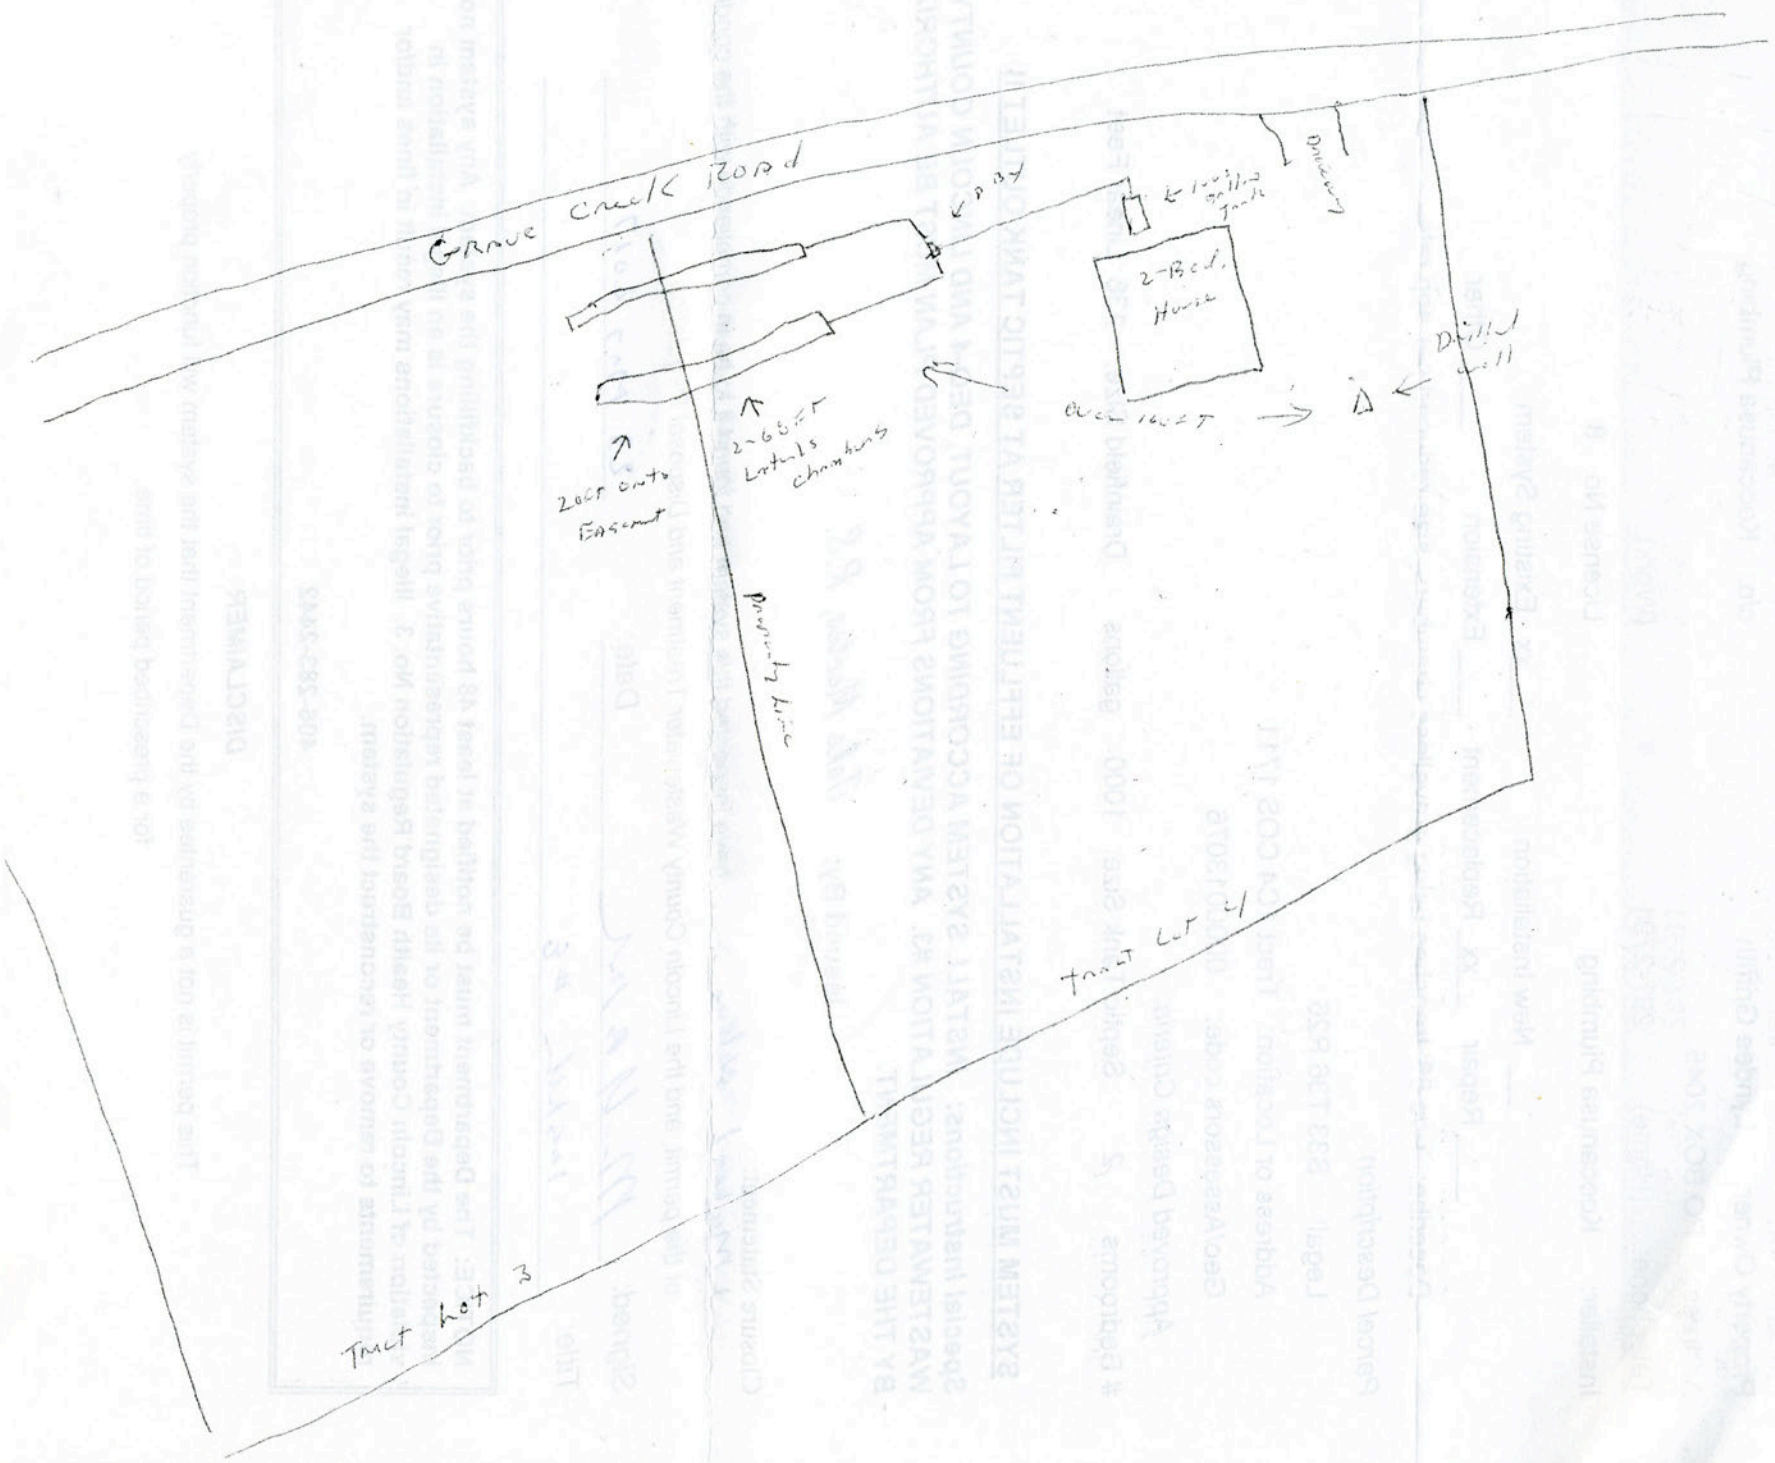
Title: Install #8

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


North
Grave Creek Road
Driveway
4-100 gallon Tanks
2-Bed. House
Drill Well
Property Line
Tract Lot 4
Tract Lot 3