County

LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 5/9/2017 Expiration Date: 5/9/2018

Property Owner: Wesley D. Harmon c/o: Tom Cole

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: Talley Hoe License No. 1

___ New Installation __xx_ Existing System

____ Repair __xx_ Replacement ____ Extension ____ Other

Describe: Replaceing old system with 375 sqft adsorption bed. Per 0.8 app rate

Parcel Description:

Legal: S25 T30 R31

Address or Location: Pinewood Village Blk 2 Lot 3 & 4

Geo/Assessors code: 0000009717

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000 gallons Drainfield Size:

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Thomas J. Cole *, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Thomas J Cole *Date:* May 23, 2017

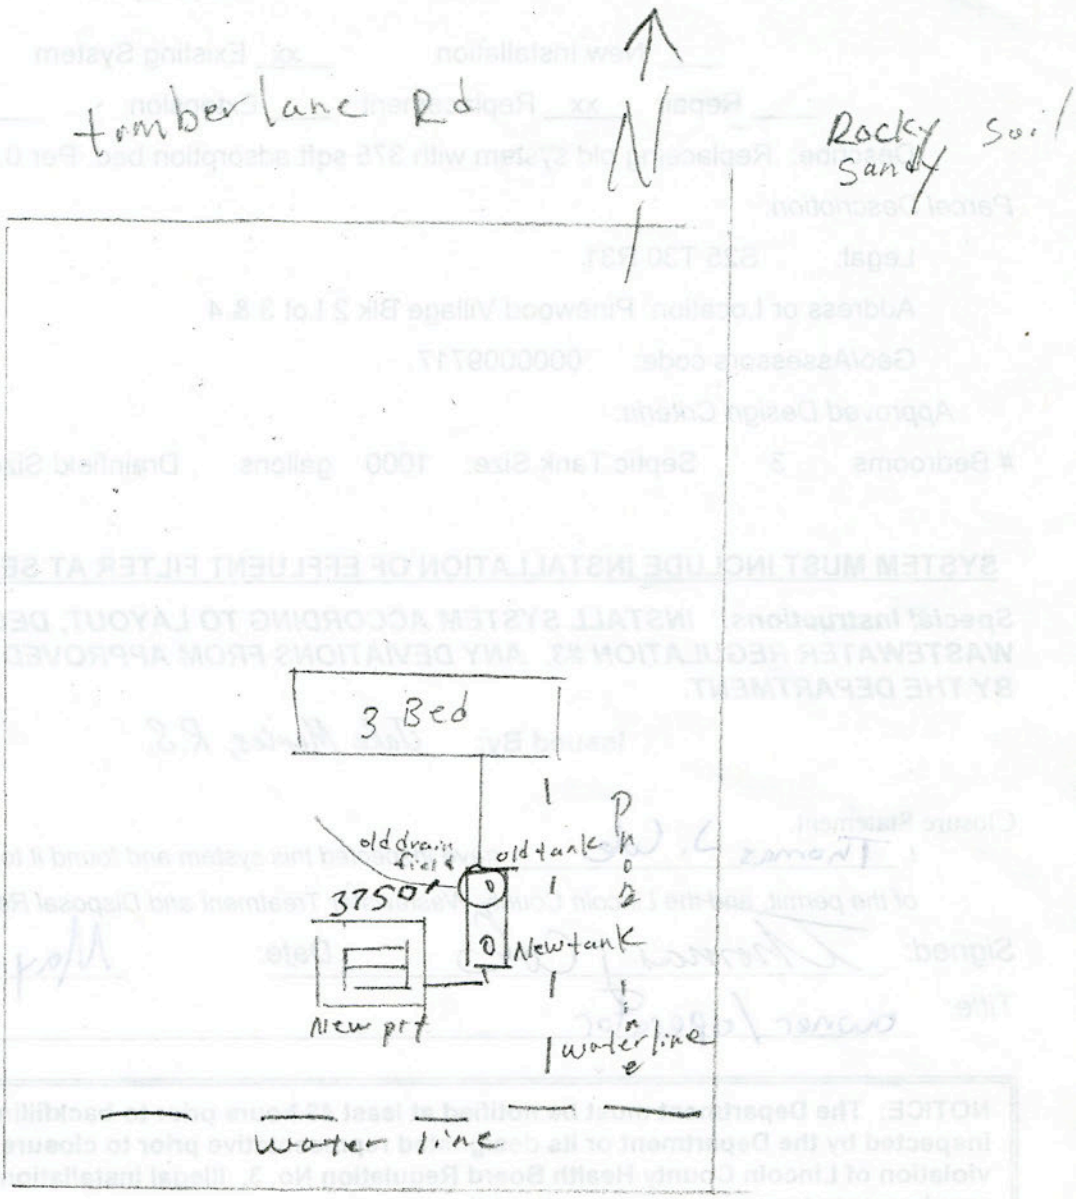
Title: owner/operator

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


tomberlane Rd
N
Rocky
Sandy
Soil
3 Bed
old drain field
old tank
3750
New tank
New prf
Water line
Water line