LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 06/03/2014 Expiration Date: 06/04/2015

Property Owner: Nancy Haugan c/o:

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: Gideon Yutzy License No. 113

____ New Installation __XX__ Existing System

_____ Repair _____ Replacement __XX__ Extension _____ Other

Describe: Expanding existing drainfield by adding one (1) 100-foot line.

Parcel Description:

Legal: S11 T37 R28 Tract 1A of COS #841 & Tract A of COS #2748

Address or Location: 208 A Turkey Track Drive

Approved Design Criteria:

Bedrooms: 3 Existing Septic Tank Size: 1000 gallons Drainfield Extension Size: 100 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kendra J. Lind, R.S.*

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

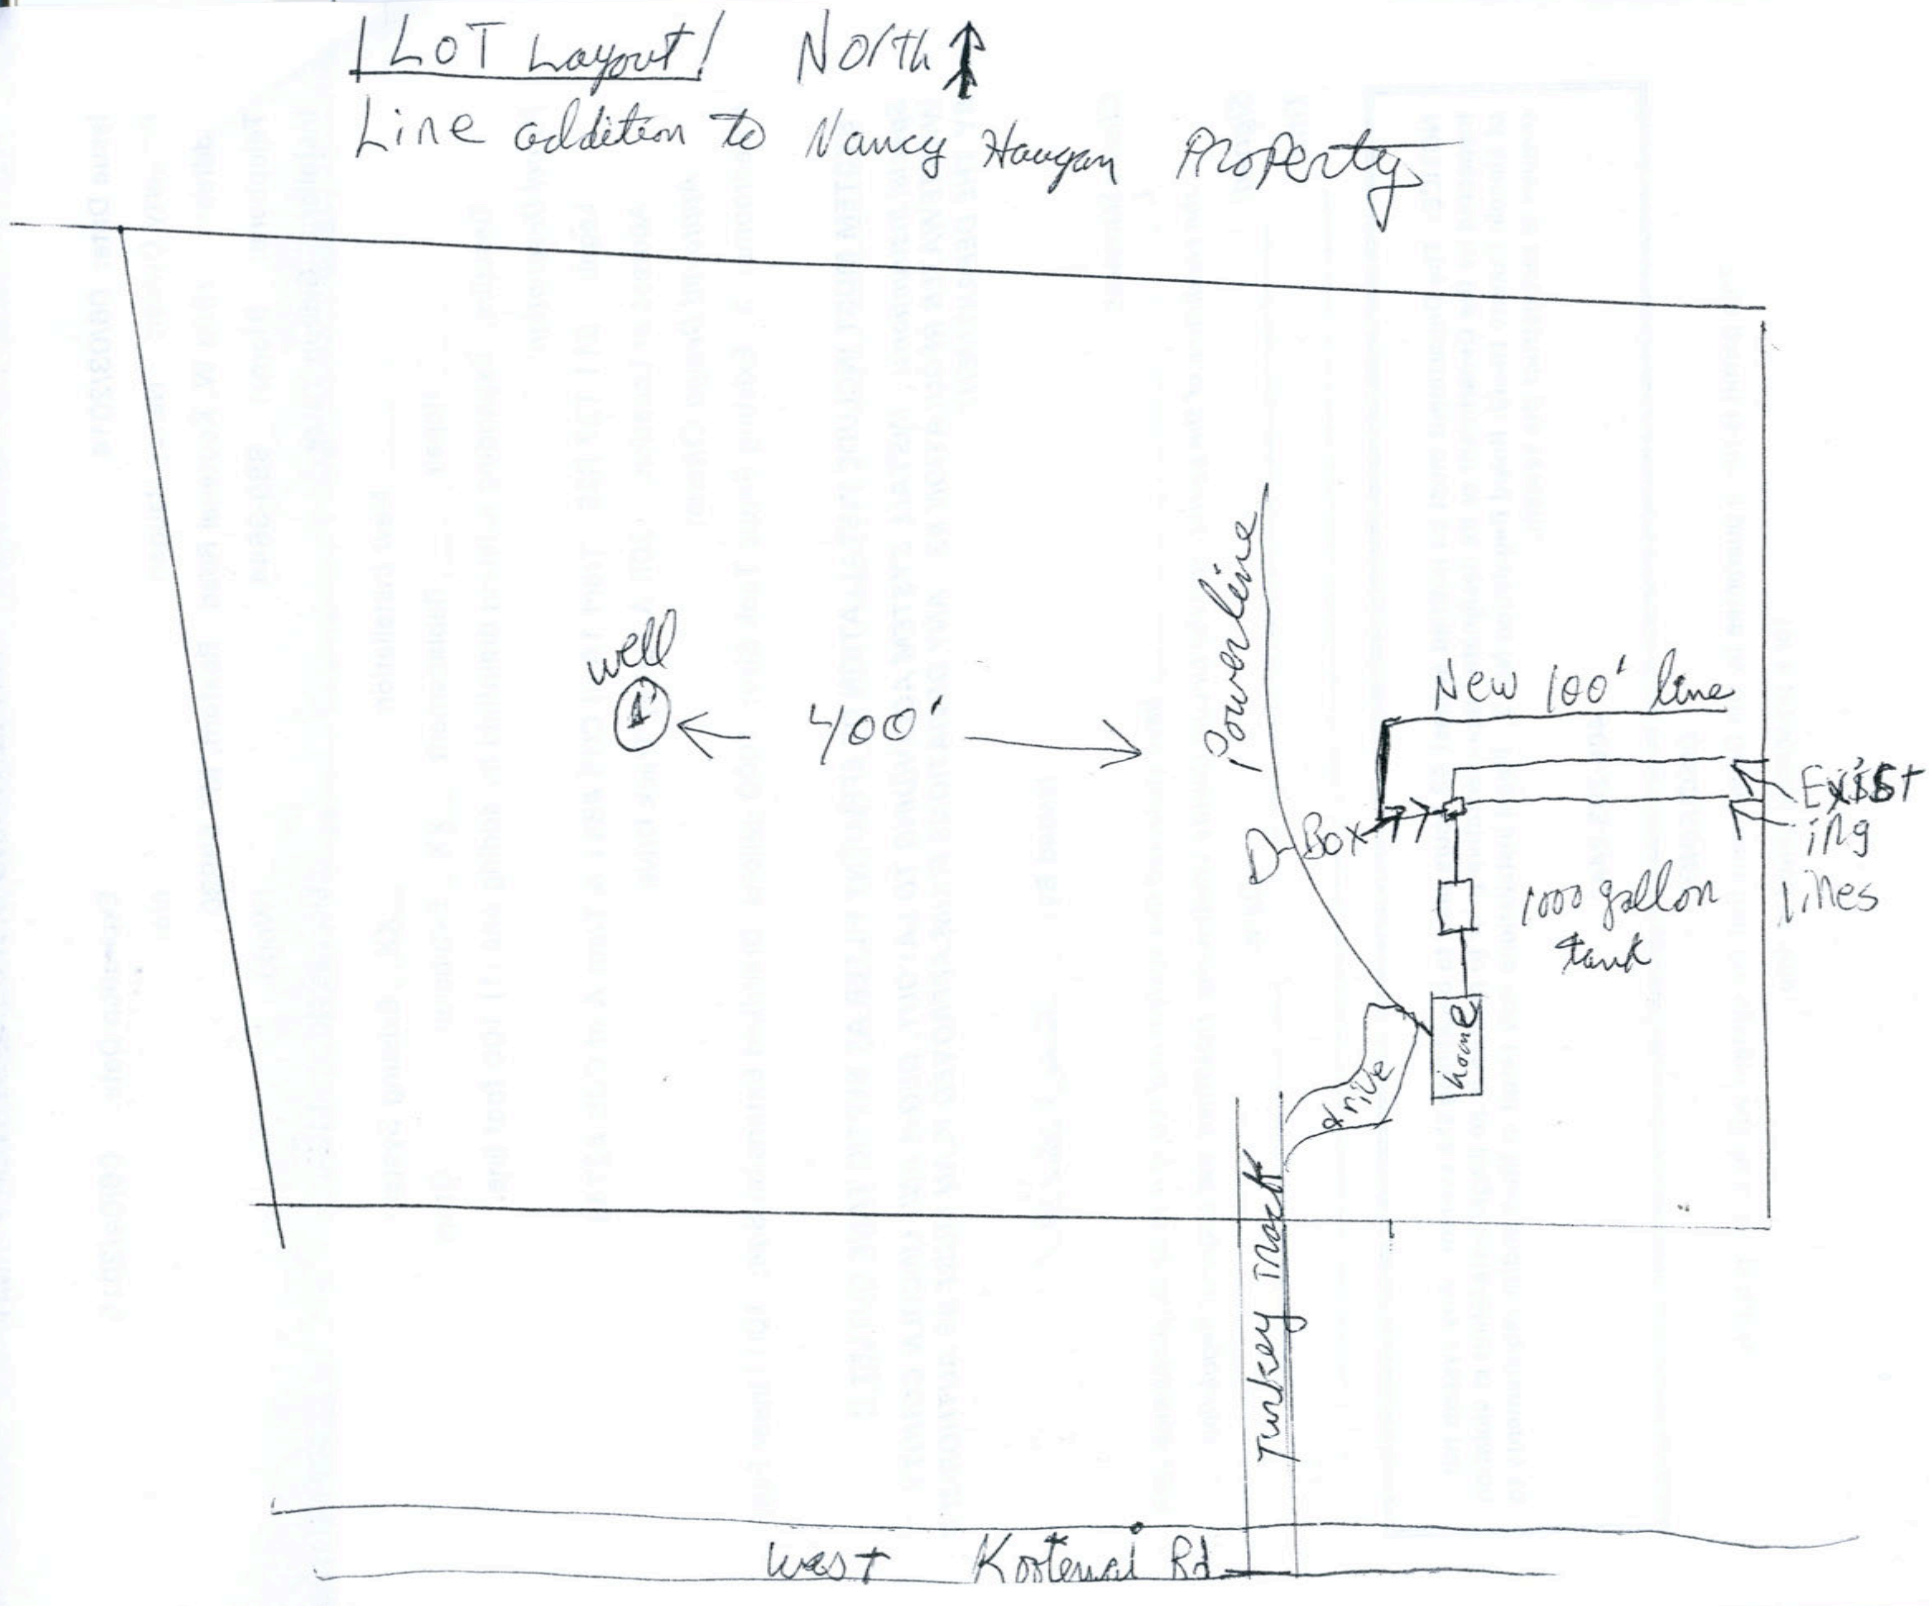
Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


LOT Layout
North
Line addition to Nancy Haugan Property
well
400'
power line
New 100' line
D-Box
Existing lines
1000 gallon tank
home
drive
Turkey Track
west Kootenai Rd