LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 7/26/2016 Expiration Date: 7/26/2017

Property Owner: Mark & Kristy Hensel c/o:

Address:

Telephone: (Home) [redacted] (Work)

Installer: License No.

__xx__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Two 73' pressure dosed laterals in 3' sand lined trenches. (Per DEQ-4 2013)

Parcel Description:

Legal: S22 T37 R31

Address or Location: Silver Tip Ranch, Block 2, Lots 13 &14A

Geo/Assessors code: 0000053621

Approved Design Criteria:

Bedrooms 4 Septic Tank Size: 1500 gallons Drainfield Size: 146 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Jake Mertes, R.S.*

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

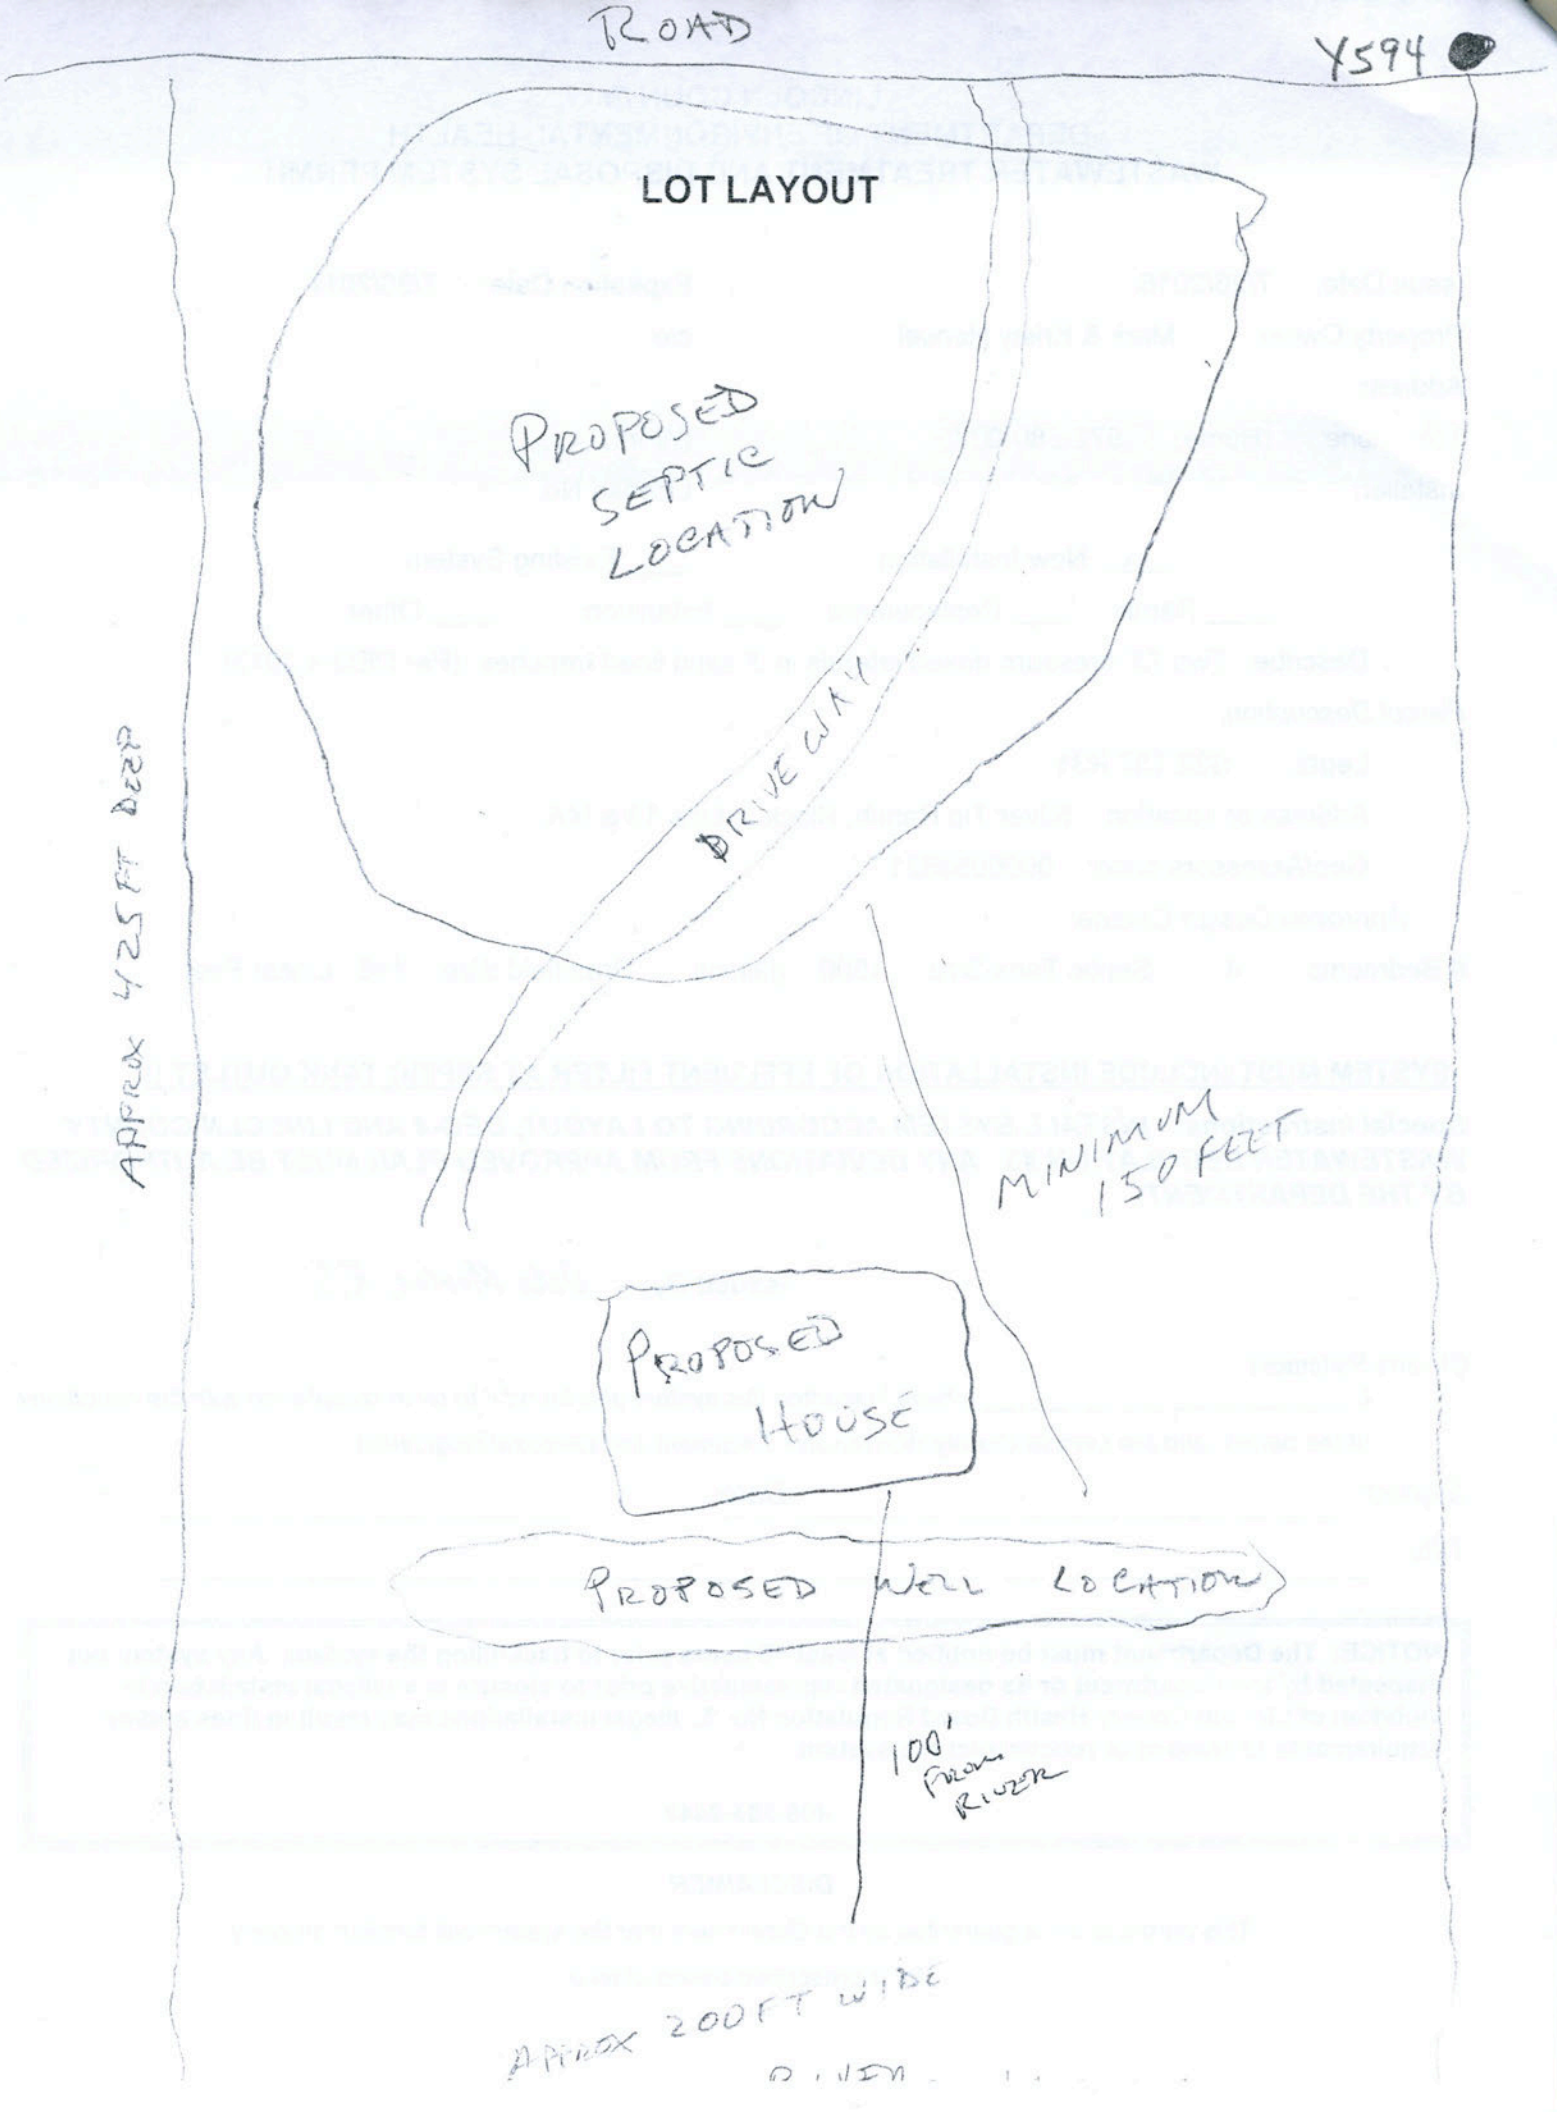
Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


ROAD
Y594
LOT LAYOUT
PROPOSED SEPTIC LOCATION
DRIVEWAY
APPROX 425 FT DEEP
MINIMUM 150 FEET
PROPOSED HOUSE
PROPOSED WELL LOCATION
100' FROM RIVER
APPROX 200 FT WIDE