LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 11/14/2017 Expiration Date: 11/14/2018

Property Owner: Jeff Hoff c/o: T. Oedewaldt

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: Terry Oedewaldt License No. 002

___ New Installation ___ Existing System

___ Repair __xx__ Replacement ___ Extension ___ Other

Describe: Three 65' laterals using gravelless chambers. Size reduced per 0.8 app rate.

Parcel Description:

Legal: S29 T31 R31

Address or Location: Rawlings Road Lot 9

Geo/Assessors code: 0000008424

Approved Design Criteria:

Bedrooms 5 Septic Tank Size: 1000/500 gallons Drainfield Size: 195 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, TERRY OEDEWALDT, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ Date: 11/15/2017

Title: PRESIDENT


NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

LOT LAYOUT JEFF HOFF 11/10/17

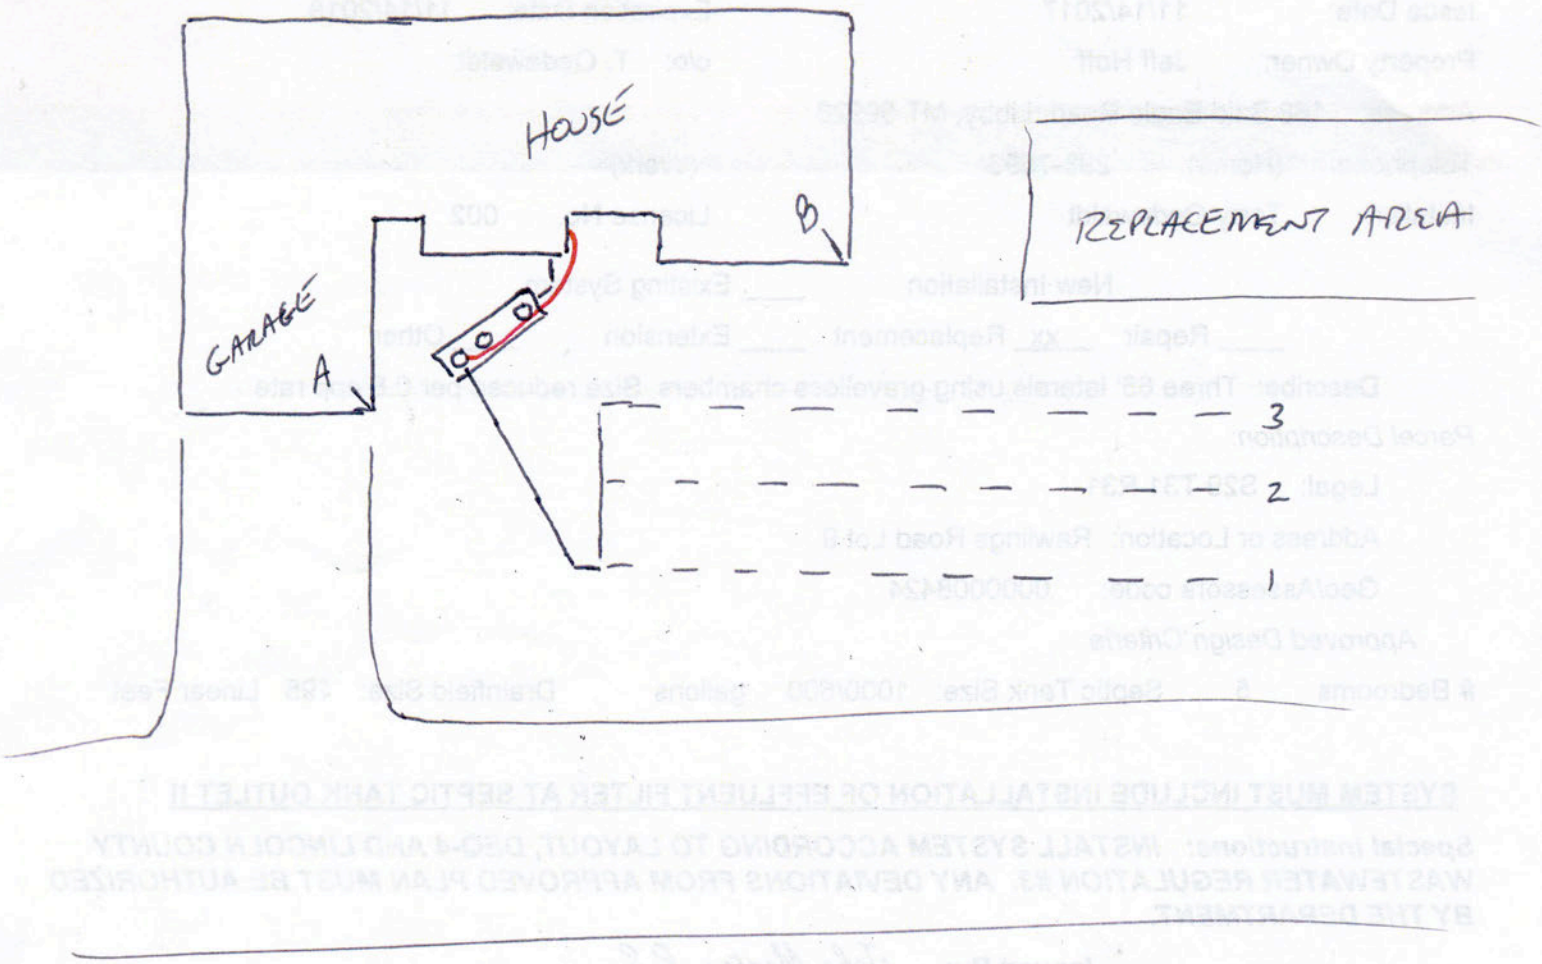

JEFF HOFF SEPTIC LOCATION

	A	B
INLET	23'	31'11
OUTLET	17'8	36'6
PUMP	13'11	40'8
D1 START	31'5	36'5
D1 END	95'3	54'4
D2 START	30'2	30'10
D2 END	94'6	50'8
D3 START	30'	26'3
D3 END	94'2	47'