LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 05/13/2015 Expiration Date: 05/14/2016

Property Owner: David Hulslander c/o:

Address: P.O. Box 64 Stryker, MT 59933

Telephone: (Home) [redacted] (Work)

Installer: Rupert Schreiner License No. 19

____ New Installation __XX__ Existing System

_____ Repair __XX__ Replacement_____ Extension _____ Other

Describe:

Parcel Description:

Legal: S20 T34 R24 State Land Agreement #3050882

Address or Location: Fish Lake Road

Approved Design Criteria:

Bedrooms: 3 Septic Tank Size: 1000 gallons Drainfield Size: 3-Ring Drywell System

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kendra J. Lind, R.S.*

Closure Statement:

I, Rupert Schreiner, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Rupert Schreiner *Date:* 5-23-15

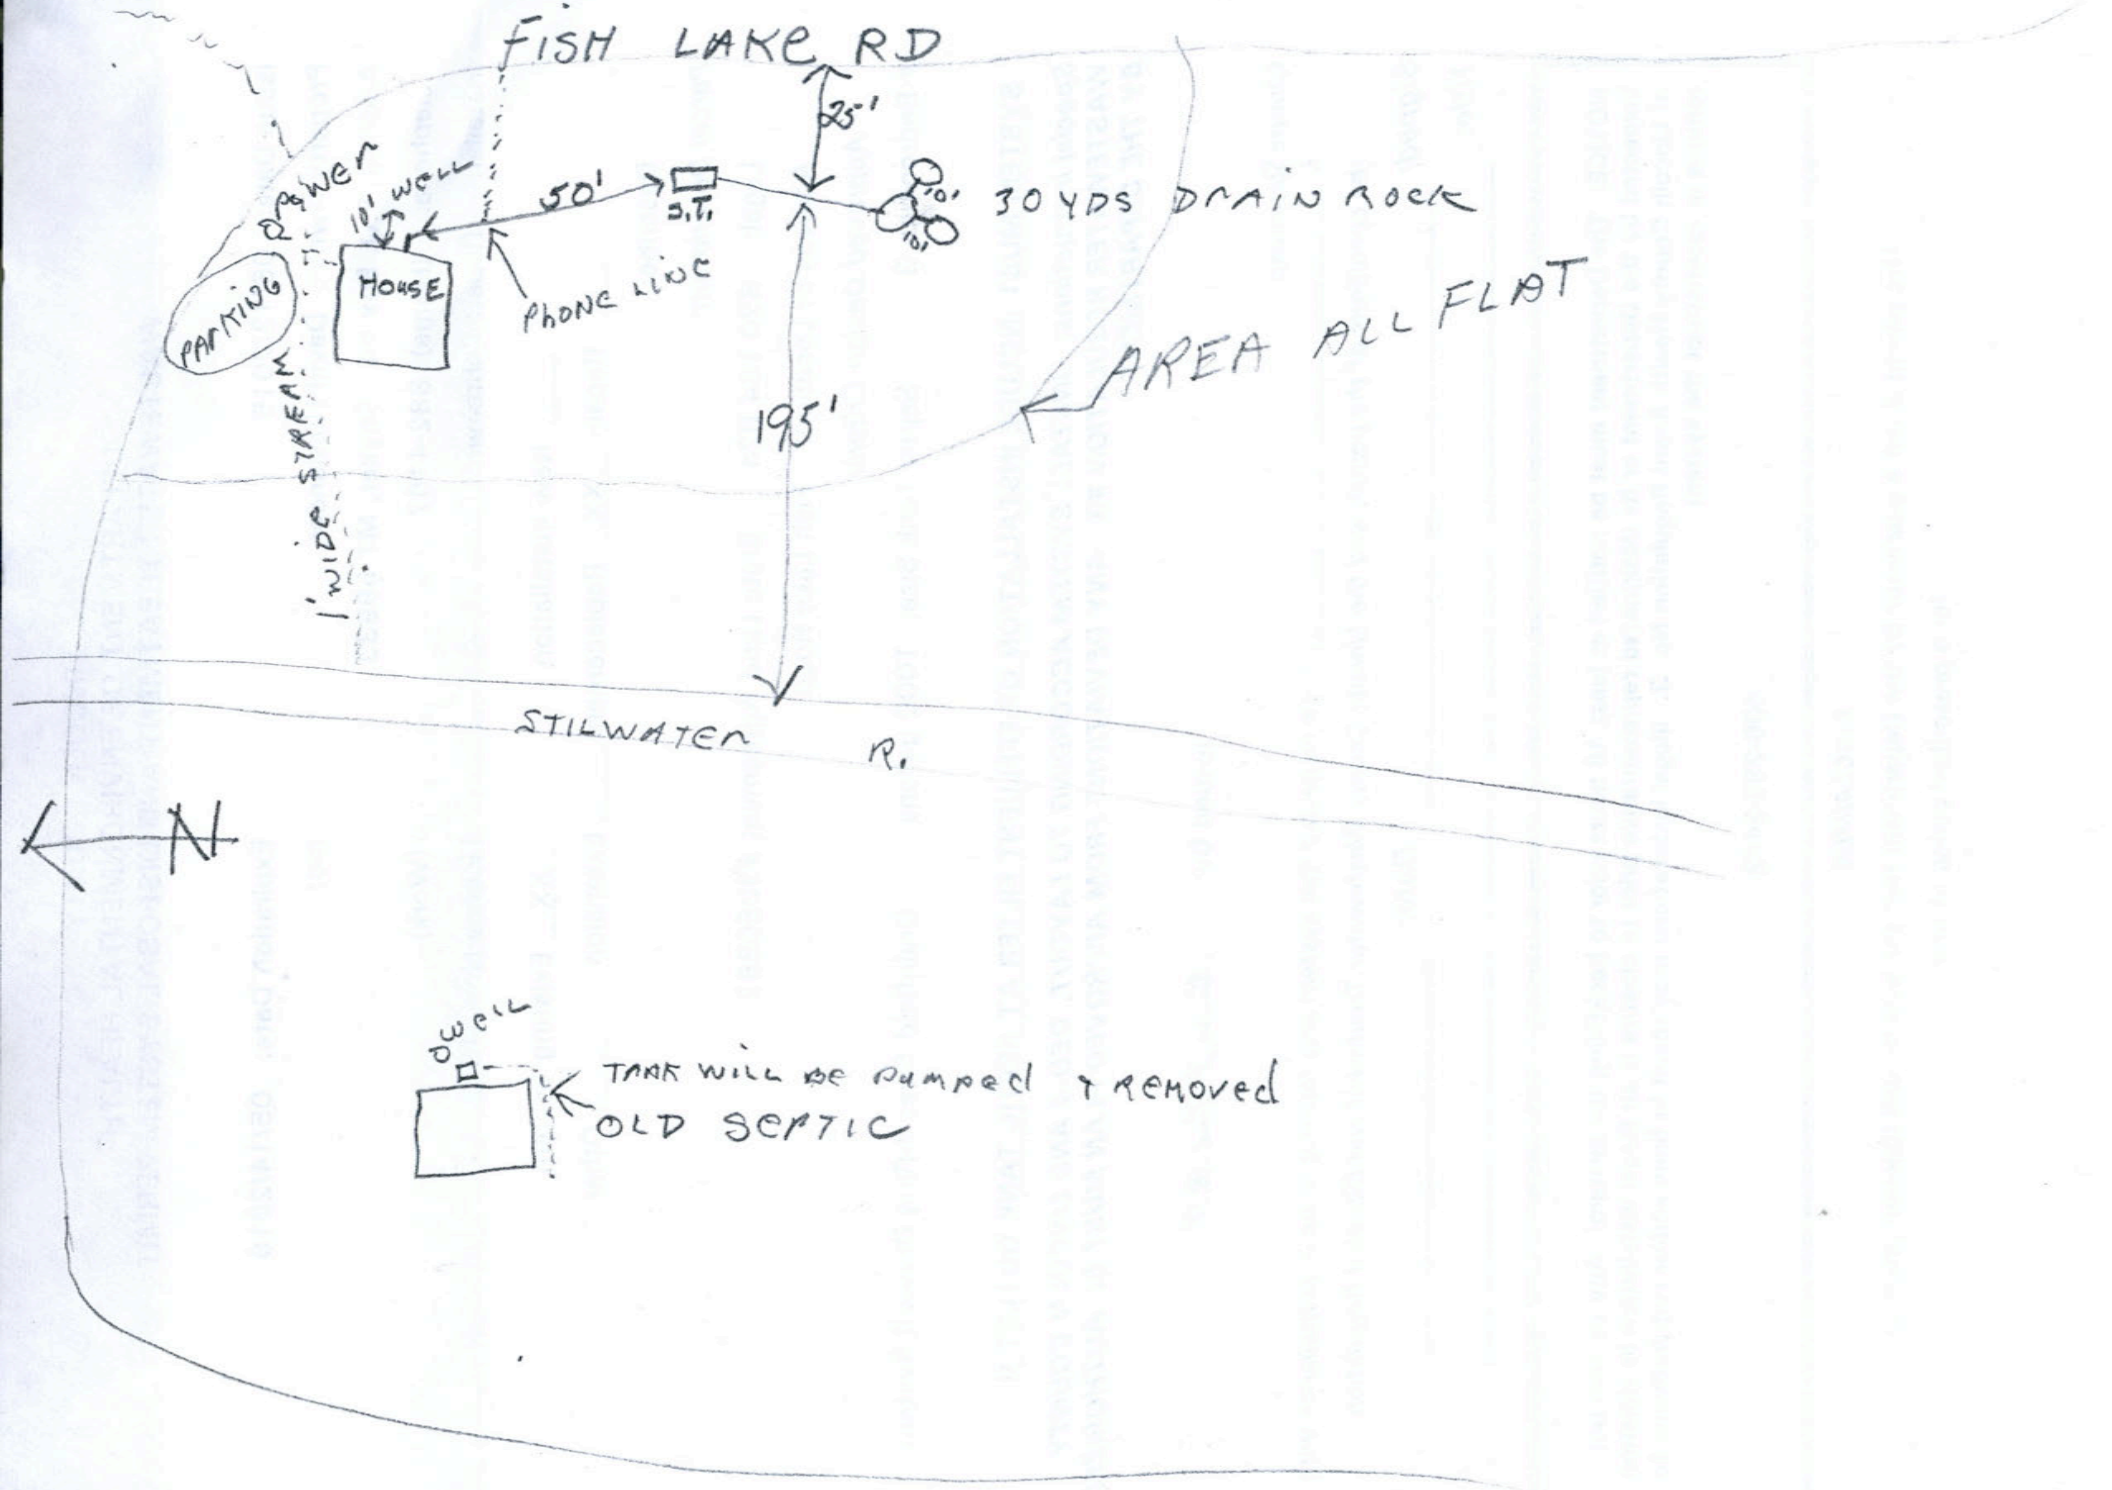
Title: Lic #19

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


FISH LAKE RD
25'
POWER
10' WELL
50'
S.T.
30 YDS DRAIN ROCK
HOUSE
PHONE LINE
PARKING
AREA ALL FLAT
1' WIDE STREAM
195'
STILWATER R.
N
WELL
TANK WILL BE PUMPED & REMOVED
OLD SEPTIC