LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 05/06/2015 Expiration Date: 05/07/2016

Property Owner: Gary & Kathleen Isaacson c/o:

Address: [redacted]

Telephone: (Home) [redacted] (Work) [redacted]

Installer: License No.

____ New Installation __XX__ Existing System

_____ Repair __XX__ Replacement_____ Extension _____ Other

Describe: Using gravelless chambers – sizing reduction allowed per "Drainfield Size" below.

Parcel Description:

Legal: S24 R27 R28 West Crystal Lake, Lot 002 or Tract B39

Address or Location: 657 Crystal Lake Road

Approved Design Criteria:

Bedrooms: 3 Septic Tank Size: 1000 gallons Drainfield Size: 144 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kendra J. Lind, R.S.*

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

Title: _____

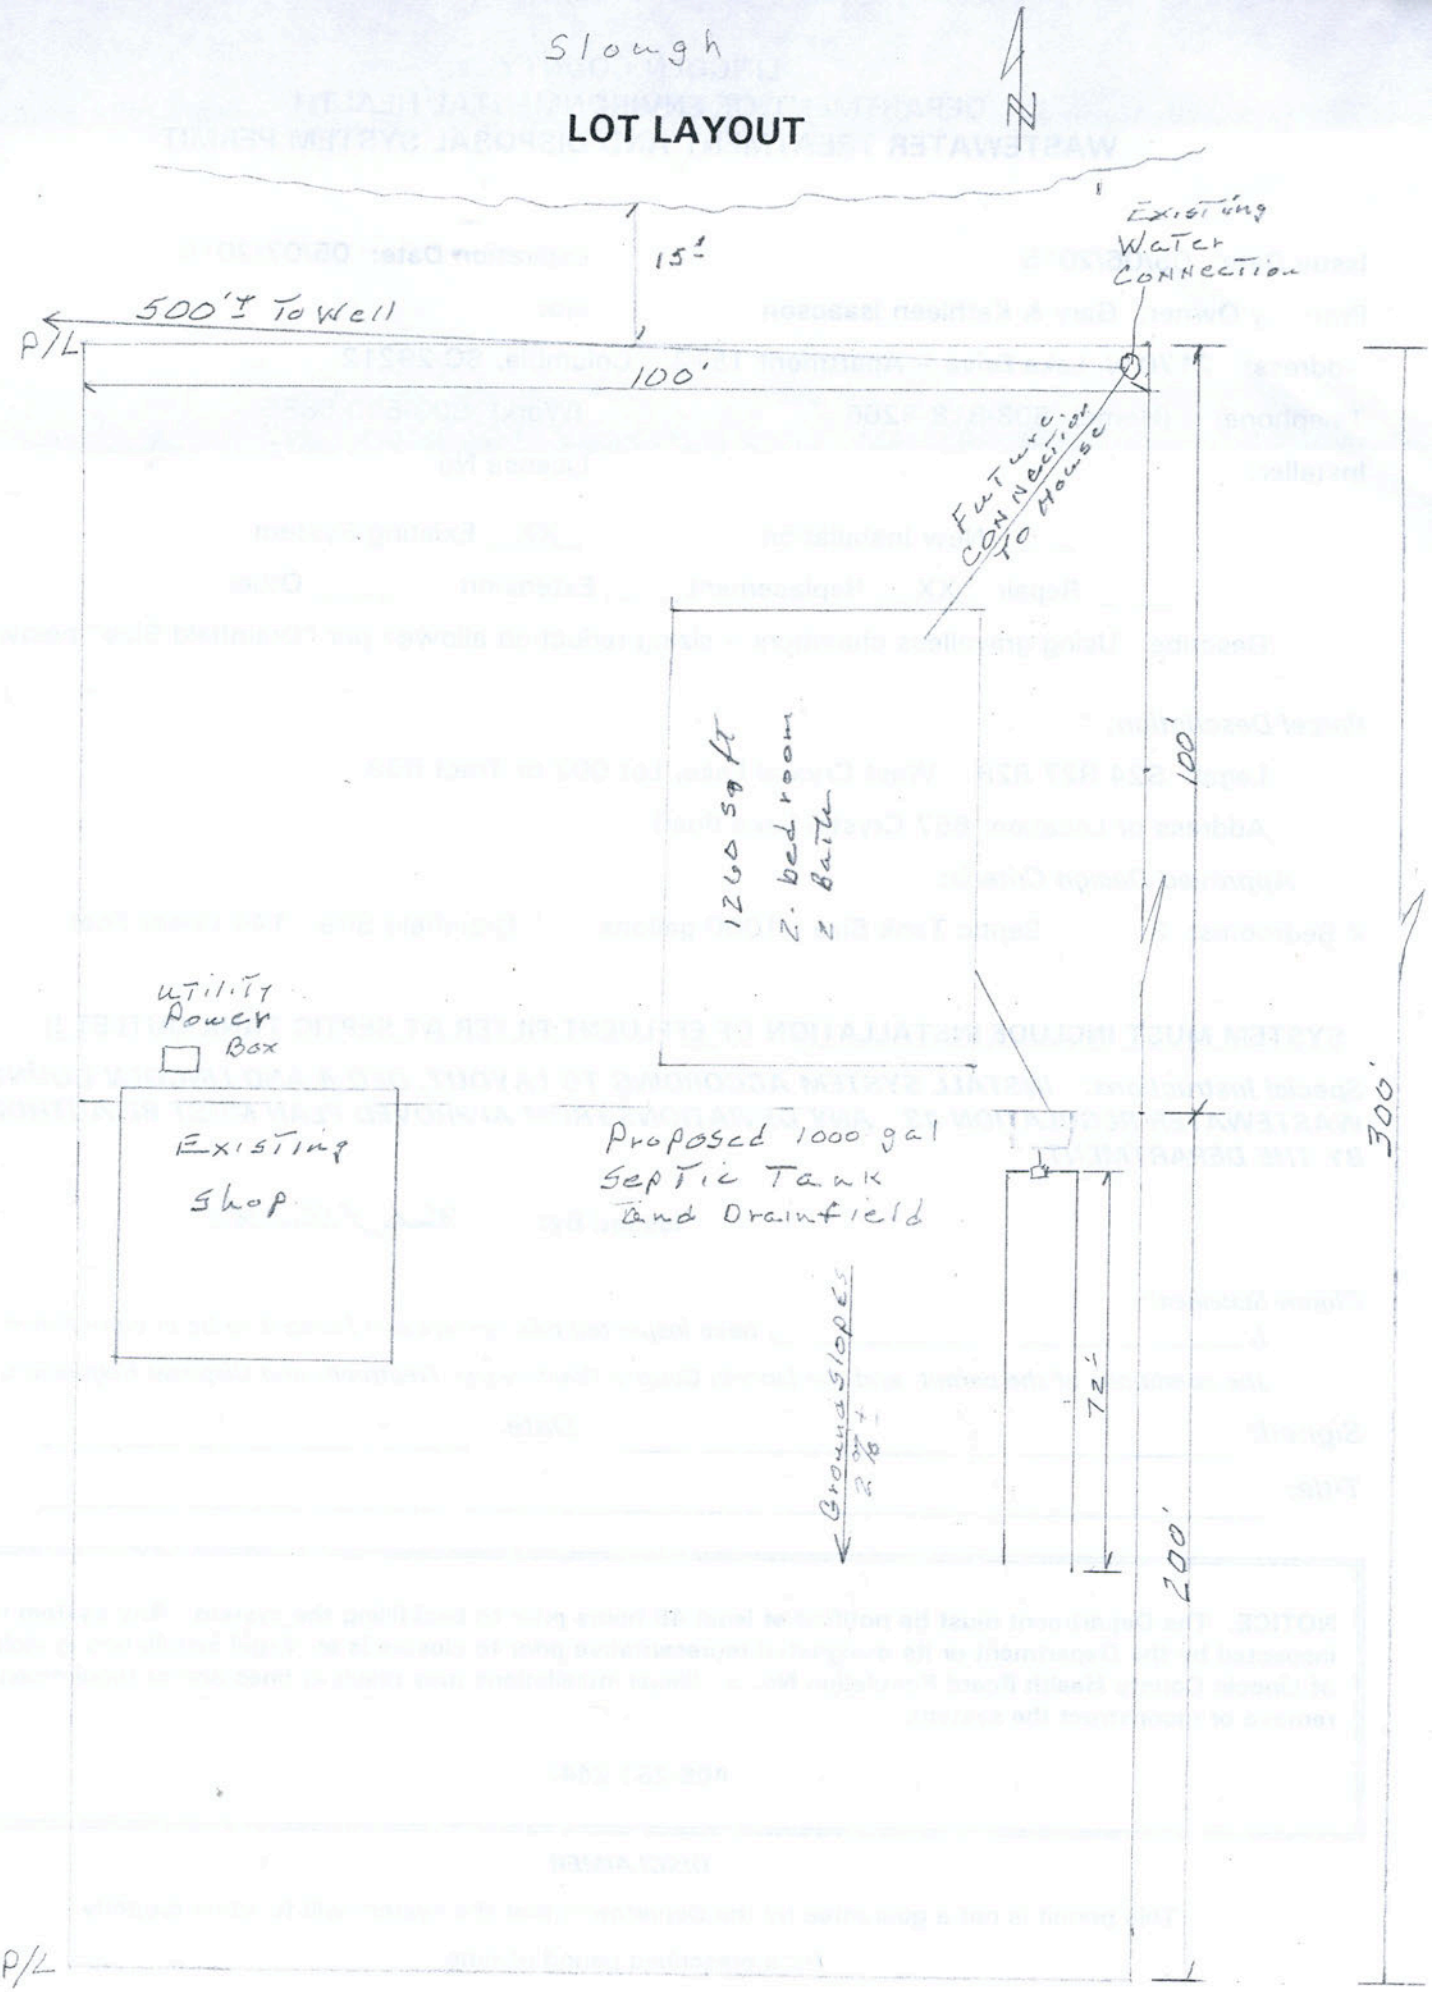
NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

LOT LAYOUT


Slough
N
15'±
Existing Water Connection
500'± To Well
P/L
100'
Future Connection To House
1200 sq ft
2 bed room
2 Bath
100'
Utility Power Box
Existing Shop
Proposed 1000 gal Septic Tank and Drainfield
Ground Slopes
72'±
200'
300'
P/L