LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 10/14/2025 Expiration Date: 10/13/2026 Permit#25-15868

Property Owner: Dave and Sarah Keen

Mailing Address: [redacted]

Installer: Bobbie-Jo Sprague License #: 182

Approved Work: (Check One) ☐ New Installation ☒ Existing System

☐ Replace Drainfield ☐ Replace Tank ☒ Extension

Describe: Installation of an additional tank for an additional Bedroom and Office. 3 Bedroom House and separate office.

Legal: S18, T35 N, R27 W, COS 2565, PARCEL A, ACRES 20.057

Property Address: 1617 Virginia Hill Rd., Rexford, MT 59930 Assessment Code: 15868

DEQ COSA: E.Q.# Date:

Approved Design Criteria: Installation of an additional tank for an additional Bedroom and Office. 3 Bedroom House and separate office. 2 Existing Laterals @ 100' and 1000 gallon tank, adding 2 additional Laterals @ 100' and 1000 gallon tank.

# of Bedrooms: 3 +Office Septic Tank Size: 2 X 1000 Trench Width: 24"

# of Laterals: 4 Length of Laterals: 100' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, Circular DEQ-4, and COSA(If Applies). It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Robin Blumberg, RS*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:


This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Robin Blumberg *Date:* 10/27/25

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.

LOT LAYOUT
WAYNE DEGOINES
1501 VIRGINIA HILL ROAD

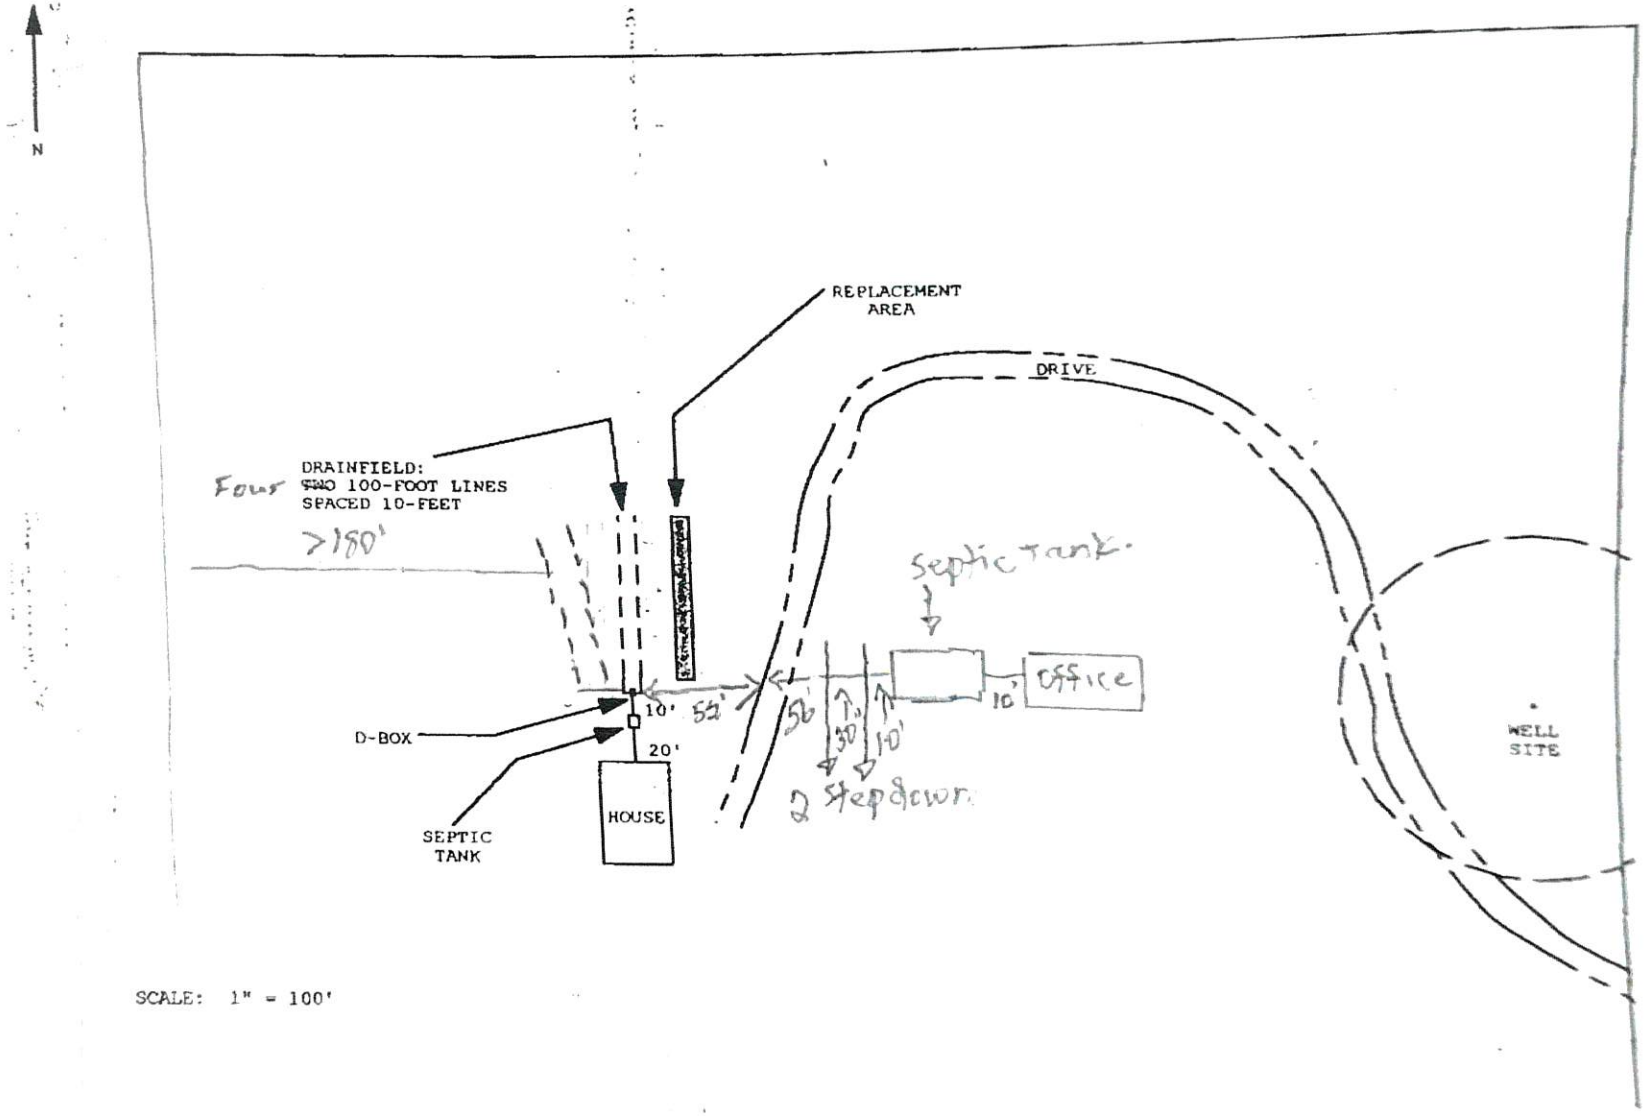

SCALE: 1" = 100'