LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 9/27/2017

Expiration Date: 9/27/2018

Property Owner: Michael Krooshoop

c/o: Corunna Krooshoop

Address: [redacted]

Telephone: (Home) (Work)

Installer: Bradley Persson

License No. 159

__xx__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Three 84' pressure dosed laterals in 2' wide trenches. Size reduced per 0.4 app rate

Parcel Description:

Legal: S7 T36 R27

Address or Location: Tobacco Bay Estates Lot 12

Geo/Assessors code: 0000055347

Approved Design Criteria:

Bedrooms 2 Septic Tank Size: 1000/500 gallons Drainfield Size: 252 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, BRADLEY S. PERSSON, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: [signature] Date: 11-11-17

Title: INSTALLER.

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

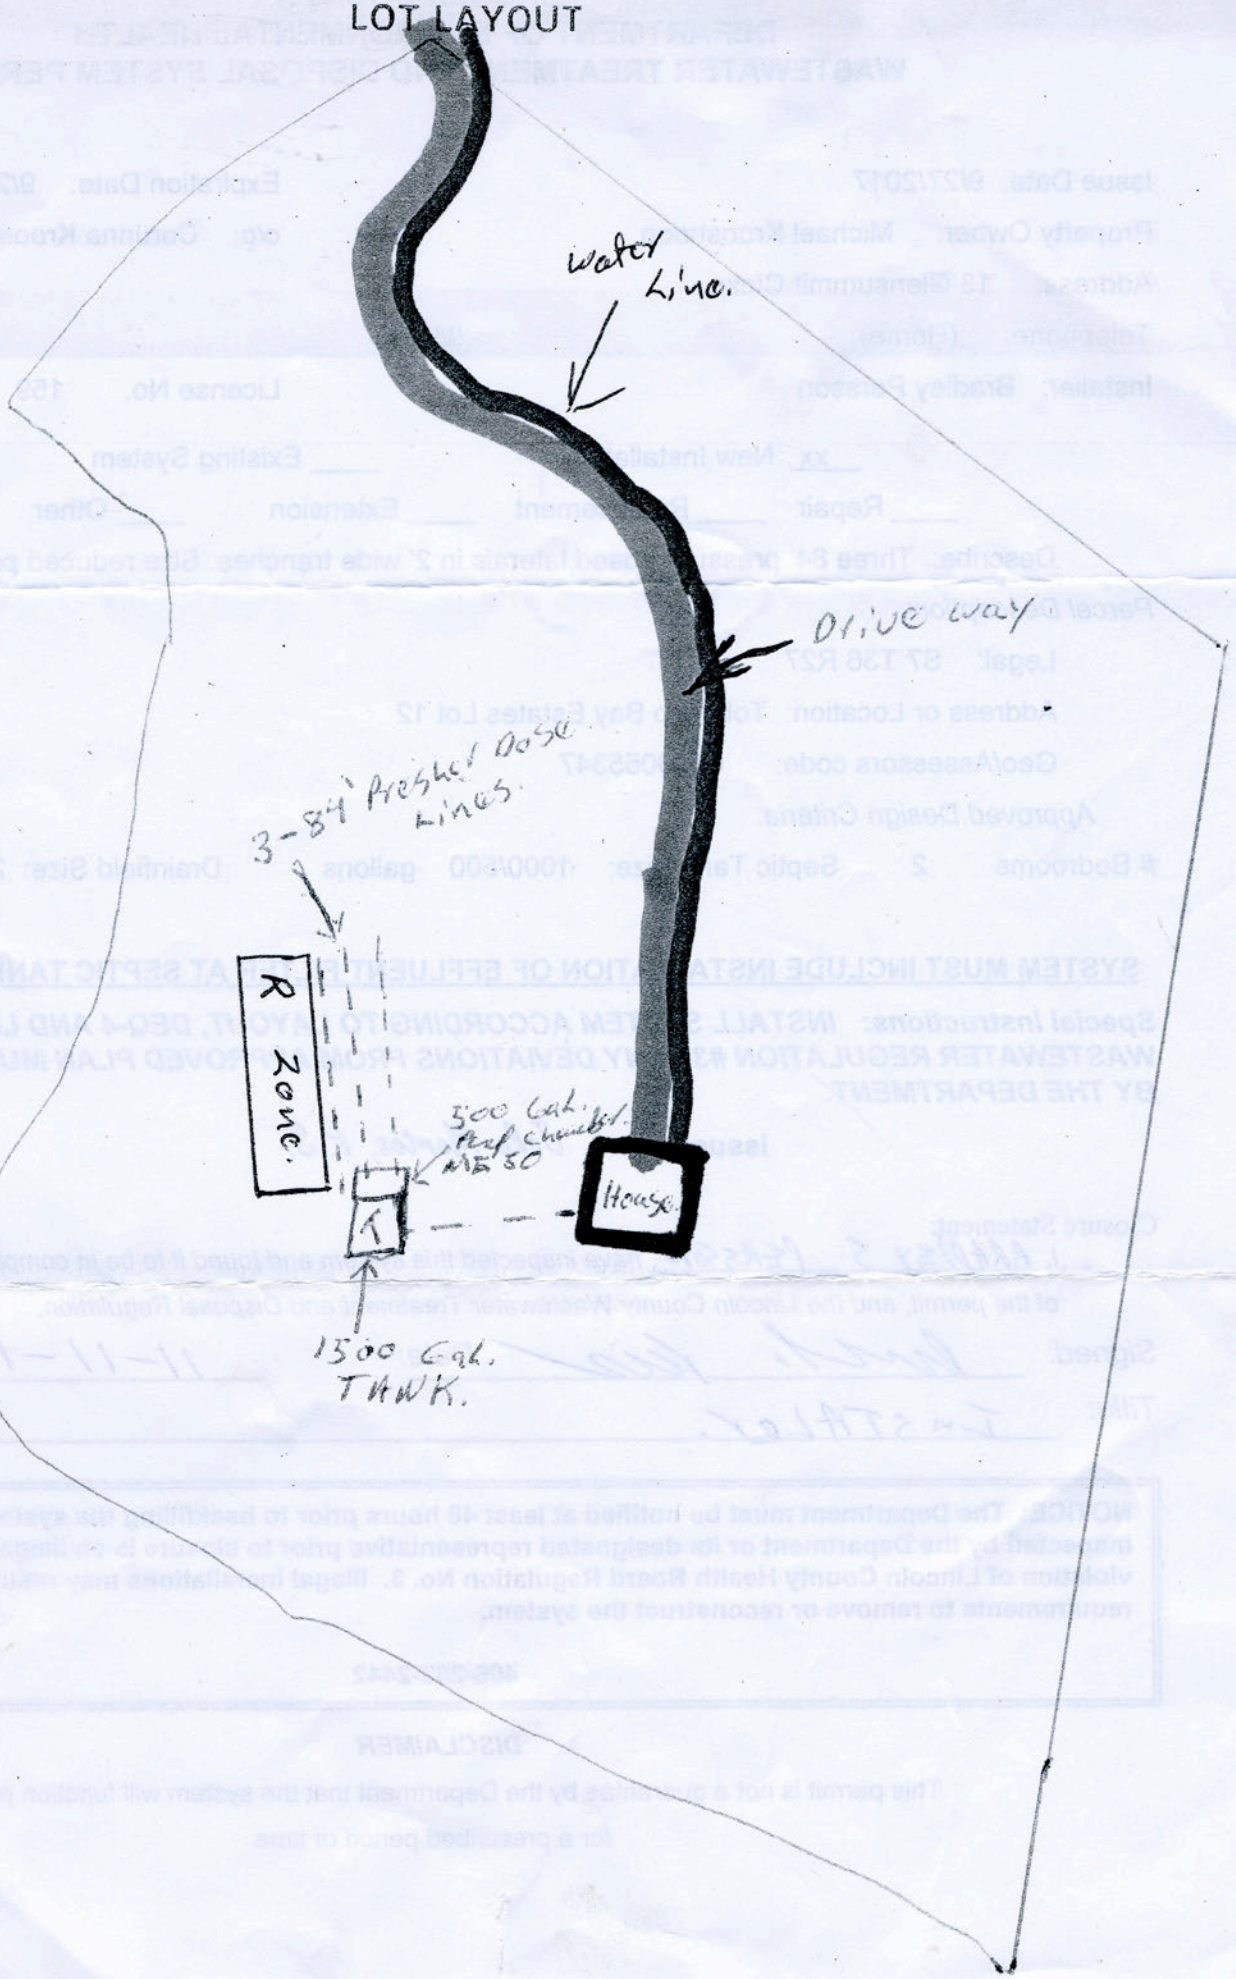
406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

SV

LOT LAYOUT


water Line.
Drive way
3-84' Presbel Dose Lines.
R Zone.
500 Gal. Pump chamber MF 50
House
1500 Gal. TANK.