LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 5/04/2016 Expiration Date: 5/04/2017

Property Owner: John and Teresa Krum c/o: Gideon Yutzy

Address: PO Box 486 Weimar, CA 95736

Telephone: (Home) (Work)

Installer: Gideon Yutzy License No. 113

__xx__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Four 84' trenches using gravelless chambers

Parcel Description:

Legal: S11 T35 R26

Address or Location: Creekside Drive off Graves Creek

Geo/Assessors code: 0000014098

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000 gallons Drainfield Size: 384 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Gideon Yutzy, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Gideon Yutzy *Date:* 5-15-16

Title: Licensed Installer; Lic # 113

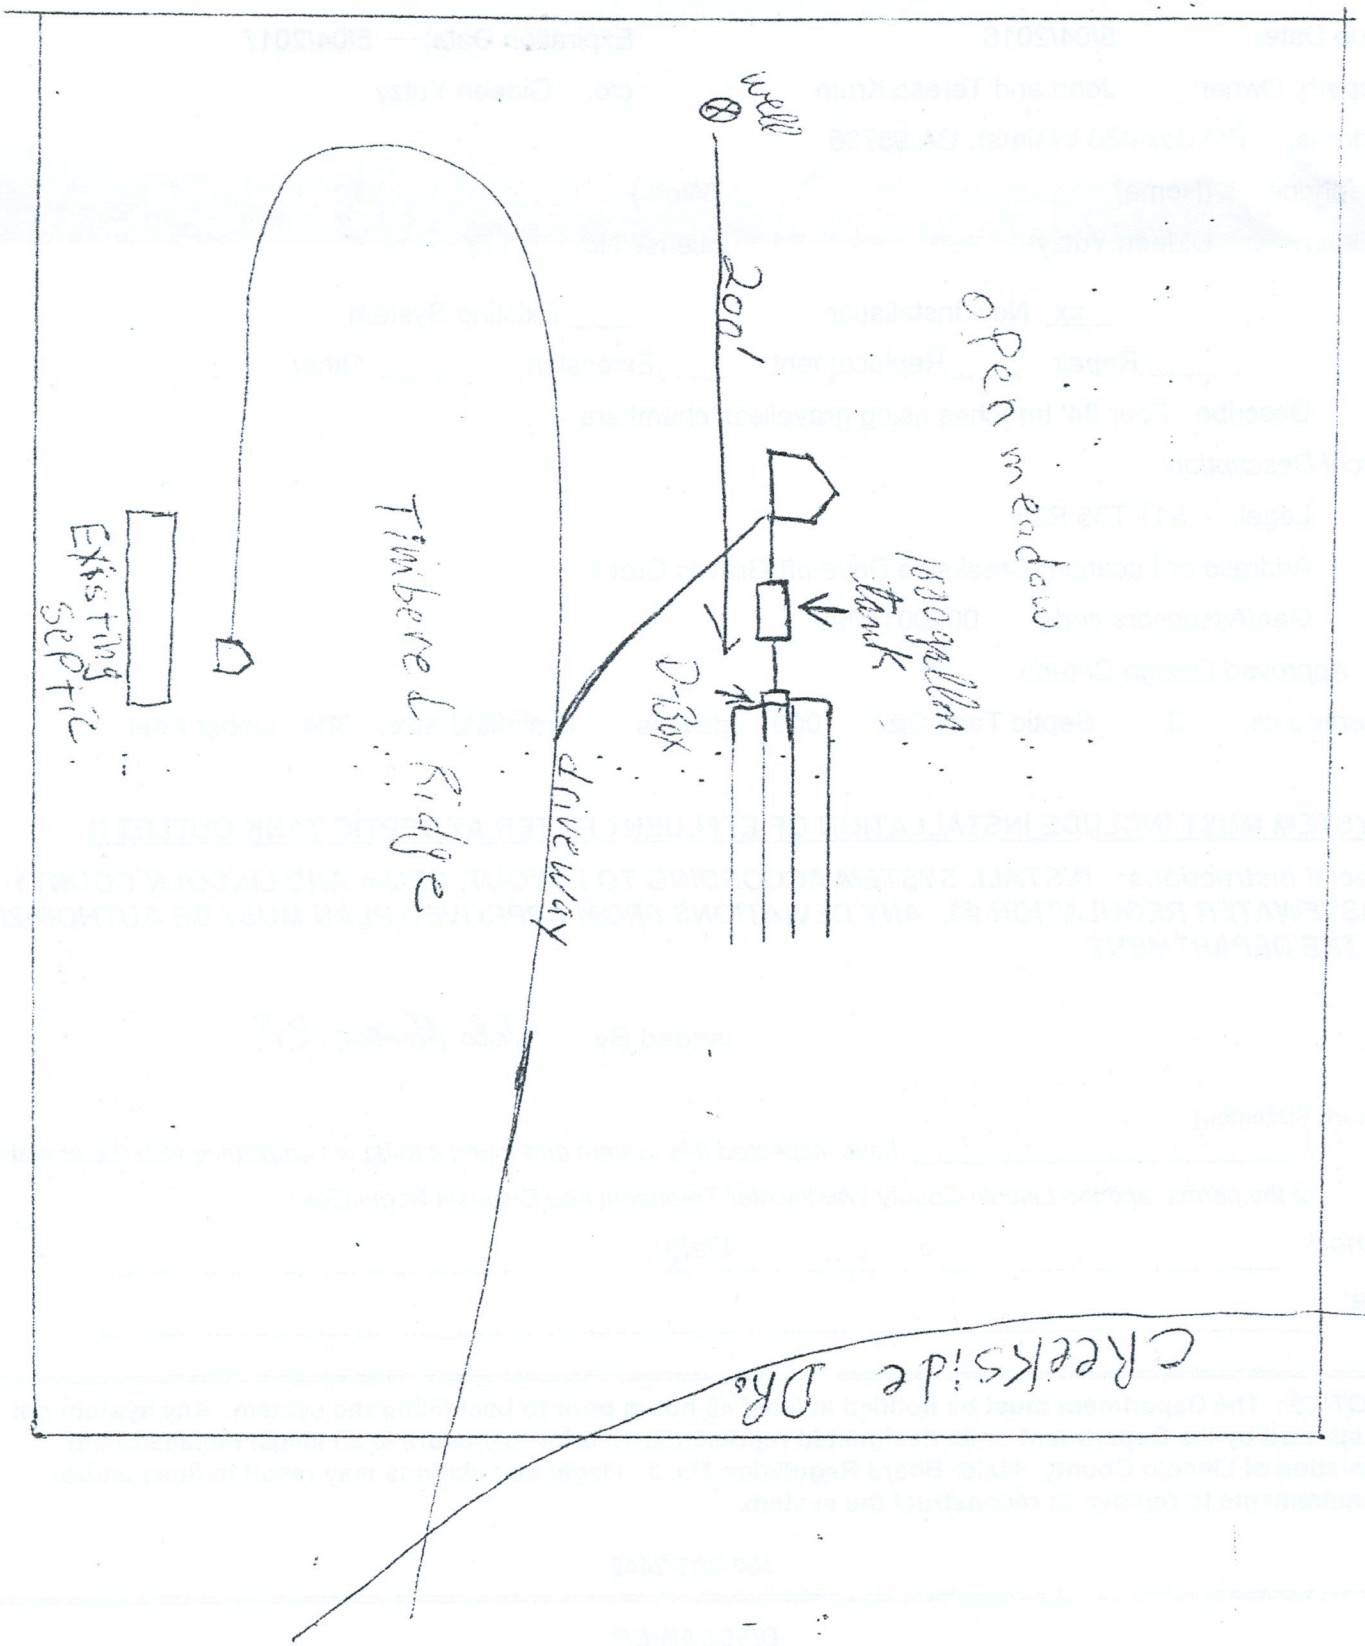
NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

LOT LAYOUT


well
200'
open meadow
1000 gallon tank
D-Box
driveway
Timberel Ridge
Existing septic
Creekside Dr.