LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
AFFIDAVIT OF WASTEWATER TREATMENT AND DISPOSAL SYSTEM COMPLIANCE REVIEW FOR SYSTEM INSTALLED, REPAIRED OR REPLACED WITHOUT A VALID PERMIT

Issue Date: 8/28/2015

Property Owner: Robert Lance, Kathryn Posten

Mailing Address: [redacted]

Telephone: (Home) [redacted] (Work)

Name of Person Who Installed System Being Reviewed: Robert Lance

Type of System Work Reviewed:

__xx__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: 5 90' trenches, gravity fed manifold distributed system.

Property Description:

Legal: S28 T37 R28

Address or Location: 37 Lupine Dr. Rexford, MT 59930

Reviewed Design Components:

Wastewater Flows: 225gpd (2 bed) Sewer Lines: 4" S40 Septic Tank: 1000gal

Effluent Filter: yes Dosing or Lift Tank: none Drainfield Size: 450 lineal ft

Drainfield Construction: perforated pipe and drain rock Hydraulic Function: gravity

Comments: System has been determined to be compliant. Any future extension, repair, replacement or increase in wastewater flows must be reviewed and permitted by Lincoln County Department of Environmental Health.

System Review Documentation Statement:

I, JACOB T. MERTES *, have inspected/reviewed the components of this system as listed above and found it to be in compliance with the sizing, construction, orientation and operating requirements of Chapter 17, Subchapter 9 A.R.M., Circular DEQ-4 and Lincoln County Wastewater Regulation #3.*

Signed: _____ *Date:* 8/28/15

Title: LOCAL SANITARIAN, ENVIRONMENTAL TECHNICIAN

NOTICE: This document is not a permit for installation, repair or alterations of a wastewater treatment system. It is merely a statement of affirmation that the Department has conducted a review of an otherwise illegal system and found it to be in compliance with all applicable requirements for that system. This affidavit effectively removes the illegal installation status on this system.


DISCLAIMER

This affidavit of review is not a guarantee by the Department that the system will continue to function properly for any prescribed period of time.

1 = 20
SCALE

VIRGIN FIELD IS VIRTUALLY FLAT/LEVEL
EAST TO WEST - 60' 2-3" DIFF - .04% SLOPE
NORTH TO SOUTH - 90' 4-5" DIFF - .04% SLOPE

LOT LAYOUT

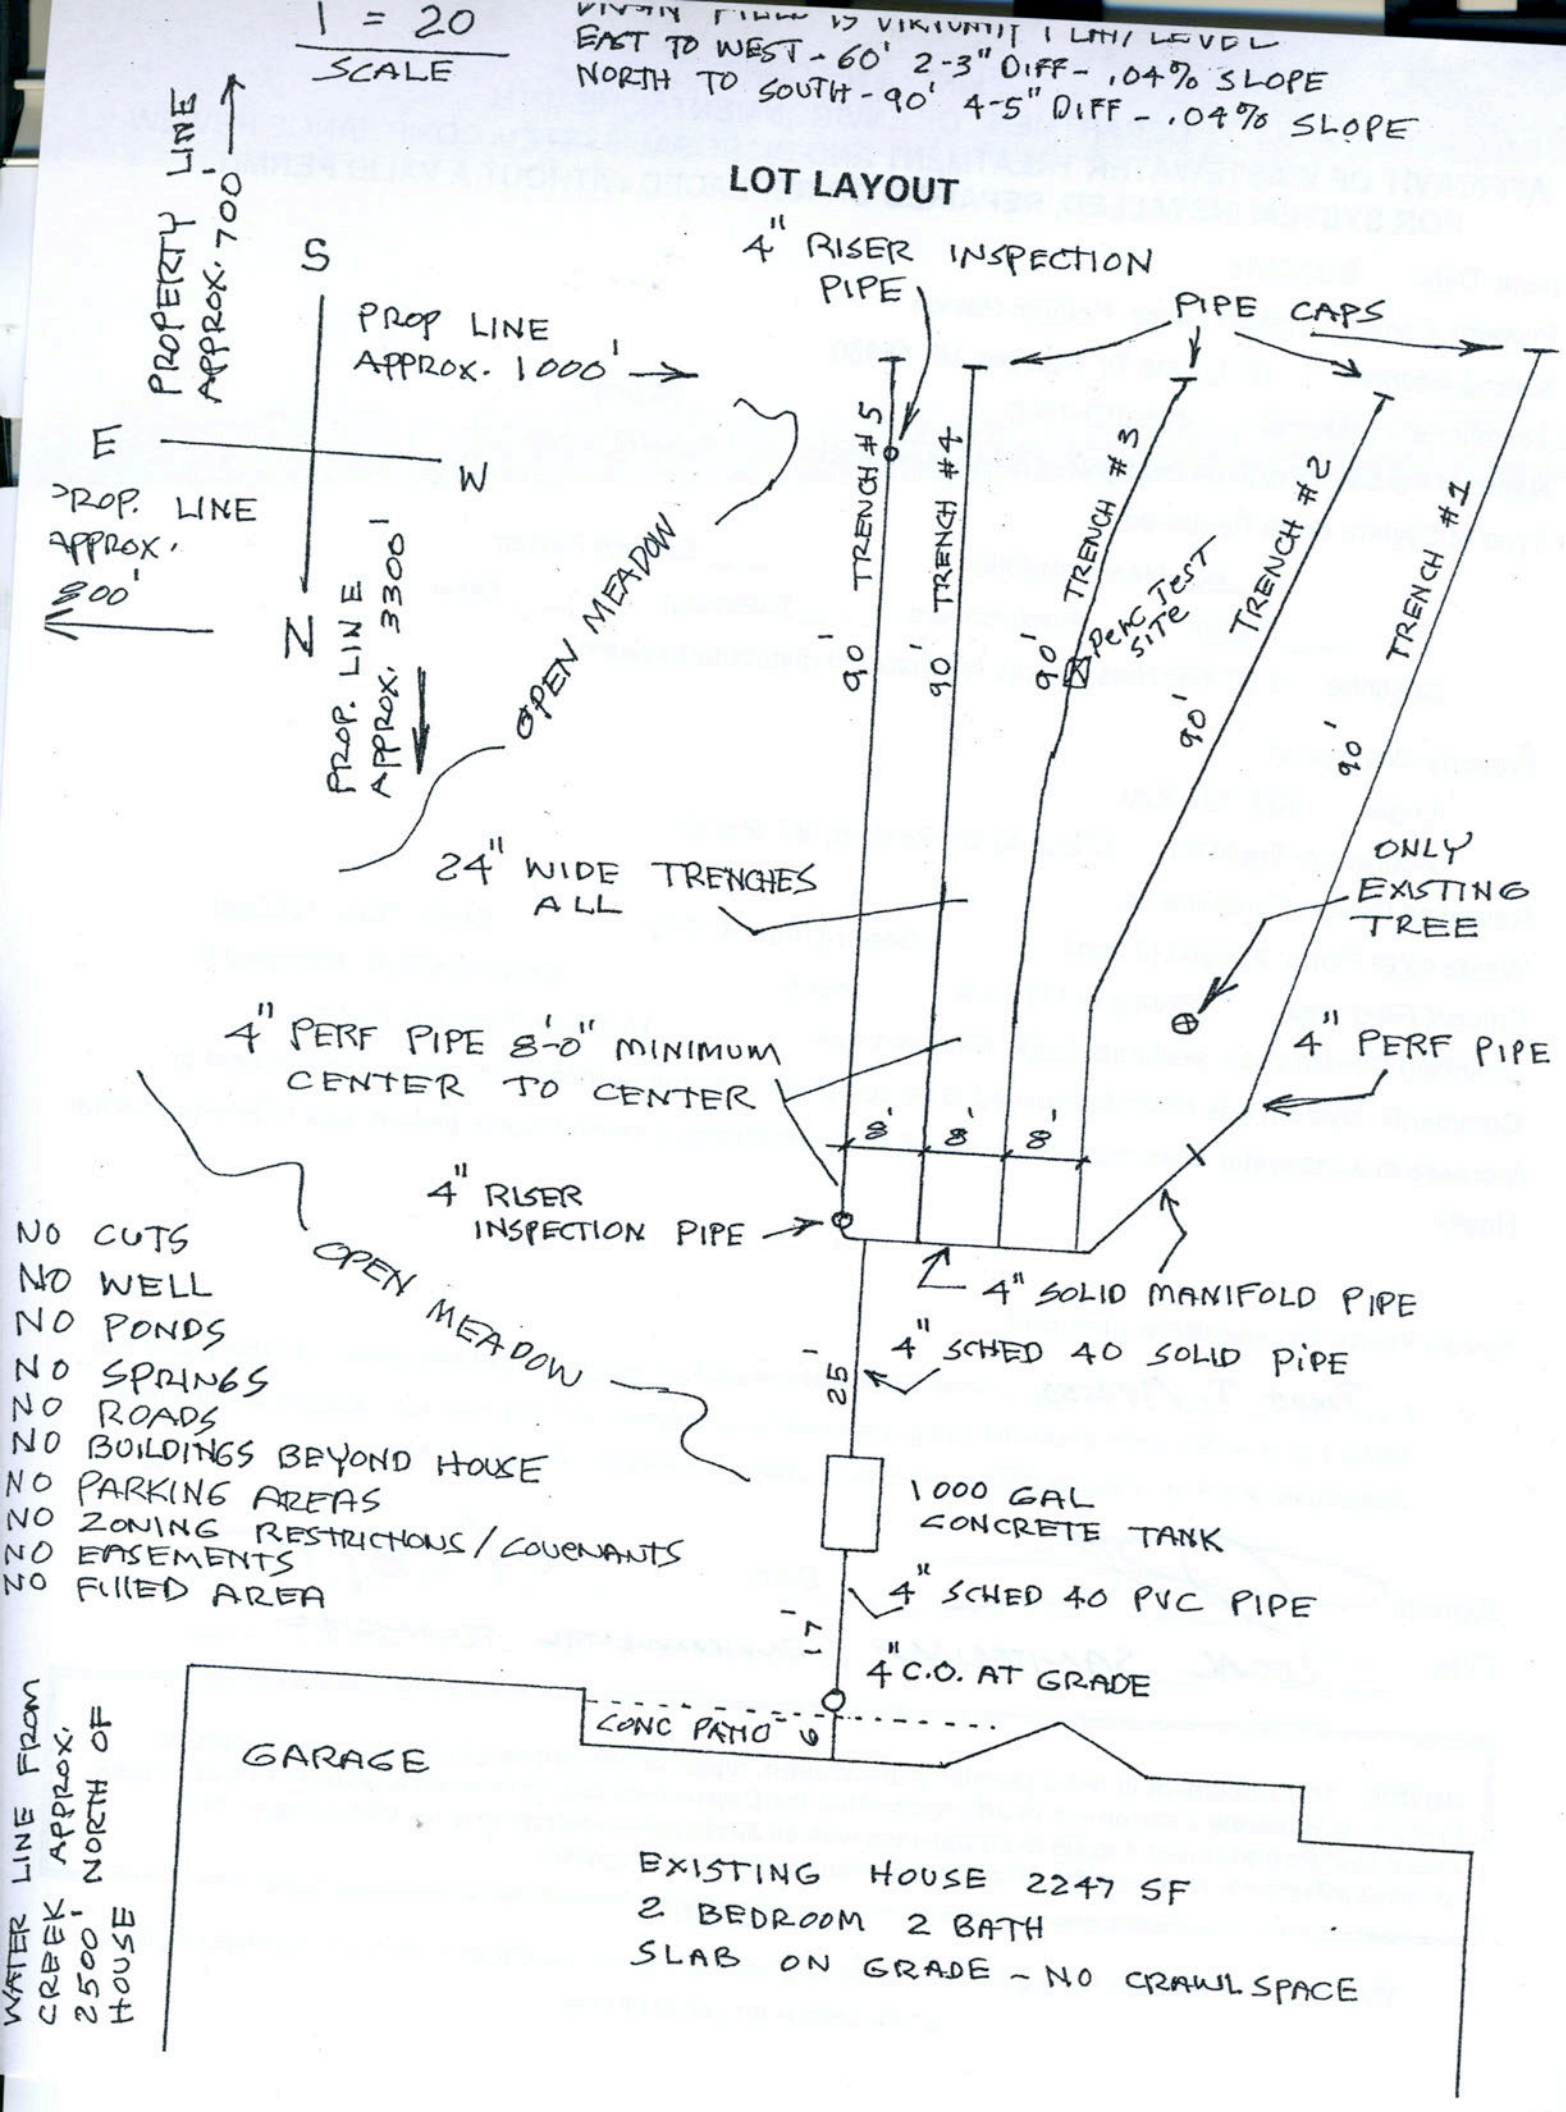

NO CUTS
NO WELL
NO PONDS
NO SPRINGS
NO ROADS
NO BUILDINGS BEYOND HOUSE
NO PARKING AREAS
NO ZONING RESTRICTIONS / COVENANTS
NO EASEMENTS
NO FILLED AREA