LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 10/17/2017 Expiration Date: 10/17/2018

Property Owner: Lincoln House Family Trust c/o: Justin Webster

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: License No.

__xx__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Four 95' laterals using drain rock and perf pipe.

Parcel Description:

Legal: S22 T36 R26

Address or Location: COS 3931 Tract 3

Geo/Assessors code: 0000055603

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000 gallons Drainfield Size: 380 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Jake Mertes, R.S.*

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.


406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

SV

REVISIONS				
ZONE	REV	DESCRIPTION	DATE	APPROVED BY
–	A	ISSUED FOR PERMIT	10/05/17	–

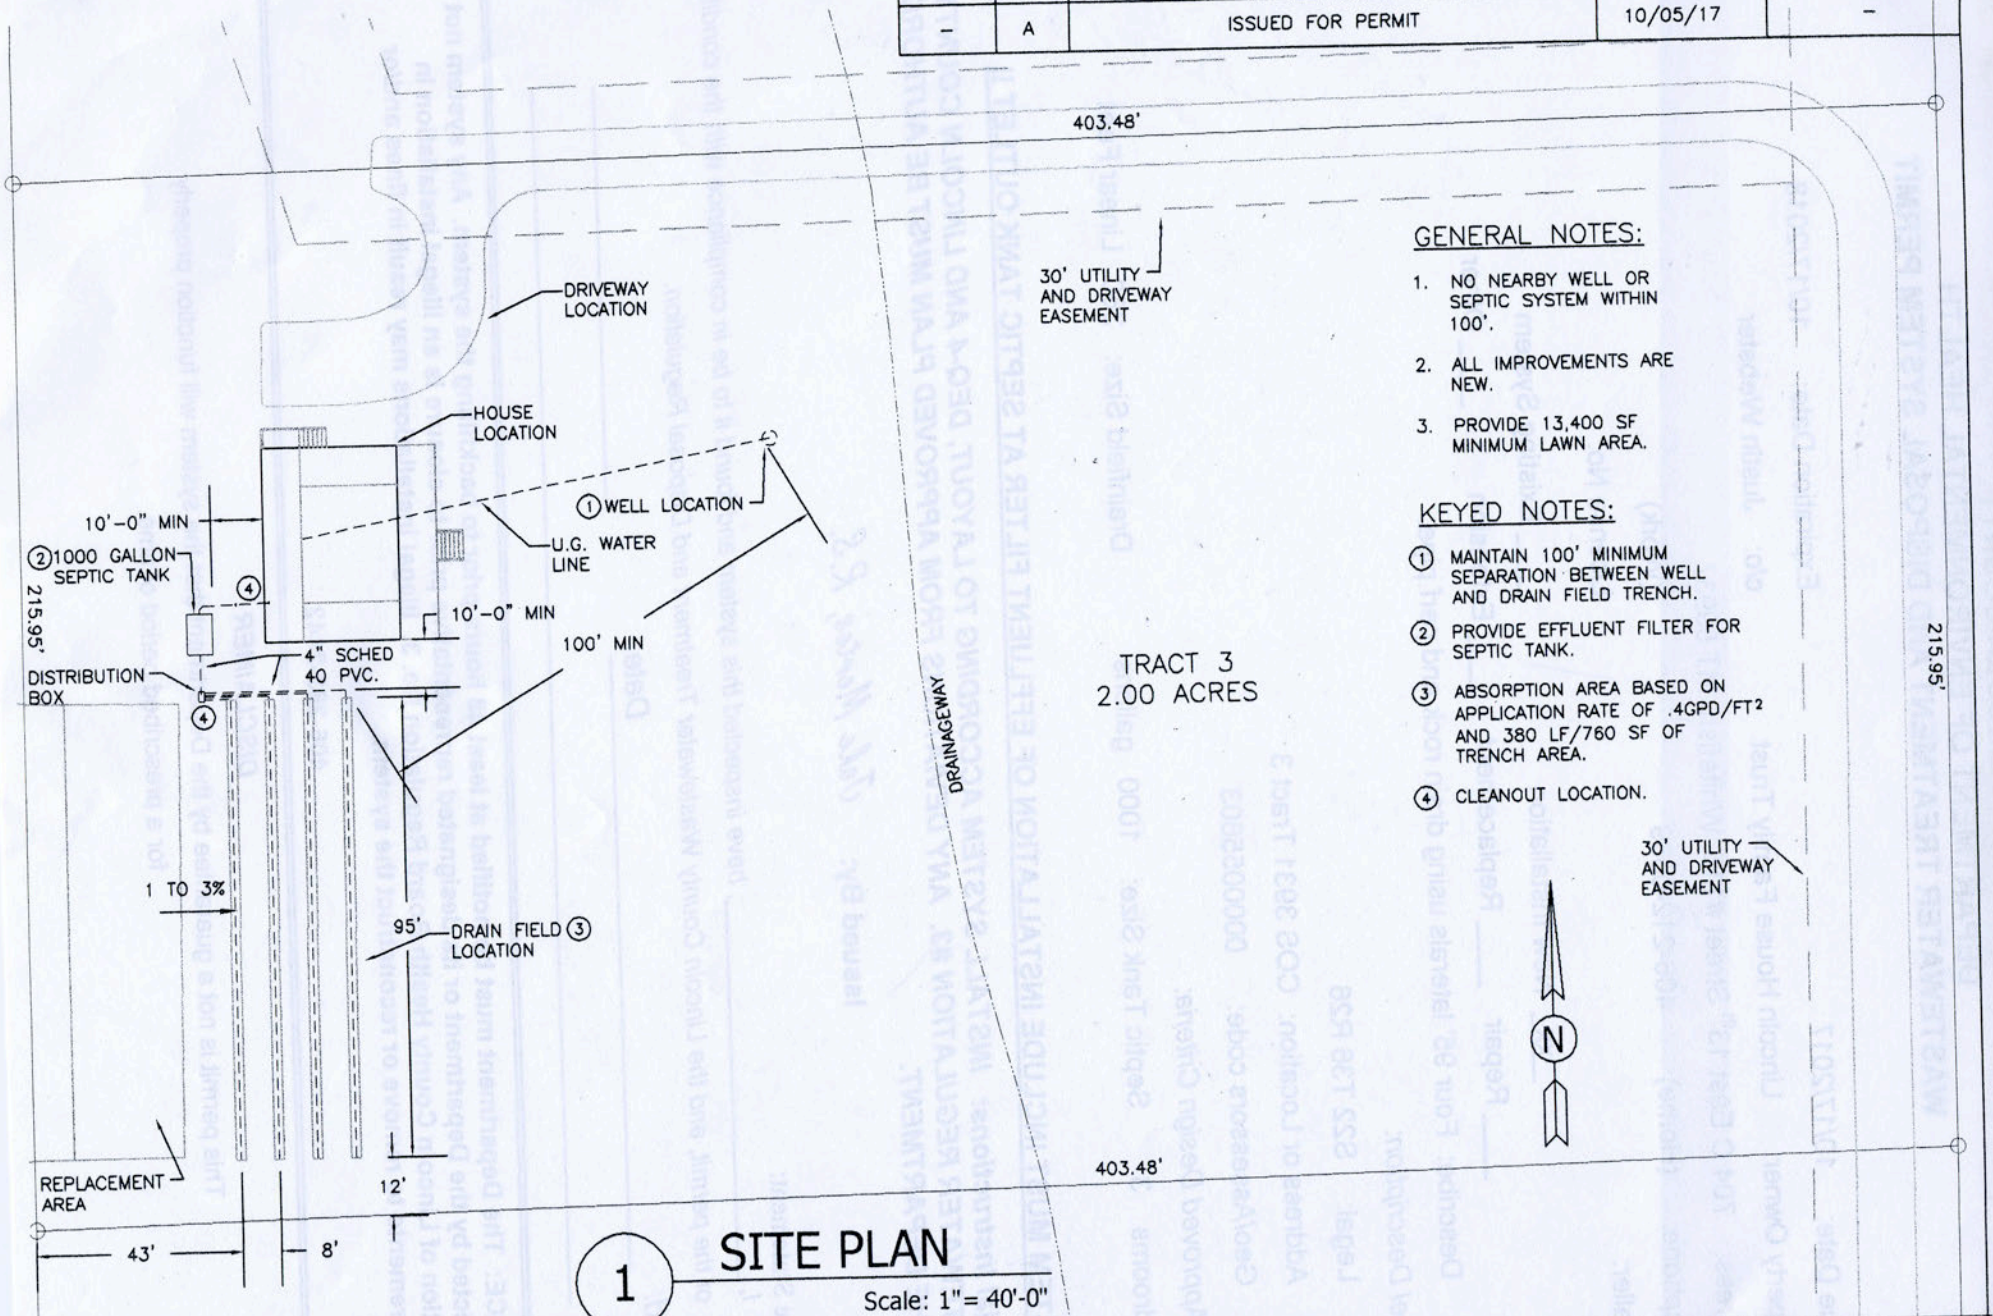

GENERAL NOTES:

1. NO NEARBY WELL OR SEPTIC SYSTEM WITHIN 100'.
2. ALL IMPROVEMENTS ARE NEW.
3. PROVIDE 13,400 SF MINIMUM LAWN AREA.

KEYED NOTES:

(1) MAINTAIN 100' MINIMUM SEPARATION BETWEEN WELL AND DRAIN FIELD TRENCH.

(2) PROVIDE EFFLUENT FILTER FOR SEPTIC TANK.

(3) ABSORPTION AREA BASED ON APPLICATION RATE OF .4GPD/FT^2 AND 380 LF/760 SF OF TRENCH AREA.

(4) CLEANOUT LOCATION.

1 **SITE PLAN**

Scale: 1"= 40'-0"

ENDURANCE DRAFTING & DESIGN
EUREKA, MT

OWNER: LINCOLN HOUSE FAMILY TRUST
NHN MOCKINGBIRD CT.

SIZE A	FSCM NO.	DWG NO. 100517	REV A