LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 7/8/2015 Expiration Date: 7/9/2016

Property Owner: Alex Mauck c/o:

Address: PO Box 367 Cocolalla, ID, 83813

Telephone: (Home) [redacted] (Work)

Installer: License No.

__x__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Drainfield and Septic to consist of 3 65' absorption trenches spaced 10 feet apart.

Parcel Description

Legal: S28 T31 R33

Address or Location: on N Milnor Lake Rd

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1250 gallons Drainfield Size: 195 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes

Closure Statement:

I, JACOB T. MERTES *, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: [signature] *Date:* 7/29/2015

Title: ENVIRONMENTAL TEC. / LOCAL SANITARIAN

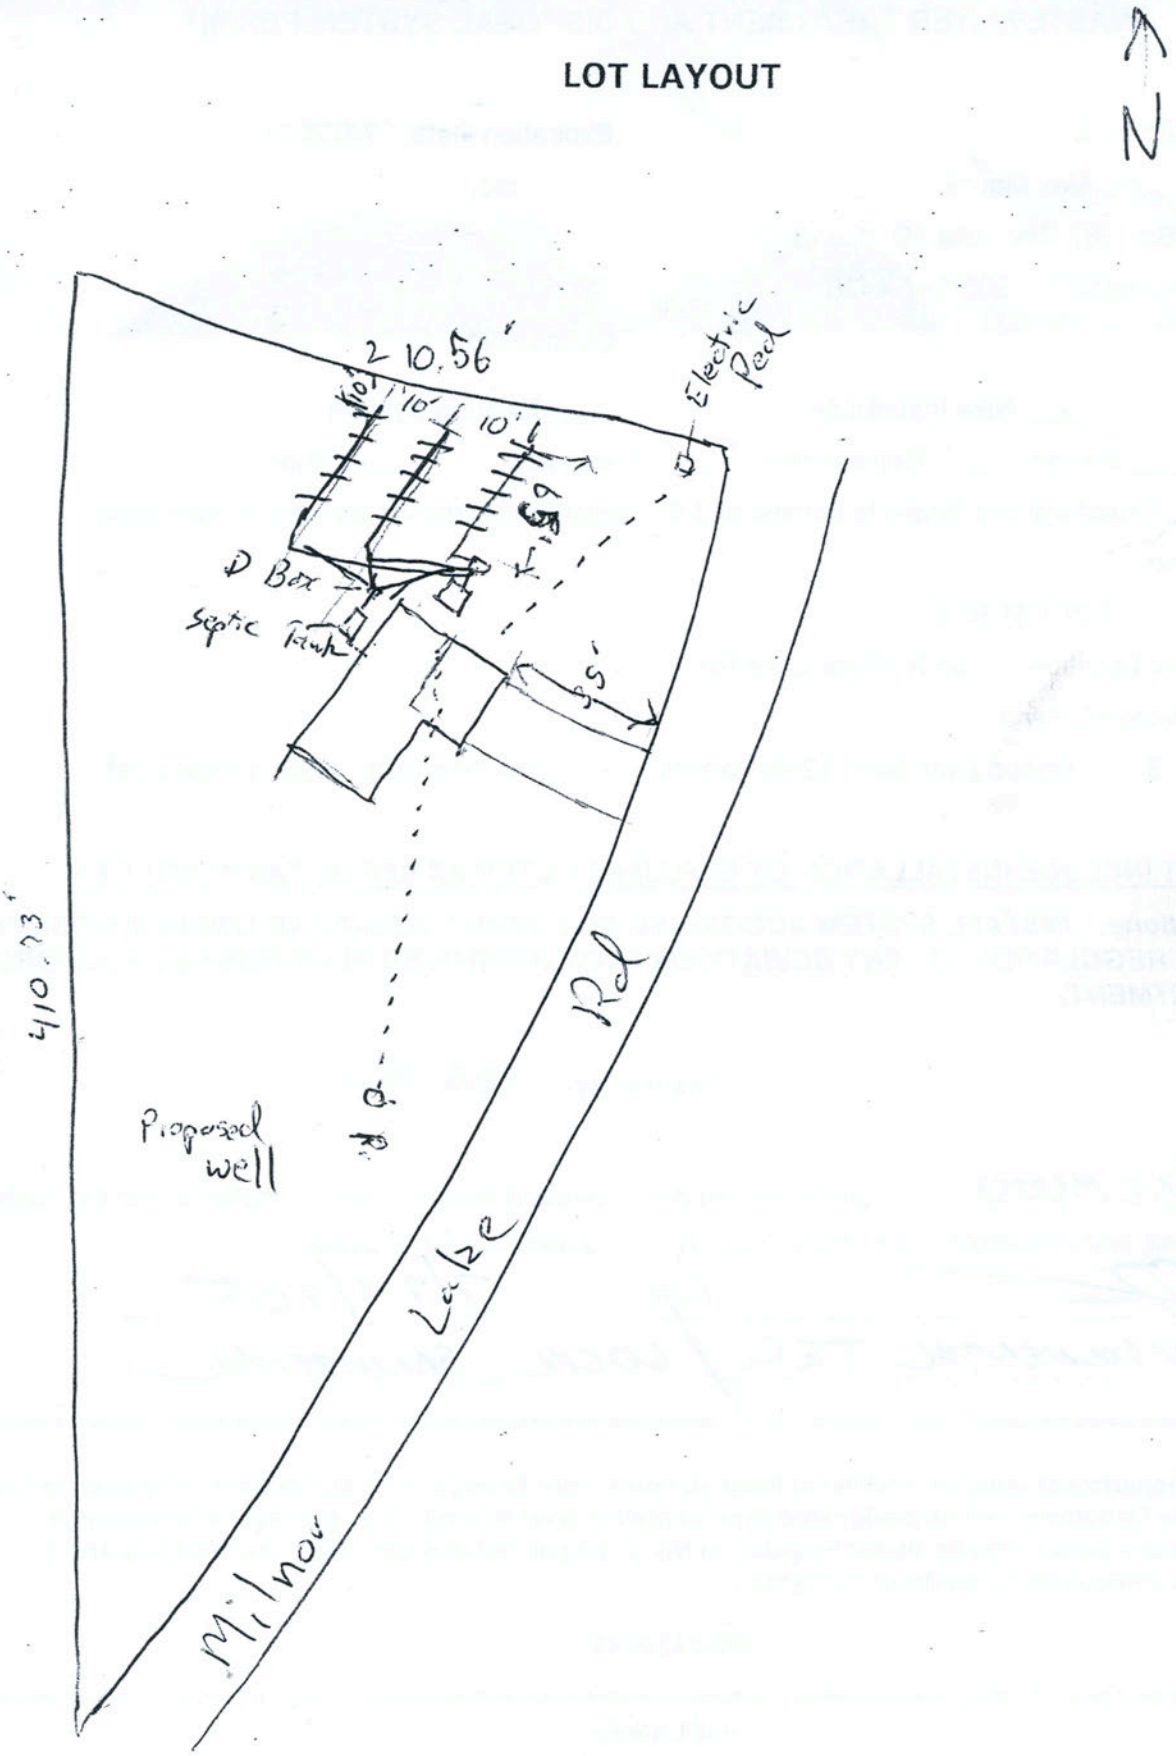
NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

LOT LAYOUT


N
210.56'
10'
10'
10'
Electric Pad
D Box
Septic Tank
5'
410.23'
Proposed well
Milnor Lake Rd