LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 12/8/2017 Expiration Date: 12/8/2018

Property Owner: Don McNeil c/o: Koocanusa Excavating

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: Koocanusa Excavating License No. 135

__xx__ Direct Connection ____ Grinder Pump Connection _____ Lift Tank Connection

Describe: Sewer line connection to sewer main for approved Drainfield

Parcel Description:

Legal: S11 T36 R28

Address or Location: Mariners Haven Phase 1 Lot 14A

Approved Design Criteria:

This lot is approved for 4 bedrooms. This structural size may not be exceeded and wastewater flows are prohibited from exceeding 350 gallons per day. Any proposed increase in wastewater flows must be reviewed by and receive the approval of the HOA Review Board and the Montana DEQ Subdivision Section. Any activity that increases wastewater flows without prior review and approval is in violation of the conditions of approval and subject to enforcement action.

Special Instructions: INSTALL DIRECT SEWERLINE CONNECTION TO THE SEWER MAIN LINE FOR DRAINFIELD ACCORDING TO THE LOT LAYOUT AND DEQ APPROVAL STATEMENT E.Q. 14-1965 . ANY DEVIATIONS FROM APPROVED PLAN MUST HAVE PRIOR AUTHORIZATION FROM THE Mariners Haven *subdivision homeowners/*ENVIRONMENTAL REVIEW BOARD, DEQ AND THE DEPARTMENT.

Issued By: Jake T. Mertes

Closure Statement:

I, BUCK SCHERMERHORN, *have inspected this system and found it to be in compliance with the conditions of the permit, and the DEQ Approval Statement requirements.*

Signed: Buck Schermerhorn *Date:* 12/9/17


Title: PRESIDENT #135

NOTICE: The Department must be notified at least 48 hours prior to installation of the connection. Any connection installation not inspected by the Department or its designated representative is considered an illegal connection and may be subject to fines and/or requirements to remove or reconstruct the connection.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that this connection will function properly for a prescribed period of time.

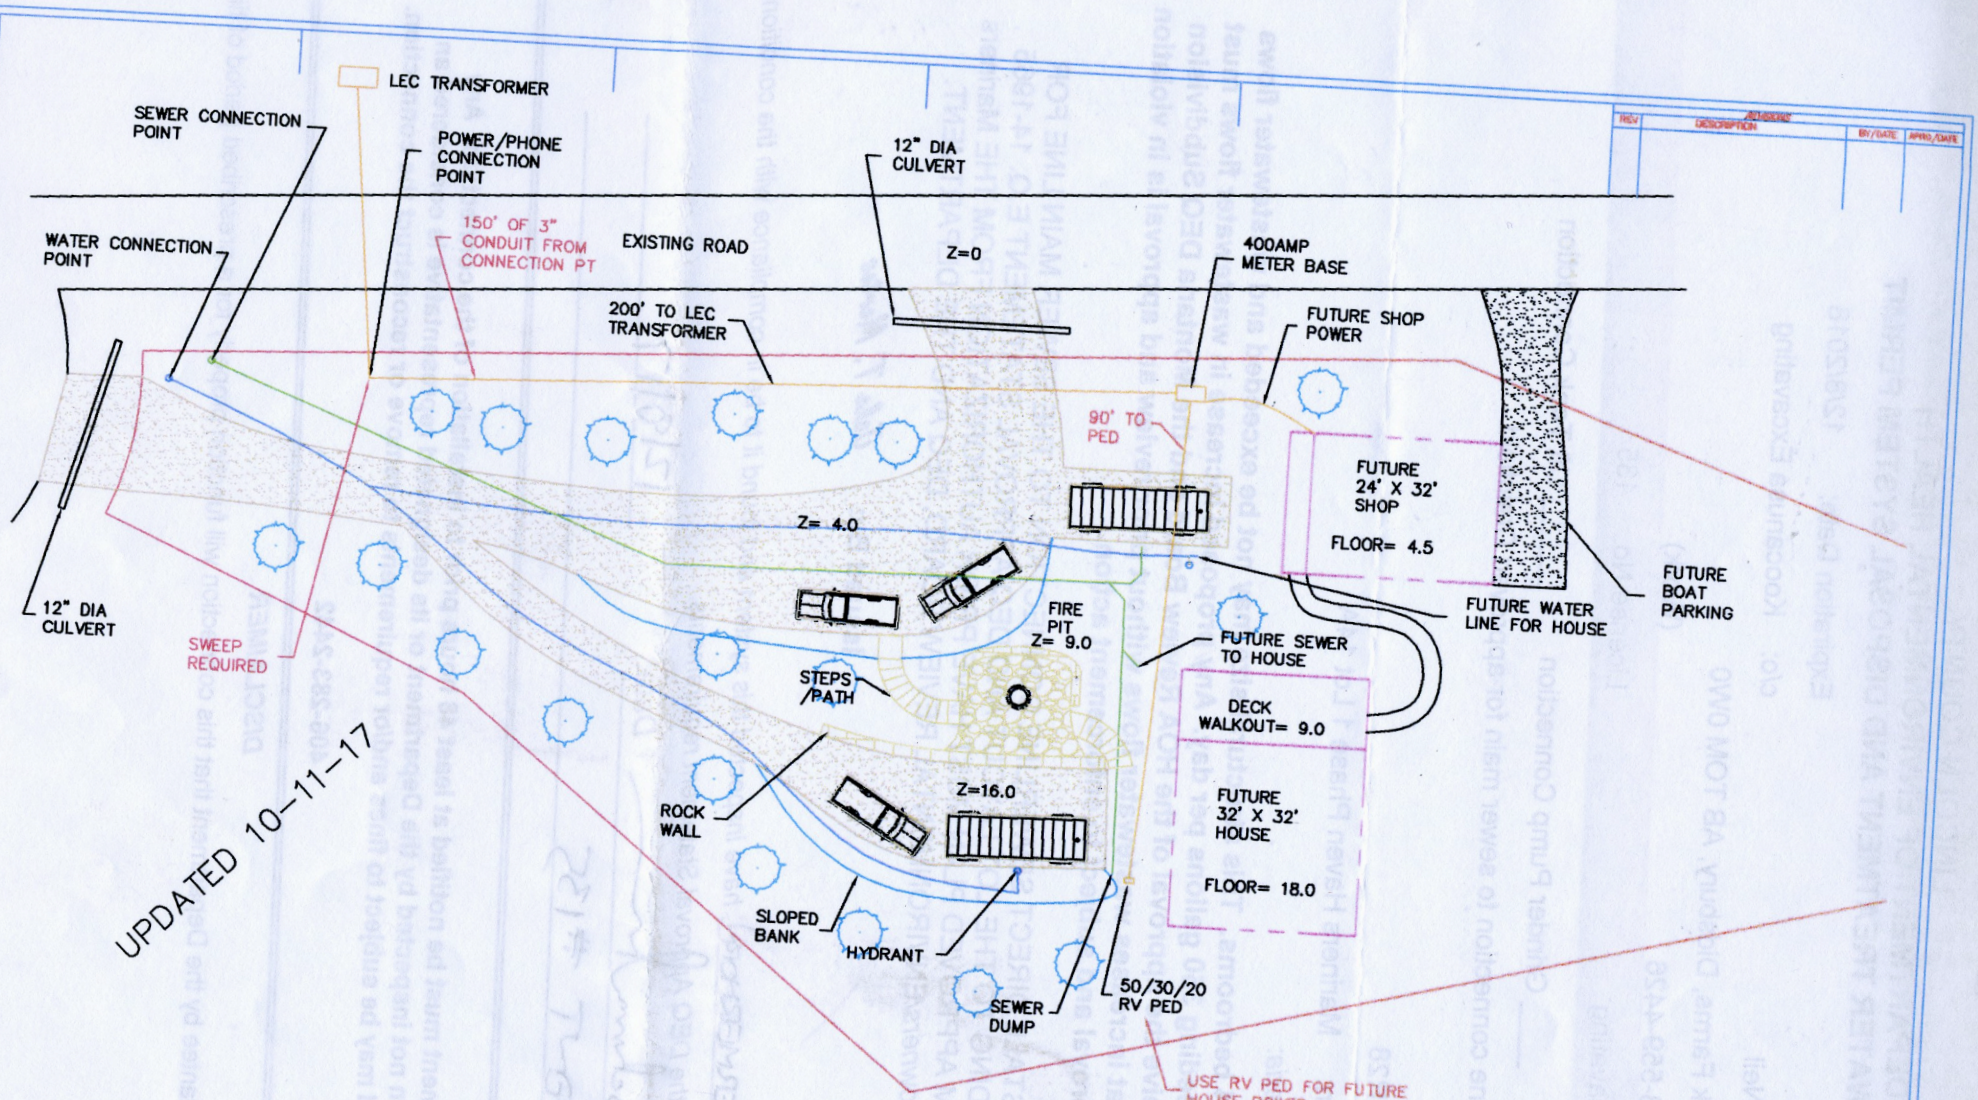

MCNEIL LOT 14A LAYOUT

REV	DESCRIPTION	BY/DATE	APPRD/DATE

REV	DATE	COMPANY	SCALE
		KEI	1/16 & NONE
		CONTRACT	DATE
		VERSION	10/5/17
		PLOT FILE	DESIGN
		P&L-0001	

KOOCANUSA EXCAVATING
MCNEIL PROJECT
CONCEPT LOT LAYOUT
10/5/17
D. MCNEIL 10/XX/17
08217-001 1