LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 7/22/2016

Expiration Date: 7/22/2017

Property Owner: Lisa Merek

c/o: Barb Renkema

Address: PO BOX 1693

Telephone: (Home) [redacted]

(Work)

Installer: Barb Renkema

License No. 78

__xx__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Two 65' laterals using gravelless chambers. Size reduced per .5 app rate.

Parcel Description:

Legal: S27 T36 R26

Address or Location: CS 1935 TR 7E1 111 Glen Lake Rd.

Geo/Assessors code: 0000015828

Approved Design Criteria:

Flow rate: 150 gal/day Septic Tank Size: 1000 gallons Drainfield Size: 130 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

Title: _____


NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

111 Glen Lk. Rd.
S27 T36N R26W

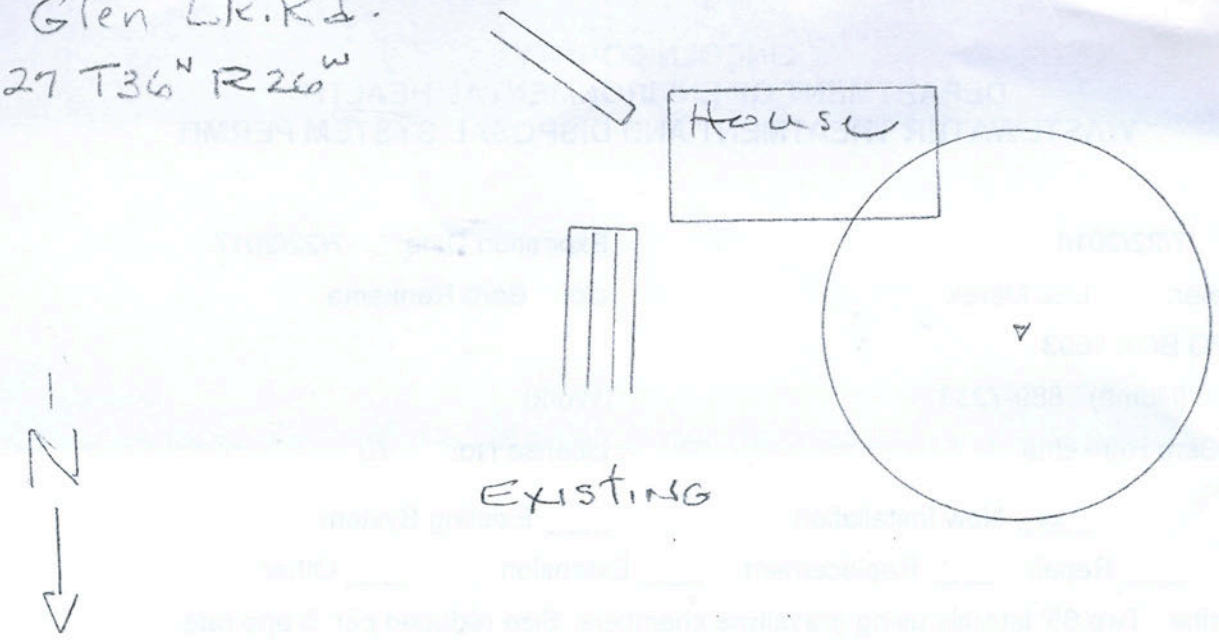

1" = 100'

