# LINCOLN COUNTY
# DEPARTMENT OF ENVIRONMENTAL HEALTH
# WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 05/05/2015 Expiration Date: 05/06/2016

Property Owner: Jean Miles c/o: Riley Excavation

Address: [redacted]

Telephone: (Home) (Work)

Installer: Riley Excavation License No. 147

____ New Installation _____ Existing System

_____ Repair __X__ Replacement _____ Extension _____ Other

Describe: Replacing failed shared system for one 3-bedroom and one 2-bedroom dwelling. Using gravelless chambers -- sizing reduction allowed per "Drainfield Size" below.

*Parcel Description*:

Legal: S5 T30 R30

Address or Location: Parcel A of COS 1636

*Approved Design Criteria*:

# Bedrooms: 5 Existing Septic Tank Sizes: 1000 gallons each Drainfield Size: 360 Linear Feet

**SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!**

***Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.***

**Issued By:** *Kendra J. Lind, R.S.*

*Closure Statement:*

*I,* Charles V Riley *, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

*Signed:* Charles J Riley *Date:* 5-6-15

*Title:* Owner

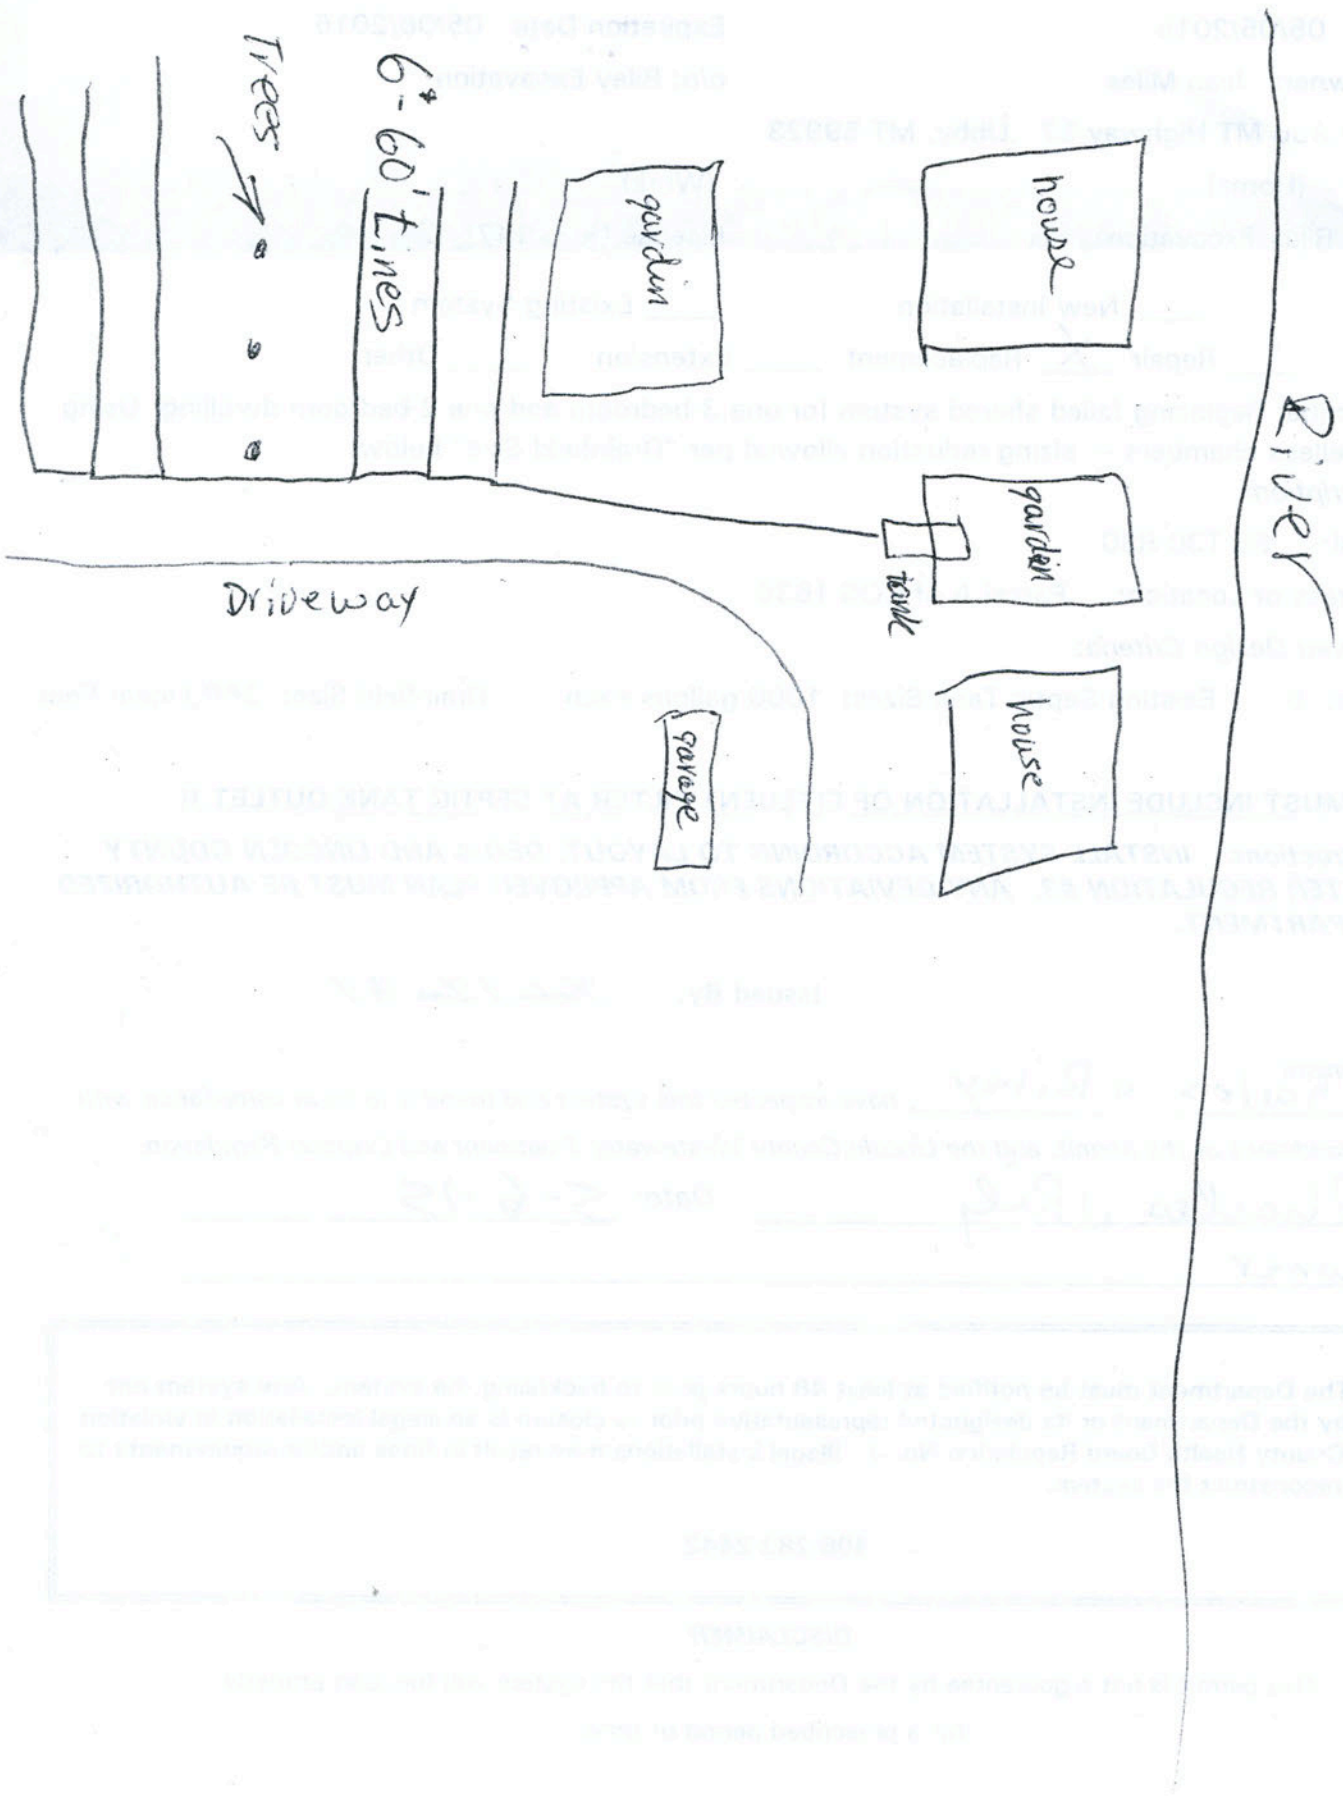
**NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.**

**406-283-2442**

***DISCLAIMER***

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

# LOT LAYOUT


Trees
6"- 60' Lines
garden
house
River
garden
tank
Driveway
garage
house