LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 8/5/2016 Expiration Date: 8/5/2017

Property Owner: Fred Miller c/o: Bruce Todd

Address: PO BOX 175 Trego, MT 59934

Telephone: (Home) [redacted] (Work)

Installer: Bruce Todd License No. 54

__xx__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Three 84' trenches using gravelless chambers. Size reduced per 0.4gpd app rate

Parcel Description:

Legal: S16 T34 R25

Address or Location: Fallen Antler Estates, LOT 3

Geo/Assessors code: 0000052639

Approved Design Criteria:

Bedrooms 2 Septic Tank Size: 1000 gallons Drainfield Size: 252 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Jake Mertes, R.S.*

Closure Statement:

I, BRUCE TODD, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Bruce C. Todd *Date:* 8-24-2016

Title: INSTALLER # 54

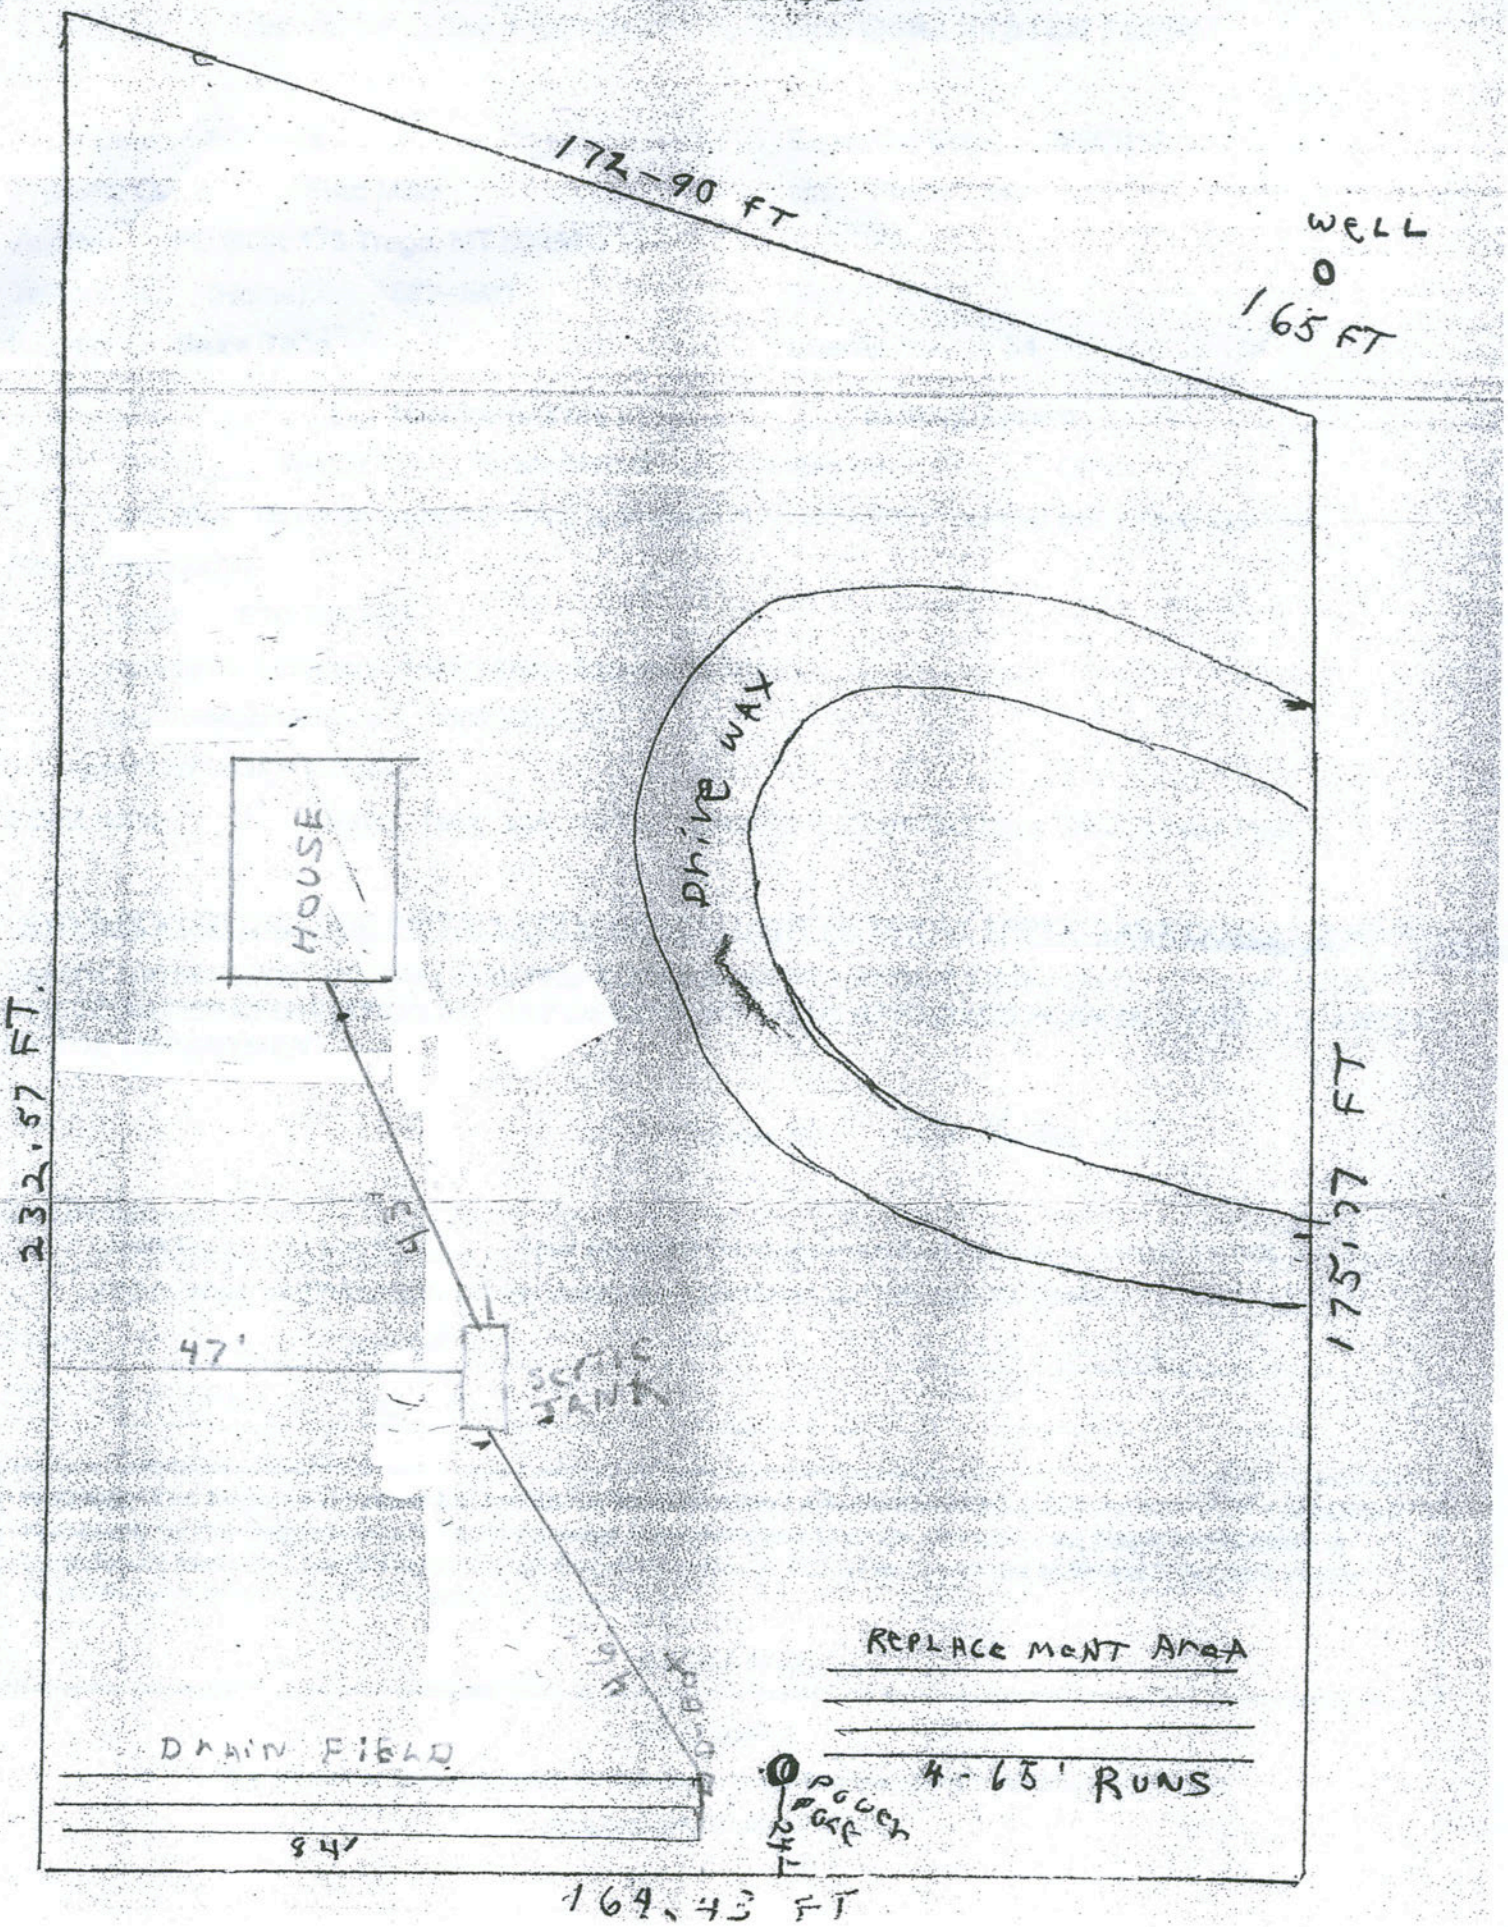
NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

LOT LAYOUT


172-90 FT
WELL
165 FT
HOUSE
DRIVE WAY
232.57 FT.
175.27 FT
47'
SEPTIC TANK
REPLACEMENT AREA
4-65' RUNS
DRAIN FIELD
84'
164.43 FT