LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 08/27/2025 Expiration Date: 08/26/2026 Permit#25-7512

Property Owner: Janet Monk

Mailing Address: [redacted]

Installer: Marty Goucher License #: 196

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new pressure dosed system for 3 Bedroom House.

Legal: S30, T29 N, R26 W, ACRES 188.53, GOVT LOTS 1 & 5, 7512

Property Address: 2130 Old Railroad Grade Rd., Libby, MT 59923 Assessment Code: 7512

DEQ COSA: E.Q.# Date:

Approved Design Criteria: Installation of new pressure dosed system for 3 Bedroom House with 3 Laterals @ 45' with reduction for chambers.

# of Bedrooms: 3 Septic Tank Size: 1000/500 Trench Width: 36"

# of Laterals: 3 Length of Laterals: 45' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, Circular DEQ-4, and COSA(If Applies). Reduction given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Robin Blumberg, RS*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

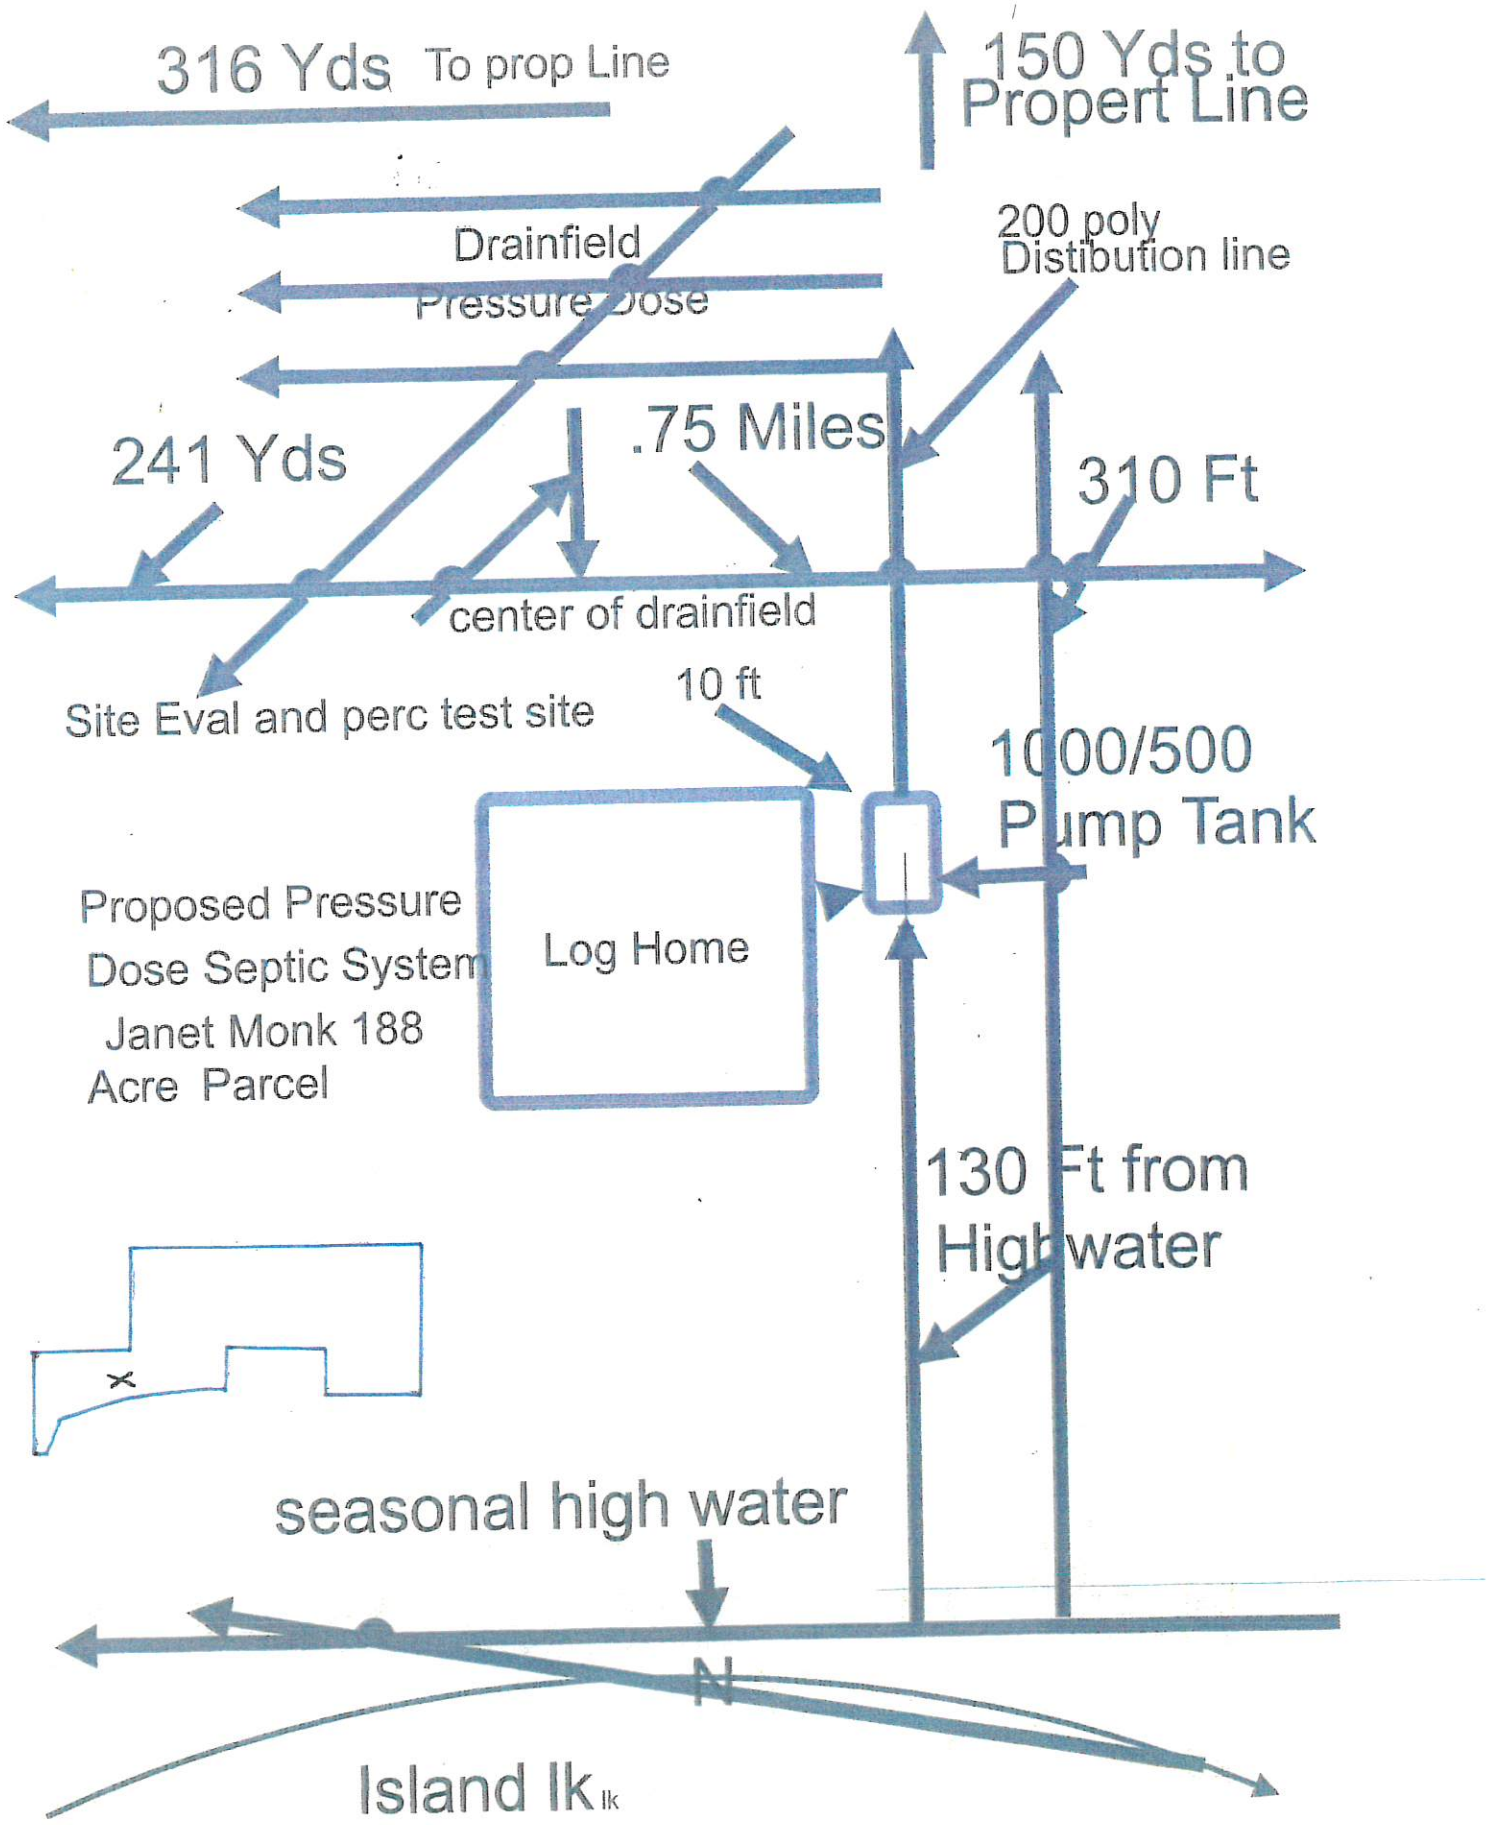
Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Robin Blumberg *Date:* 10/22/25

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.


316 Yds To prop Line
150 Yds to Propert Line
Drainfield
Pressure Dose
200 poly Distibution line
241 Yds
.75 Miles
310 Ft
center of drainfield
Site Eval and perc test site
10 ft
1000/500 Pump Tank
Proposed Pressure Dose Septic System
Janet Monk 188 Acre Parcel
Log Home
130 Ft from High water
X
seasonal high water
N
Island lk lk