LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 2/24/2016 Expiration Date: 2/25/2018(Reissued JM)

Property Owner: Robert Murphy c/o: Koocanusa Excavating

Address: [redacted]

Telephone: (Home) [redacted] (Work) [redacted]

Installer: Koocanusa Excavating, Inc. License No. 135

____ New Installation ____ Existing System

____ Repair __xx__ Replacement ____ Extension ____ Other

Describe: Grinder pump at house feeding 1000 gallon gravity tank, infiltration galleries in DF

Parcel Description:

Legal: S27 T36 R26

Address or Location: 89 Fleming RD

Geo/Assessors code: 0000007290

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000 gallons Drainfield Size: 225 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, BUCK SCHERMERHORN *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: [signature] *Date:* 8/28/17

Title: PRESIDENT - #135

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442


DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

SV

INSTALL NEW GRINDER PUMP AT HOUSE WITH GRAVITY SEPTIC TANK AT NEW DRAINFIELD LOCATION

CLOSEST WELL IS OVER 300' AWAY FROM DRAINFIELD

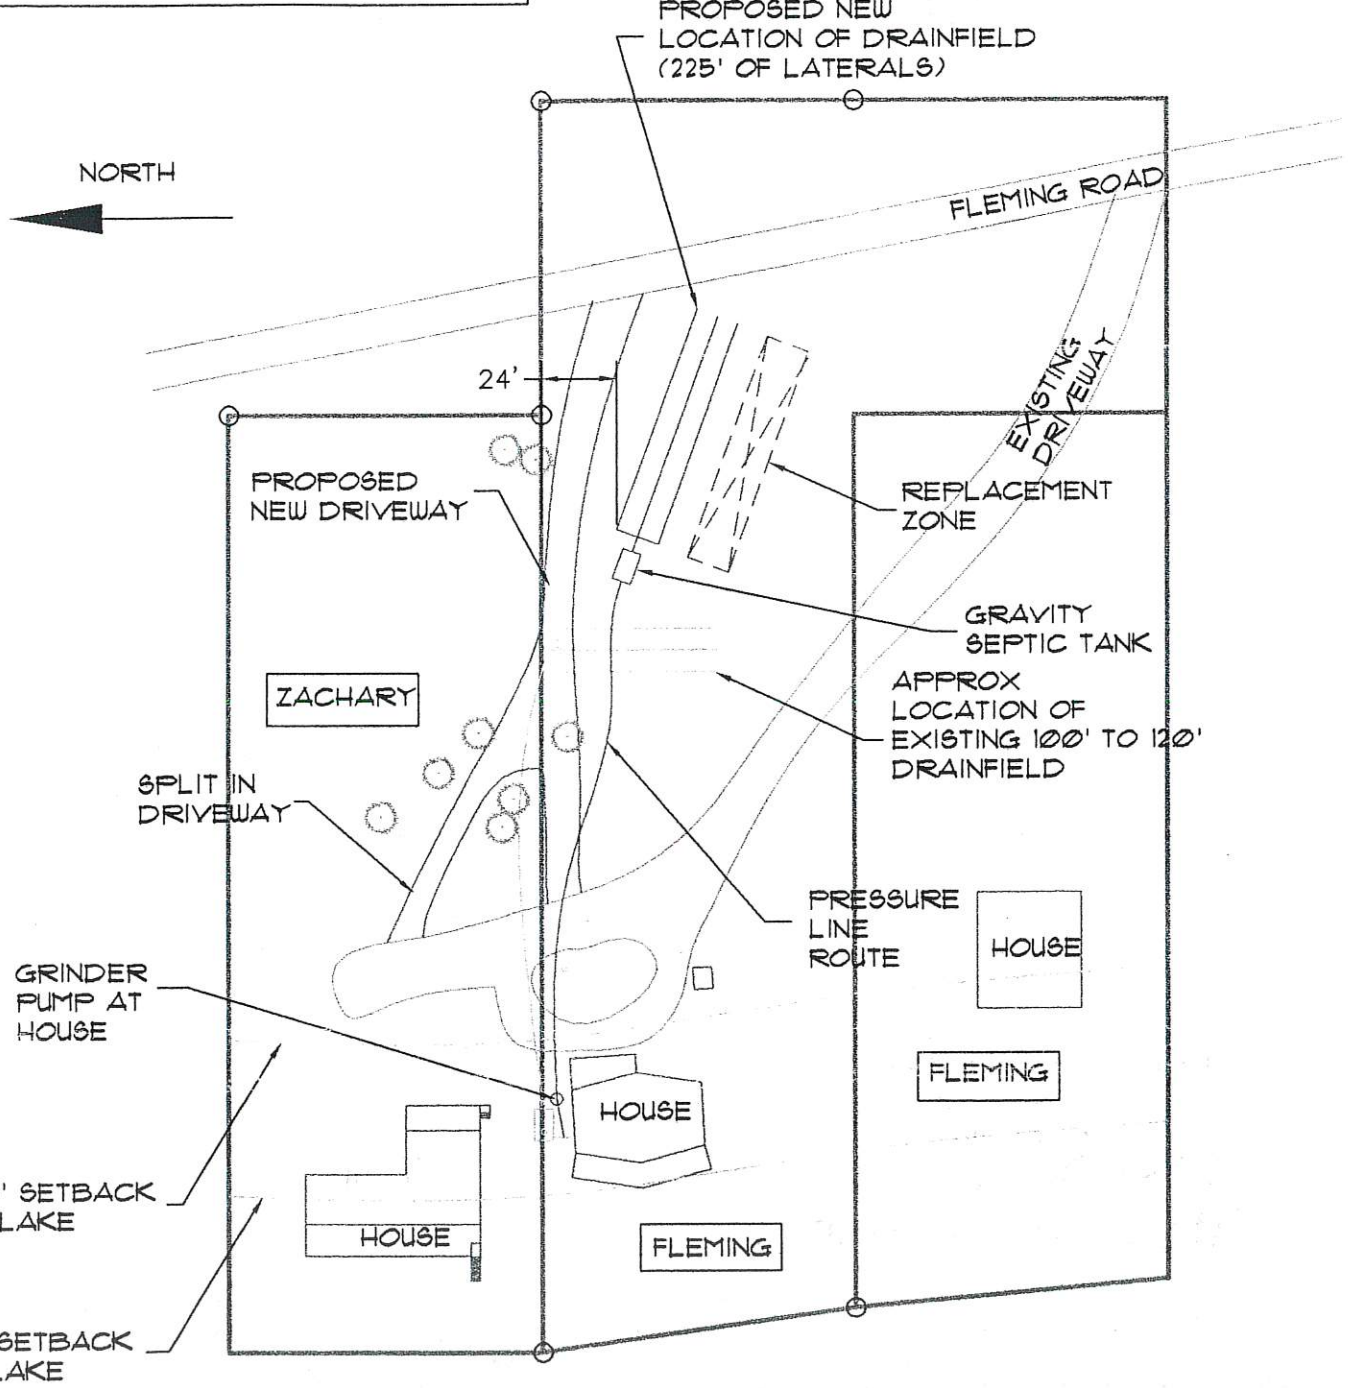

OVERALL LOT LAYOUT

GLEN LAKE

MURPHY LOT