LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 08/11//2025 Expiration Date: 08/10/2026 Permit#25-54569

Property Owner: Sean Newbury

Mailing Address: [redacted]

Installer: Tyler Hartz License #: 212

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new pressure dosed system for 3 Bedroom House.

Legal: TOBACCO BREAKS ESTATE, S09, T36 N, R27 W, LOT 2, ACRES 2, PM 6623

Property Address: 48 River Ct. N., Eureka, MT 59917 Assessment Code: 54569

DEQ COSA: E.Q.# 05-1424 Tobacco Breaks Date: 12/8/2004

Approved Design Criteria: Installation of new pressure dosed system for 3 Bedroom House with 3 Laterals @ 83'. **Existing well is shared and the Tobacco Breaks COSA requires an individual water system. The COSA needs a rewrite or an individual well installed in the previously approved location. Septic passed inspection.**

# of Bedrooms: 3 Septic Tank Size: 1500/500 Trench Width: 36"

# of Laterals: 3 Length of Laterals: 83' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, Circular DEQ-4, and COSA(If Applies). It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Robin Blumberg, RS*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.


Signed: Robin Blumberg *Date:* 10/10/25

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.

Assessment Code 00000 54 569

N

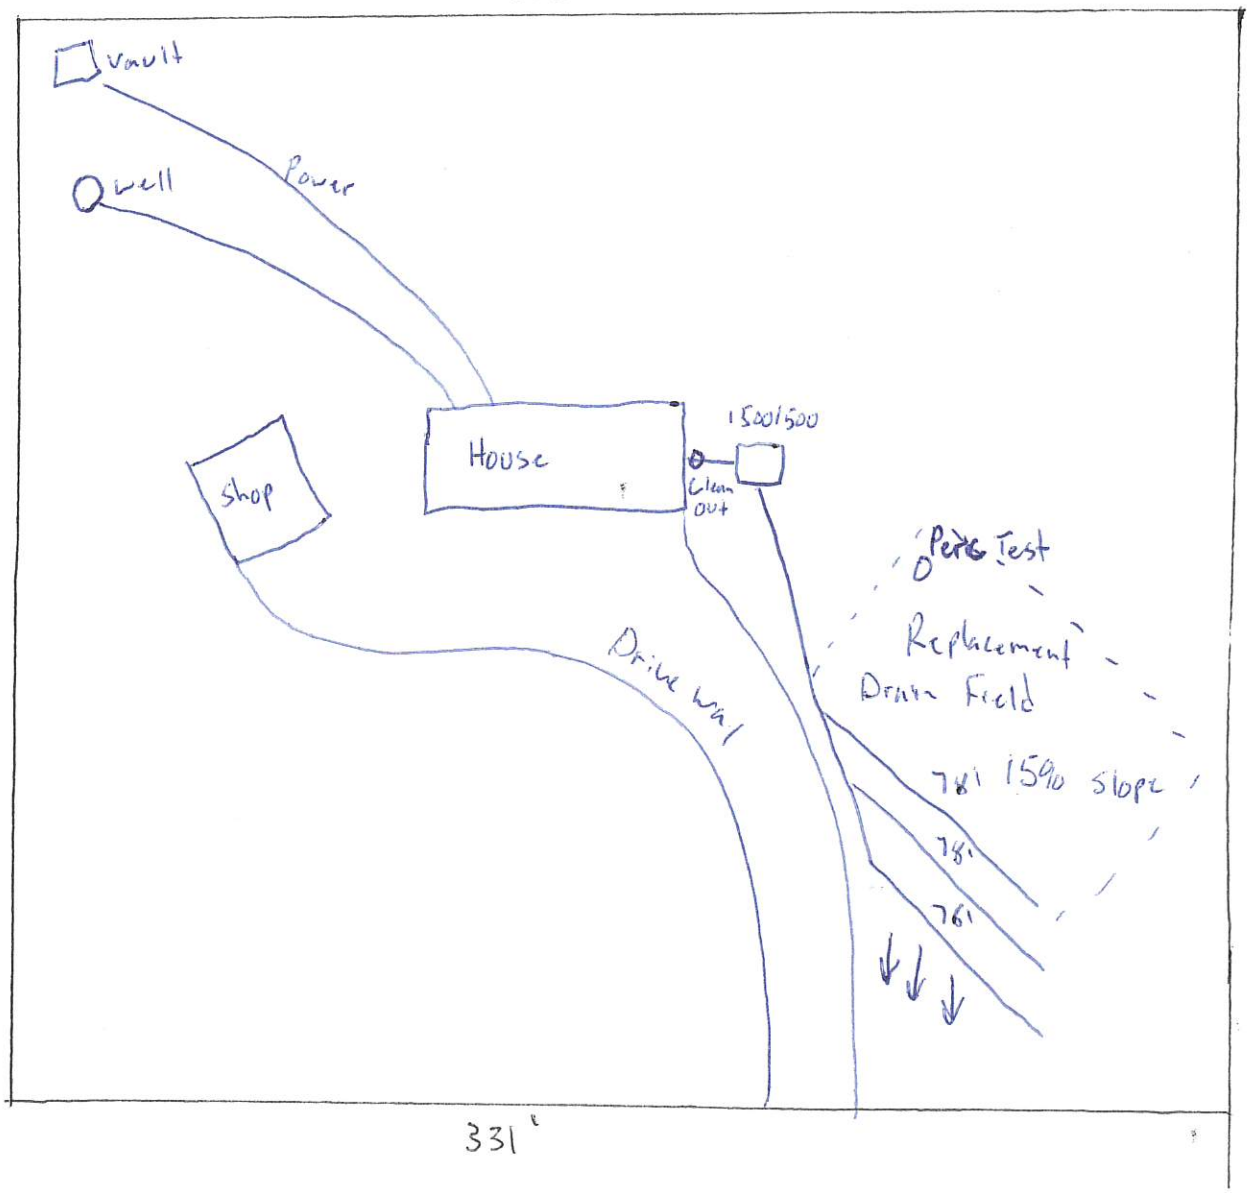

Tobacco Breaks Estates

Lot 2

2.00 Gross Acres

48 River Court North

Eureka, MT 59917

Updated 03/29/2024