LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 9/19/2017 Expiration Date: 9/19/2018

Property Owner: Leonard Oberdorf c/o:

Address: PO BOX 275 Fortine, MT 59918

Telephone: (Home) (Work)

Installer: Rupert Schreiner License No. 19

____ New Installation __xx_ Existing System

____ Repair __xx_ Replacement ____ Extension ____ Other

Describe: Three 85' laterals using gravelless chambers. Size reduced per 0.5 app rate

Parcel Description:

Legal: S9 T34 R26 Tract 3A

Address or Location: 248 Marl Lake Road

Geo/Assessors code: 0000010211

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000 gallons Drainfield Size: 255 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Rupert Schreiner, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: Rupert Schreiner Date: 9-19-19

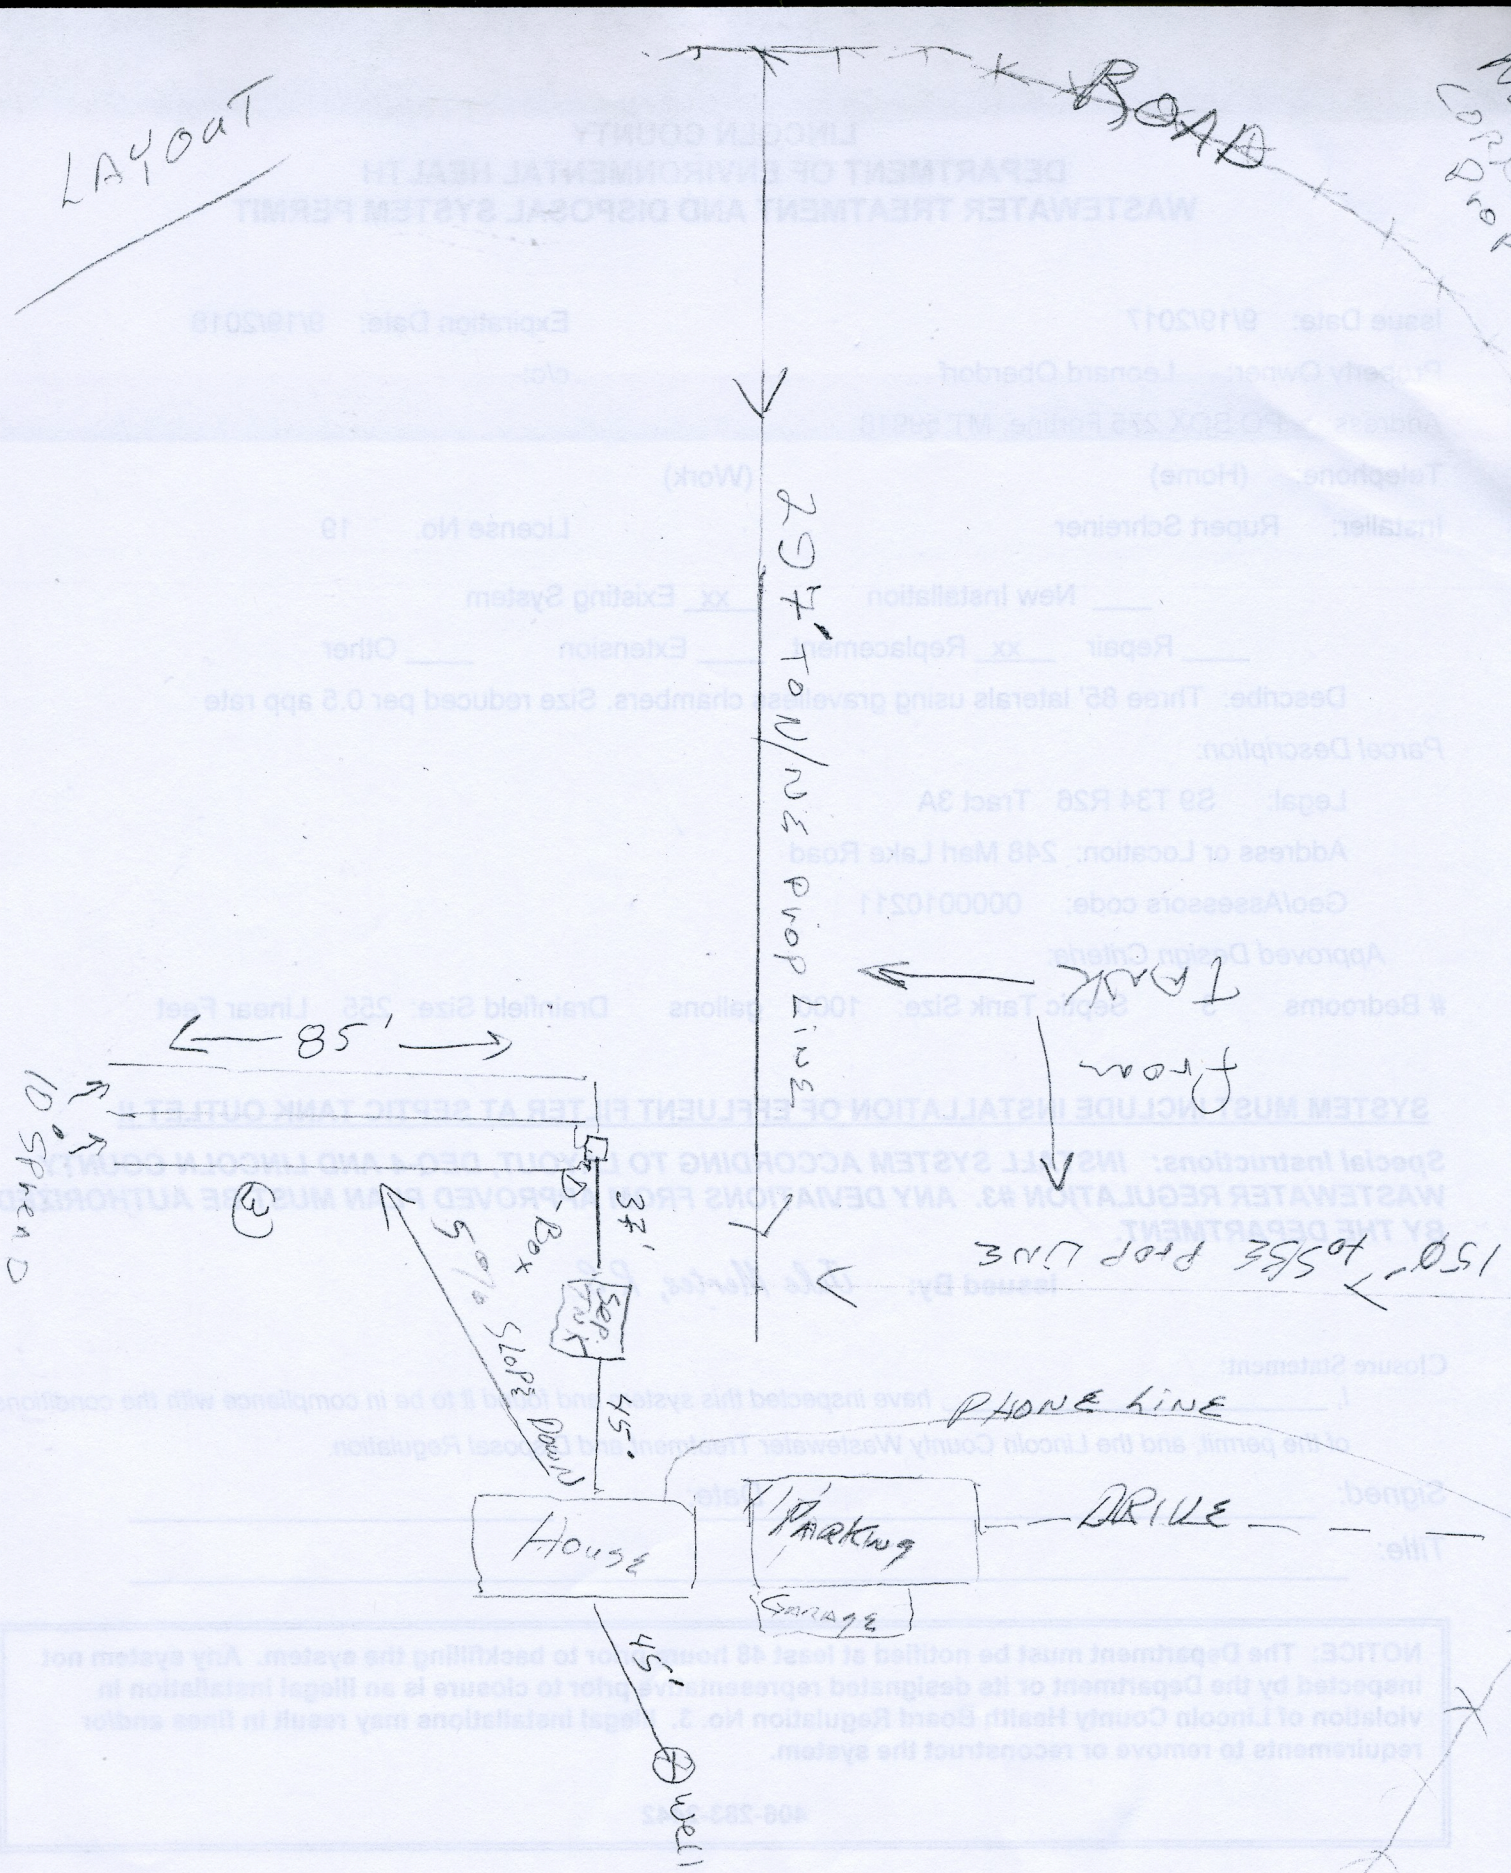
Title: Lic # 19

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


LAYOUT
ROAD
20FT TOP/NE Prop Line
85'
10' Spread
37'
Septic
45'
Solids Sloped Down
House
Parking
Garage
PHONE LINE
DRIVE
Tank
from
150' to Side Prop Line
45'
Well