LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 5/16/2016 Expiration Date: 5/16/2017

Property Owner: Joseph & Lana Popelka c/o:

Address: [redacted] [redacted]

Telephone: (Home) (Work)

Installer: OSCAR ORIOSKE PDW INC. License No. #162

__xx__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Two 97' trenches using drainrock. (Alt: Two 78' trenches using gravelless chambers)

Parcel Description:

Legal: S17 T29 R30

Address or Location: West Zion Lot 1

Geo/Assessors code: 0000013670

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000 gallons Drainfield Size: 195' (156') Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, OSCAR ORIOSKE, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: Oscar Oriosk *Date:* 7-29-16

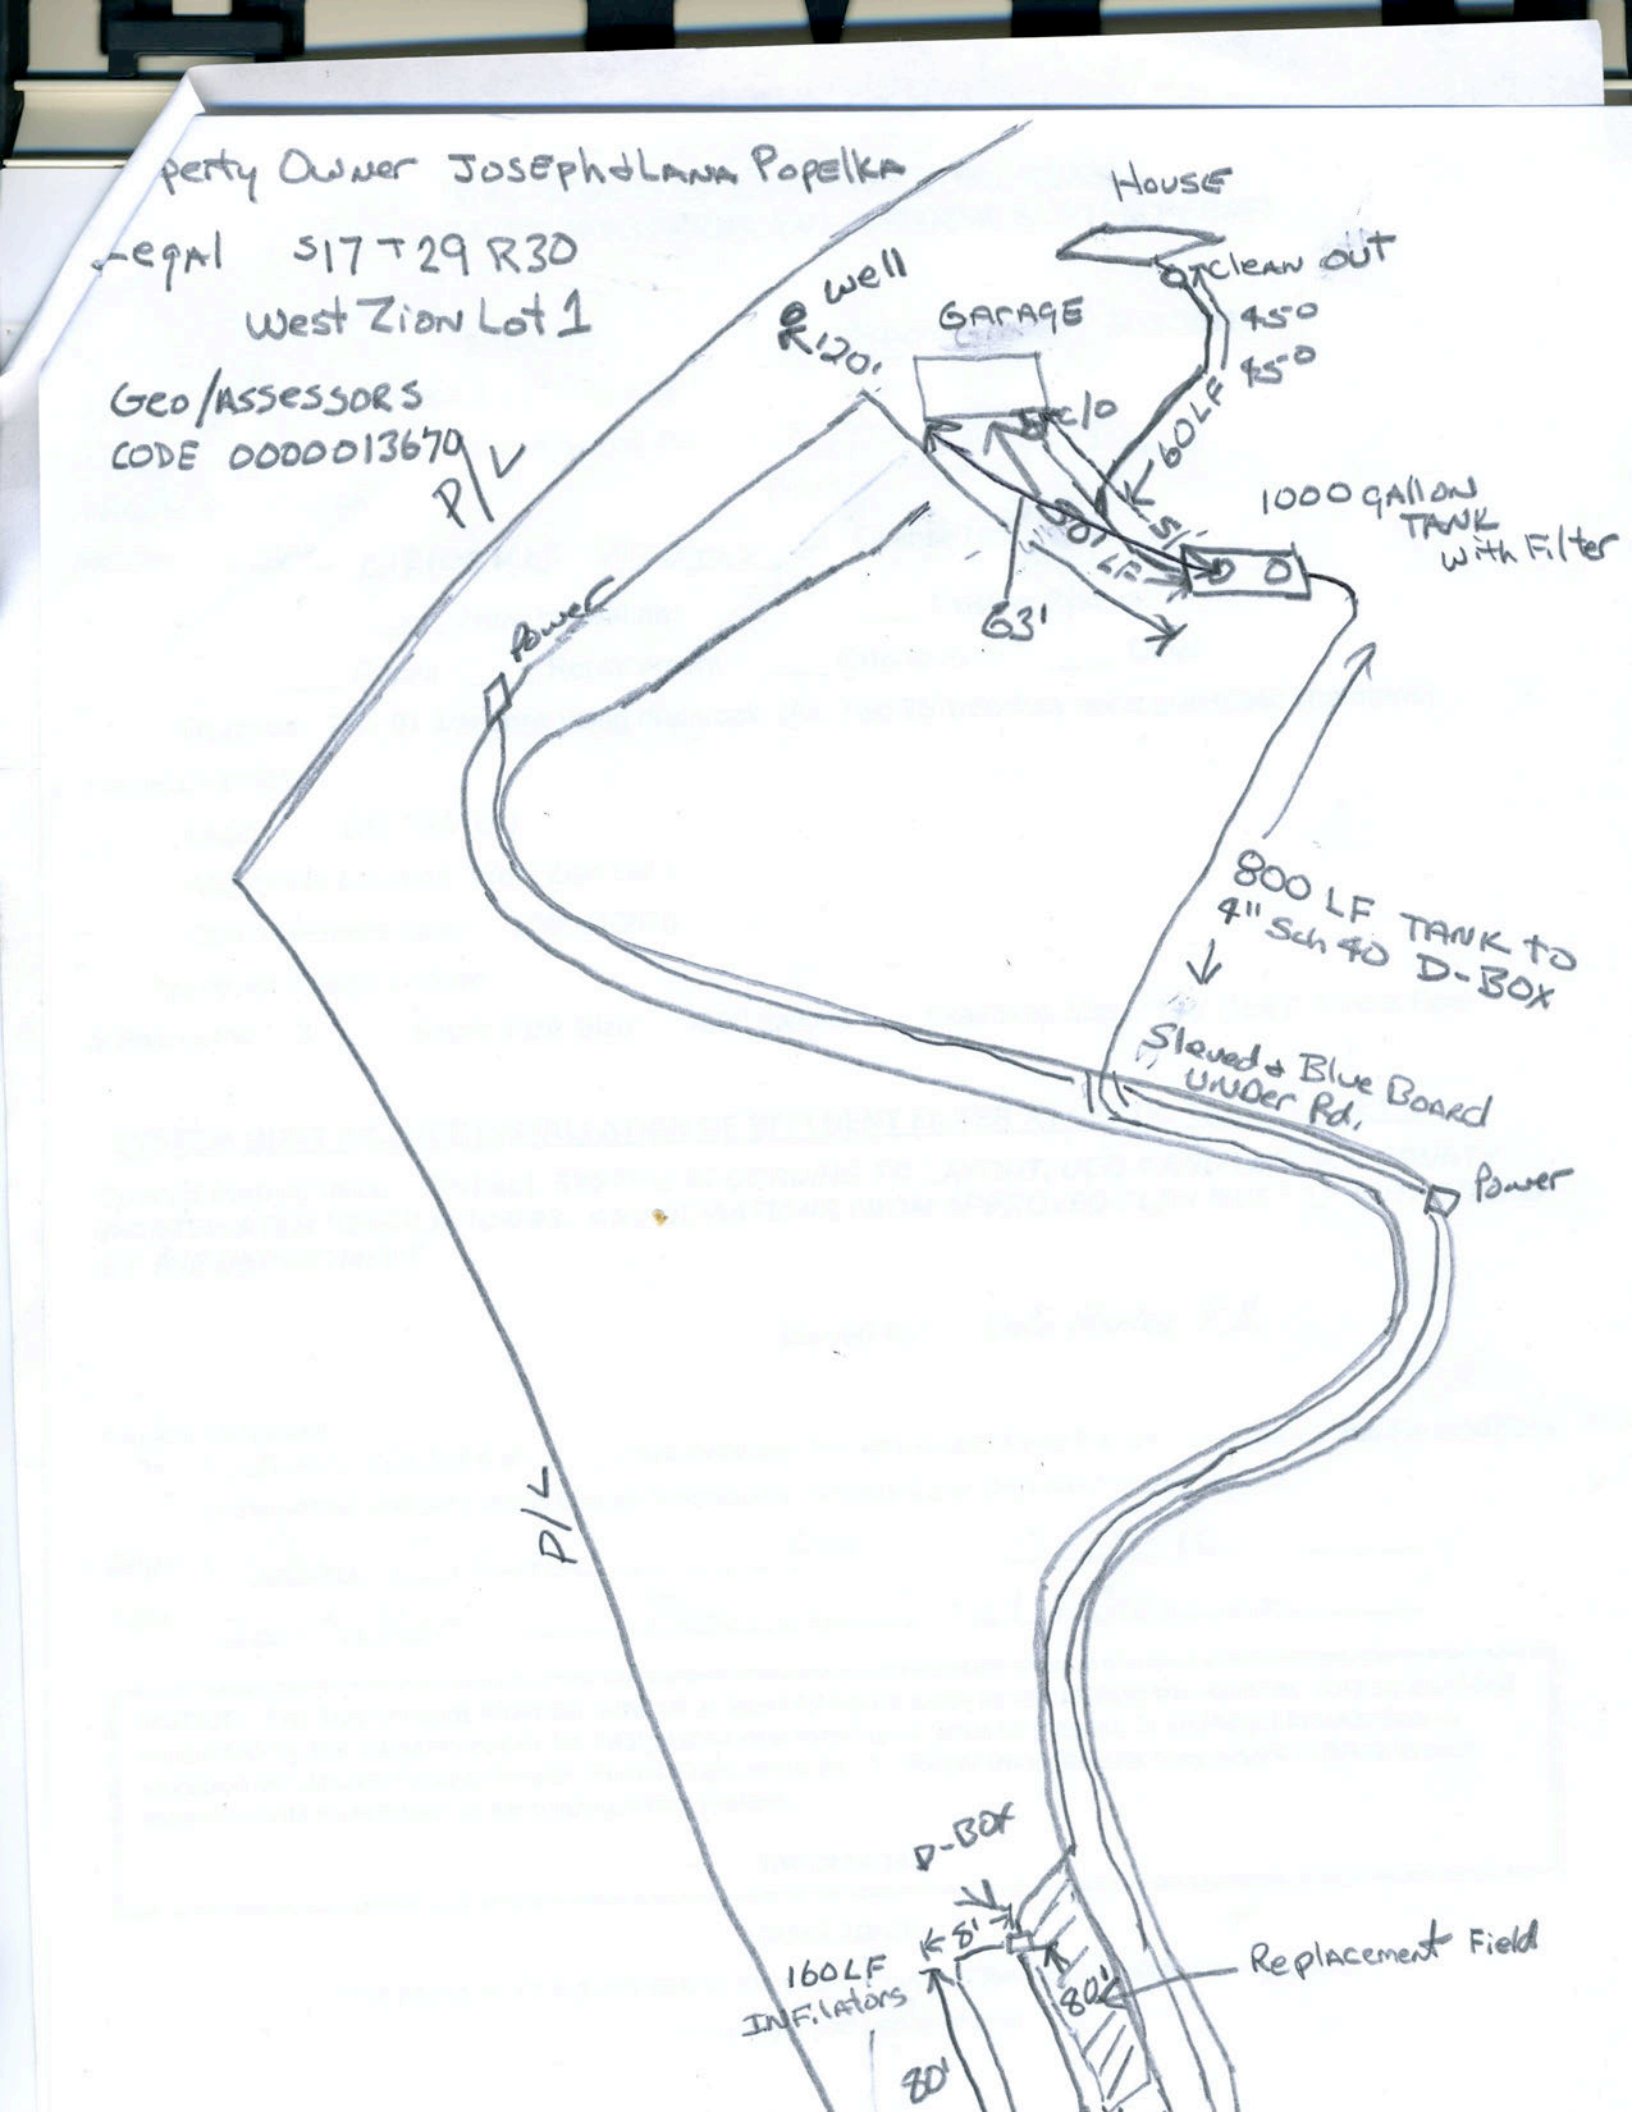
Title: Installer PRECISION DIRT WORKS INC.

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


perty Owner Joseph & Lana Popelka
egal S17 T29 R30
West Zion Lot 1
Geo/Assessors
CODE 0000013670
P/L
HOUSE
CLEAN OUT
45°
45°
well
120'
GARAGE
10
60LF
5'
1000 GALLON
TANK
with Filter
50' LF
63'
Power
800 LF TANK TO
4" Sch 40 D-BOX
Sleved & Blue Board
UNDer Rd.
Power
P/L
D-BOX
5'
160LF
INF.iators
80'
Replacement Field
80'