LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 10/14/2016 Expiration Date: 10/14/2017

Property Owner: Mary Jo Qualey c/o: Hubert Turner

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: Hubert Turner License No. 163

__xx__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Six 35' trenches using gravelless chambers and a central D-box.

Parcel Description:

Legal: S33 T31 R31

Address or Location: Lot 2 Bellers Bluff

Geo/Assessors code: 0000050454

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000 gallons Drainfield Size: 210 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

BELLER'S BLUFF SUBDIVISION


FOR

GARRY BELLER

SE 1/4, NE1/4 SEC 33, T31N, R31W,
LINCOLN COUNTY, MT

OCT 19 1999

MT DEPT. ... QUALITY
PERMITTING ... DIVISION

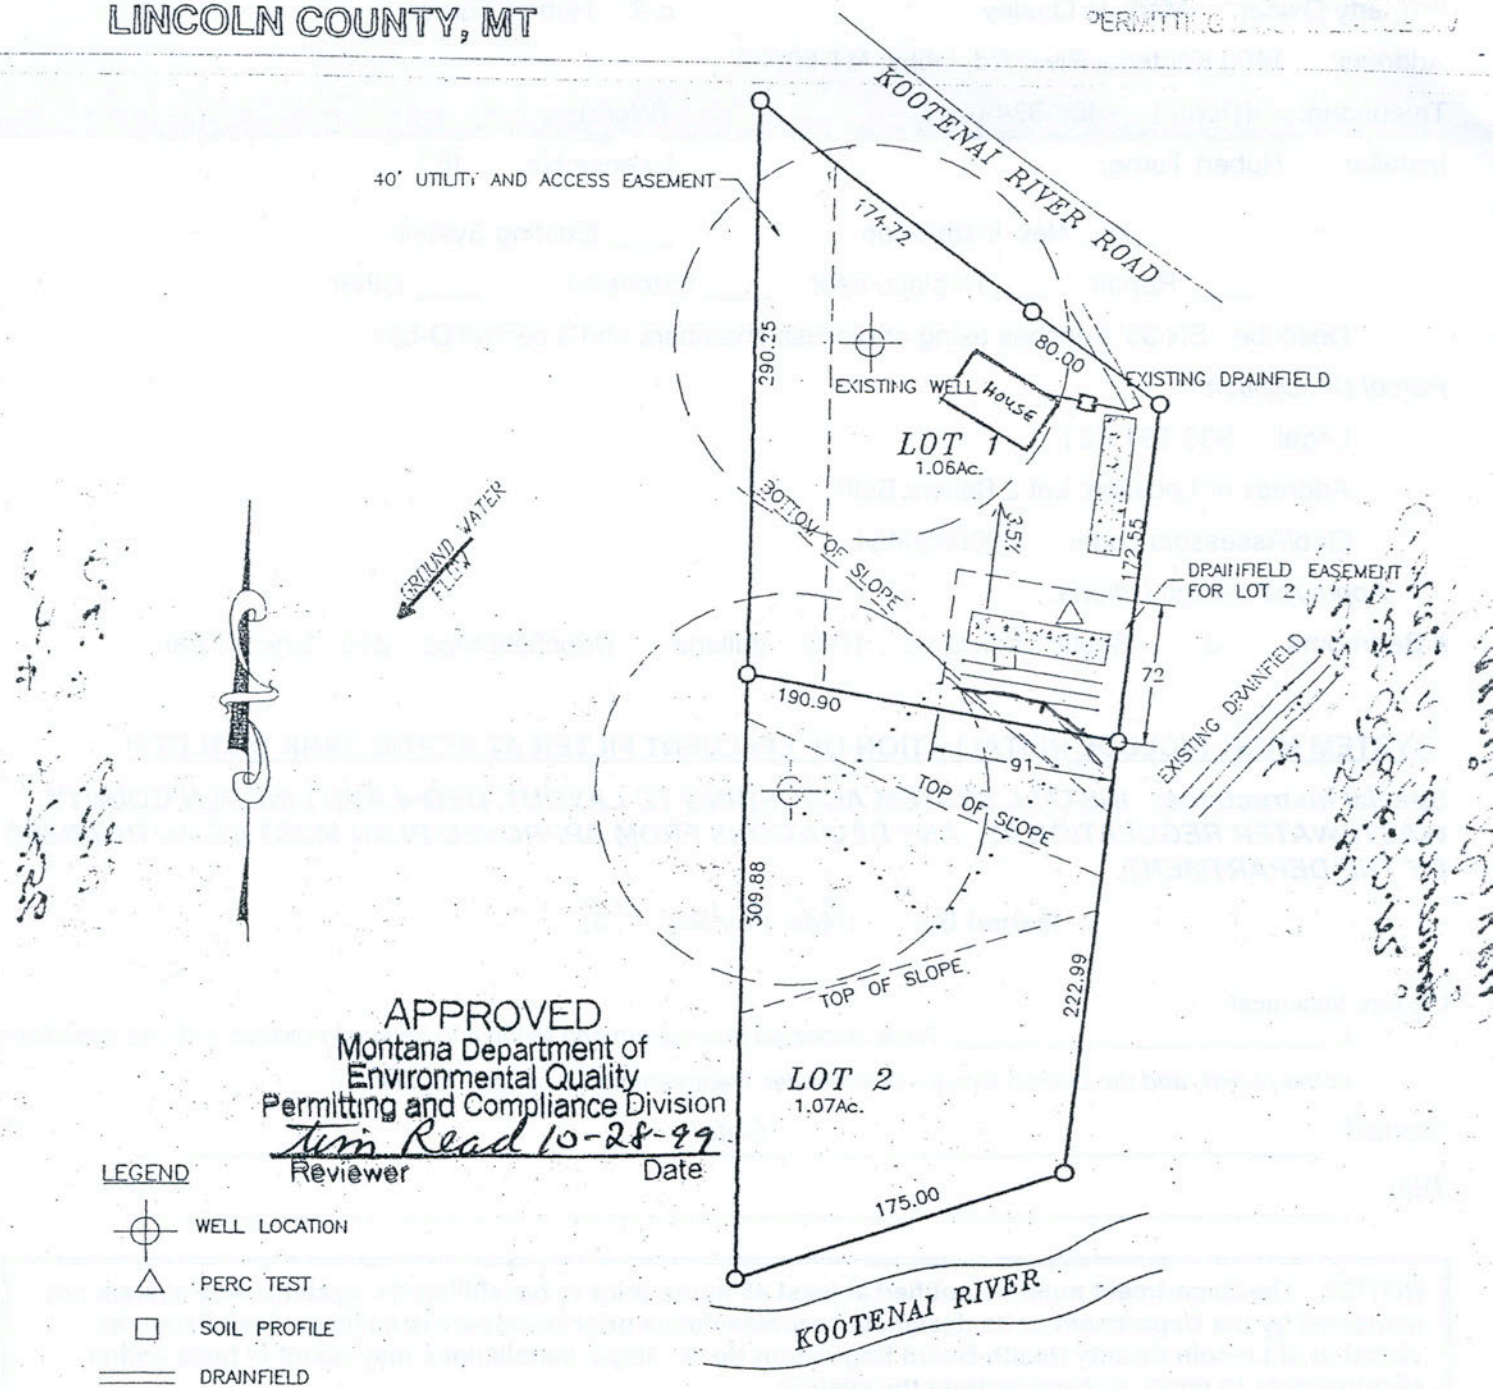

APPROVED
Montana Department of
Environmental Quality
Permitting and Compliance Division
Tim Read 10-28-99
Reviewer Date

LEGEND

- WELL LOCATION
- PERC TEST
- SOIL PROFILE
- DRAINFIELD
- REPLACEMENT AREA
- 14% SURFACE SLOPE AND DIRECTION

LOT 2: 3 LINES, 70 LF EACH, 7' APART

RAY ENGINEERING, INC.
P.O. BOX 738 LIBBY, MONTANA 59923 (406) 293-8704

GARRY BELLER
SAN DIEGO, CALIFORNIA

SCALE 1"=100'
DRAWN BY R. MILLER
DATE 22JU
SHT. NO. 1
DRAWING NO. 99-A-230

LOT LAYOUT