LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 8/3/2016 Expiration Date: 8/3/2017

Property Owner: Laurant St. Louis c/o: Gideon Yutzy

Address: PO BOX 1532 Newtown, AB TOL1R0

Telephone: (Home) [redacted] (Work)

Installer: Gideon Yutzy License No. 113

xx New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Three 76' pressure dosed laterals using 3' gravelless chambers.

Parcel Description:

Legal: S14 T37 R28

Address or Location: Young Creek Estates Lot 1 229 Mountain Lion Dr. Rexford, MT

Geo/Assessors code: 0000055840

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000/500 gallons Drainfield Size: 228 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Gideon Yutzy, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Gideon Yutzy *Date:* Oct-3-2016

Title: Licensed Installer # 113

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

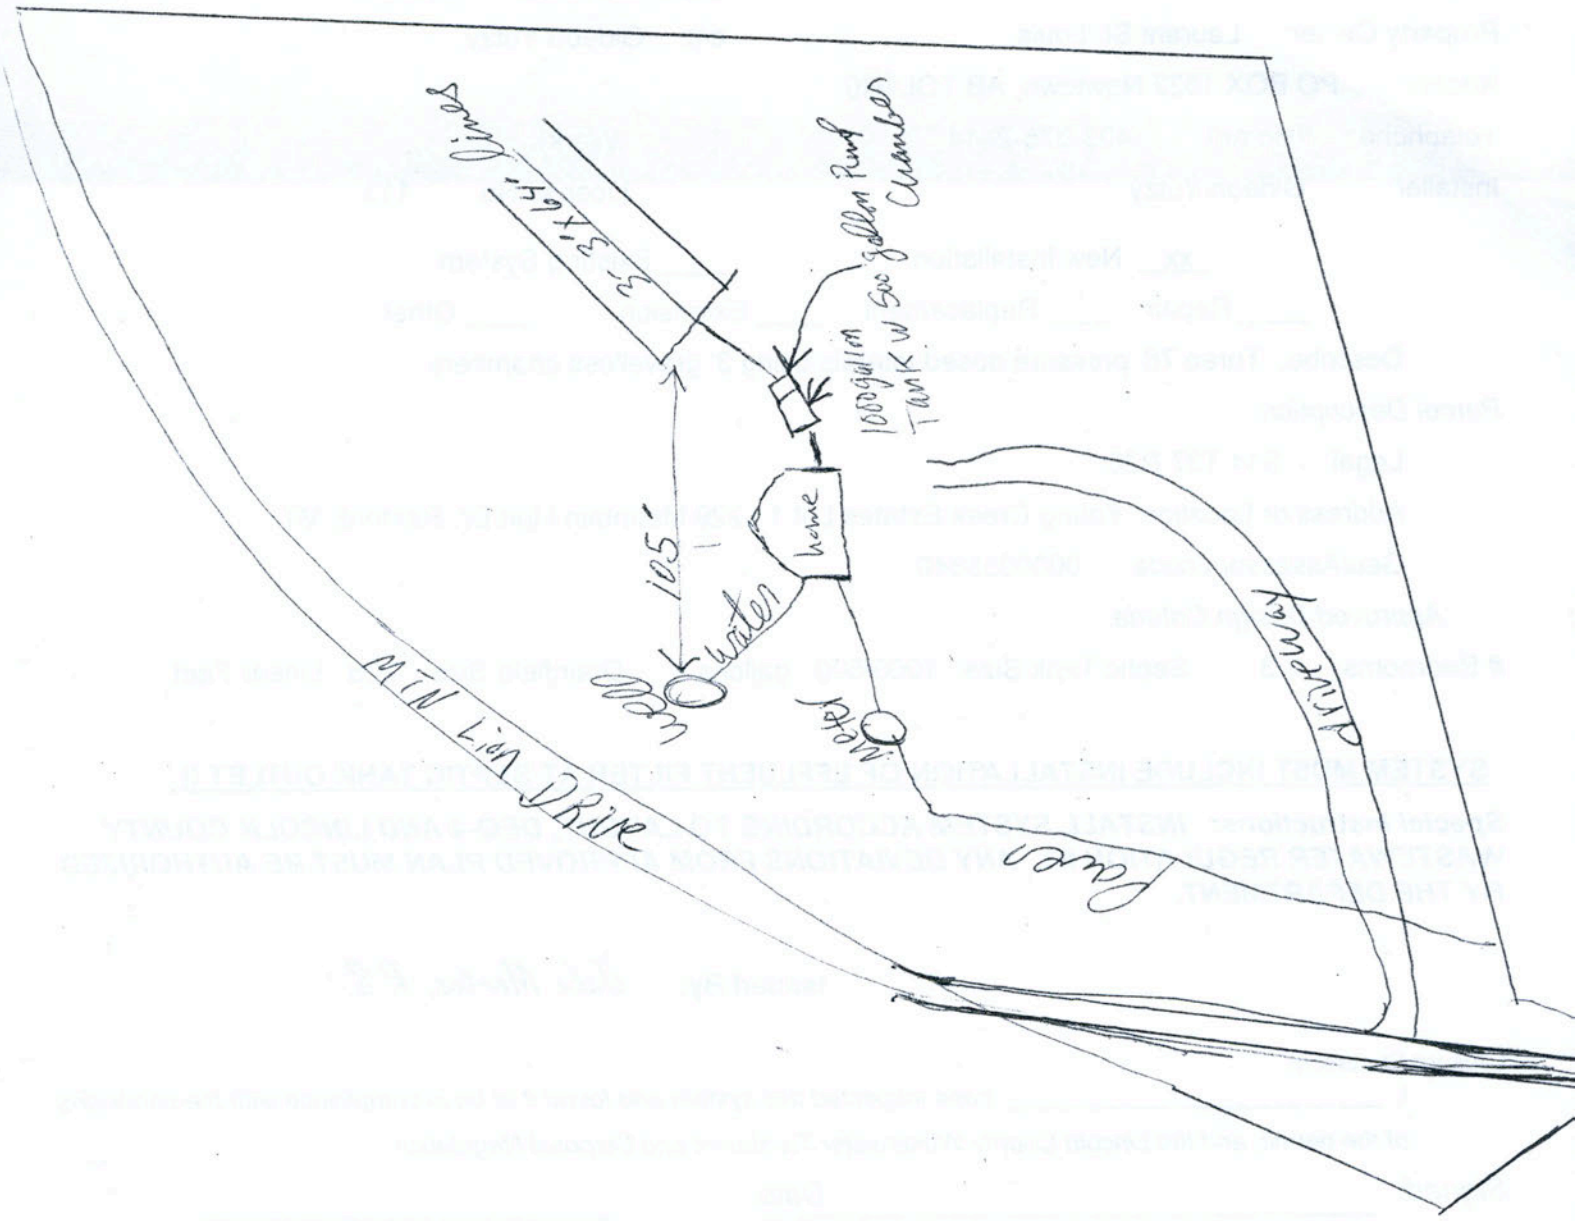
406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

N

LOT LAYOUT


Lines
2'x4'
2'x4'
1000 gallon Pump Chamber
1000 Gallon Tank w/ Sep
105'
Well
Water
Home
Patio
Driveway
MTN Lion Drive