LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 05/13/2015 Expiration Date: 05/14/2016

Property Owner: Barton Stapley c/o: Davis Surveying

Address: P.O. Box 701 Troy, MT 59935

Telephone: (Home) [redacted] (Work)

Installer: Owner License No.

__XX__ New Installation _____ Existing System

_____ Repair _____ Replacement _____ Extension _____ Other

Describe:

Parcel Description:

Legal: SW-1/4 S18 T31 R33

Address or Location: 490 Iron Creek Road

Approved Design Criteria:

Bedrooms: 2 Septic Tank Size: 1000 gallons Drainfield Size: 190 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kendra J. Lind, R.S.*

Closure Statement:

I, KEN E. DAVIS *, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: _____ *Date:* ~~June~~ May 15 2015

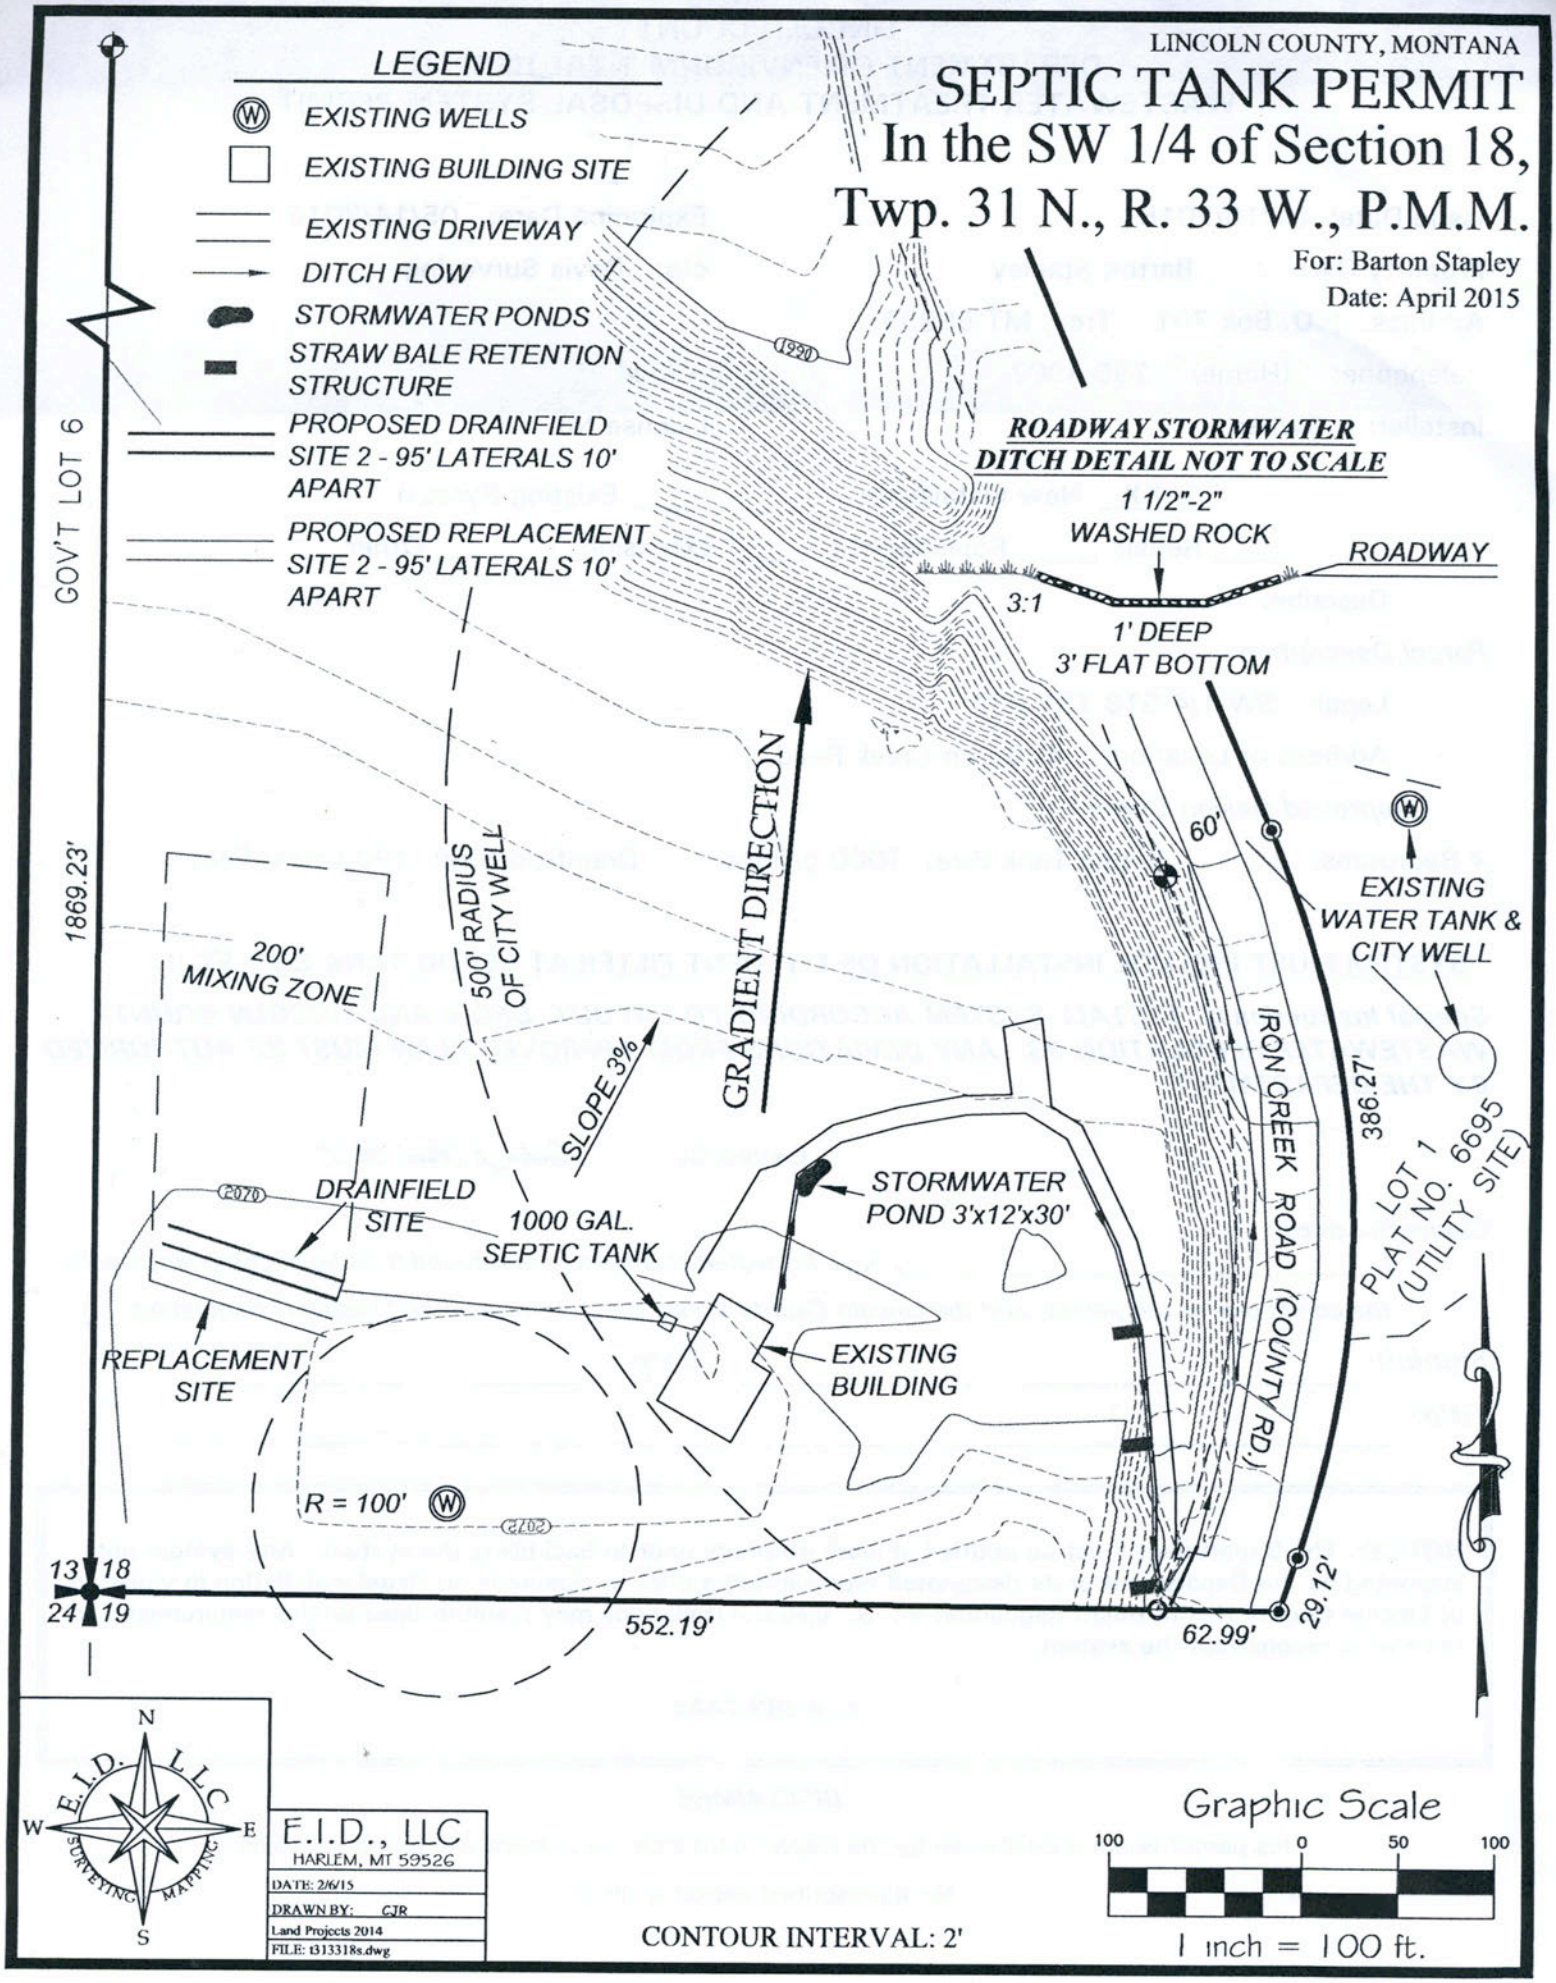
Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


LINCOLN COUNTY, MONTANA
SEPTIC TANK PERMIT
In the SW 1/4 of Section 18, Twp. 31 N., R. 33 W., P.M.M.
For: Barton Stapley
Date: April 2015
LEGEND
EXISTING WELLS
EXISTING BUILDING SITE
EXISTING DRIVEWAY
DITCH FLOW
STORMWATER PONDS
STRAW BALE RETENTION STRUCTURE
PROPOSED DRAINFIELD SITE 2 - 95' LATERALS 10' APART
PROPOSED REPLACEMENT SITE 2 - 95' LATERALS 10' APART
ROADWAY STORMWATER DITCH DETAIL NOT TO SCALE
1 1/2"-2" WASHED ROCK
ROADWAY
3:1
1' DEEP
3' FLAT BOTTOM
GOV'T LOT 6
1869.23'
200' MIXING ZONE
500' RADIUS OF CITY WELL
GRADIENT DIRECTION
SLOPE 3%
DRAINFIELD SITE
1000 GAL. SEPTIC TANK
STORMWATER POND 3'x12'x30'
REPLACEMENT SITE
EXISTING BUILDING
R = 100'
60'
EXISTING WATER TANK & CITY WELL
IRON CREEK ROAD (COUNTY RD.)
386.27'
PLAT LOT 1 (UTILITY SITE) PLAT NO. 6695
13 18
24 19
552.19'
62.99'
29.12'
E.I.D., LLC
HARLEM, MT 59526
DATE: 2/6/15
DRAWN BY: CJR
Land Projects 2014
FILE: t313318s.dwg
CONTOUR INTERVAL: 2'
Graphic Scale
100 0 50 100
1 inch = 100 ft.