LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 08/14/2025 (Renewal) 05/09/2023 Expiration Date: 08/13/2026 Permit#25-1517

Property Owner: Scott & Hilda Sterner

Mailing Address: [redacted]

Installer: Homeowner License #:

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of gravity system for 2 bathrooms in workshop.

Parcel Description:

Legal: S07, T34 N, R25 W, C.O.S. 3697, PARCEL C, ACRES 59.97

Property Address: 1168 Mee Rd. Trego, MT 59934 Assessment Code: 1517

DEQ COSA: EQ# Date:

Approved Design Criteria: Installation of Gravity system with perf pipe and drainrock for 2 bathrooms in shop. Sized at 0.3 APP rate with 4 Laterals @ 80'.

# of Bedrooms: 2 Bathrooms in Shop Septic Tank Size: 1000 gallons Trench Width: 24"

# of Laterals: 4 Length of Laterals: 80' Trench Depth: 24-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, Circular DEQ-4, and COSA(If Applies). Reduction given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Robin Blumberg, R.S.

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

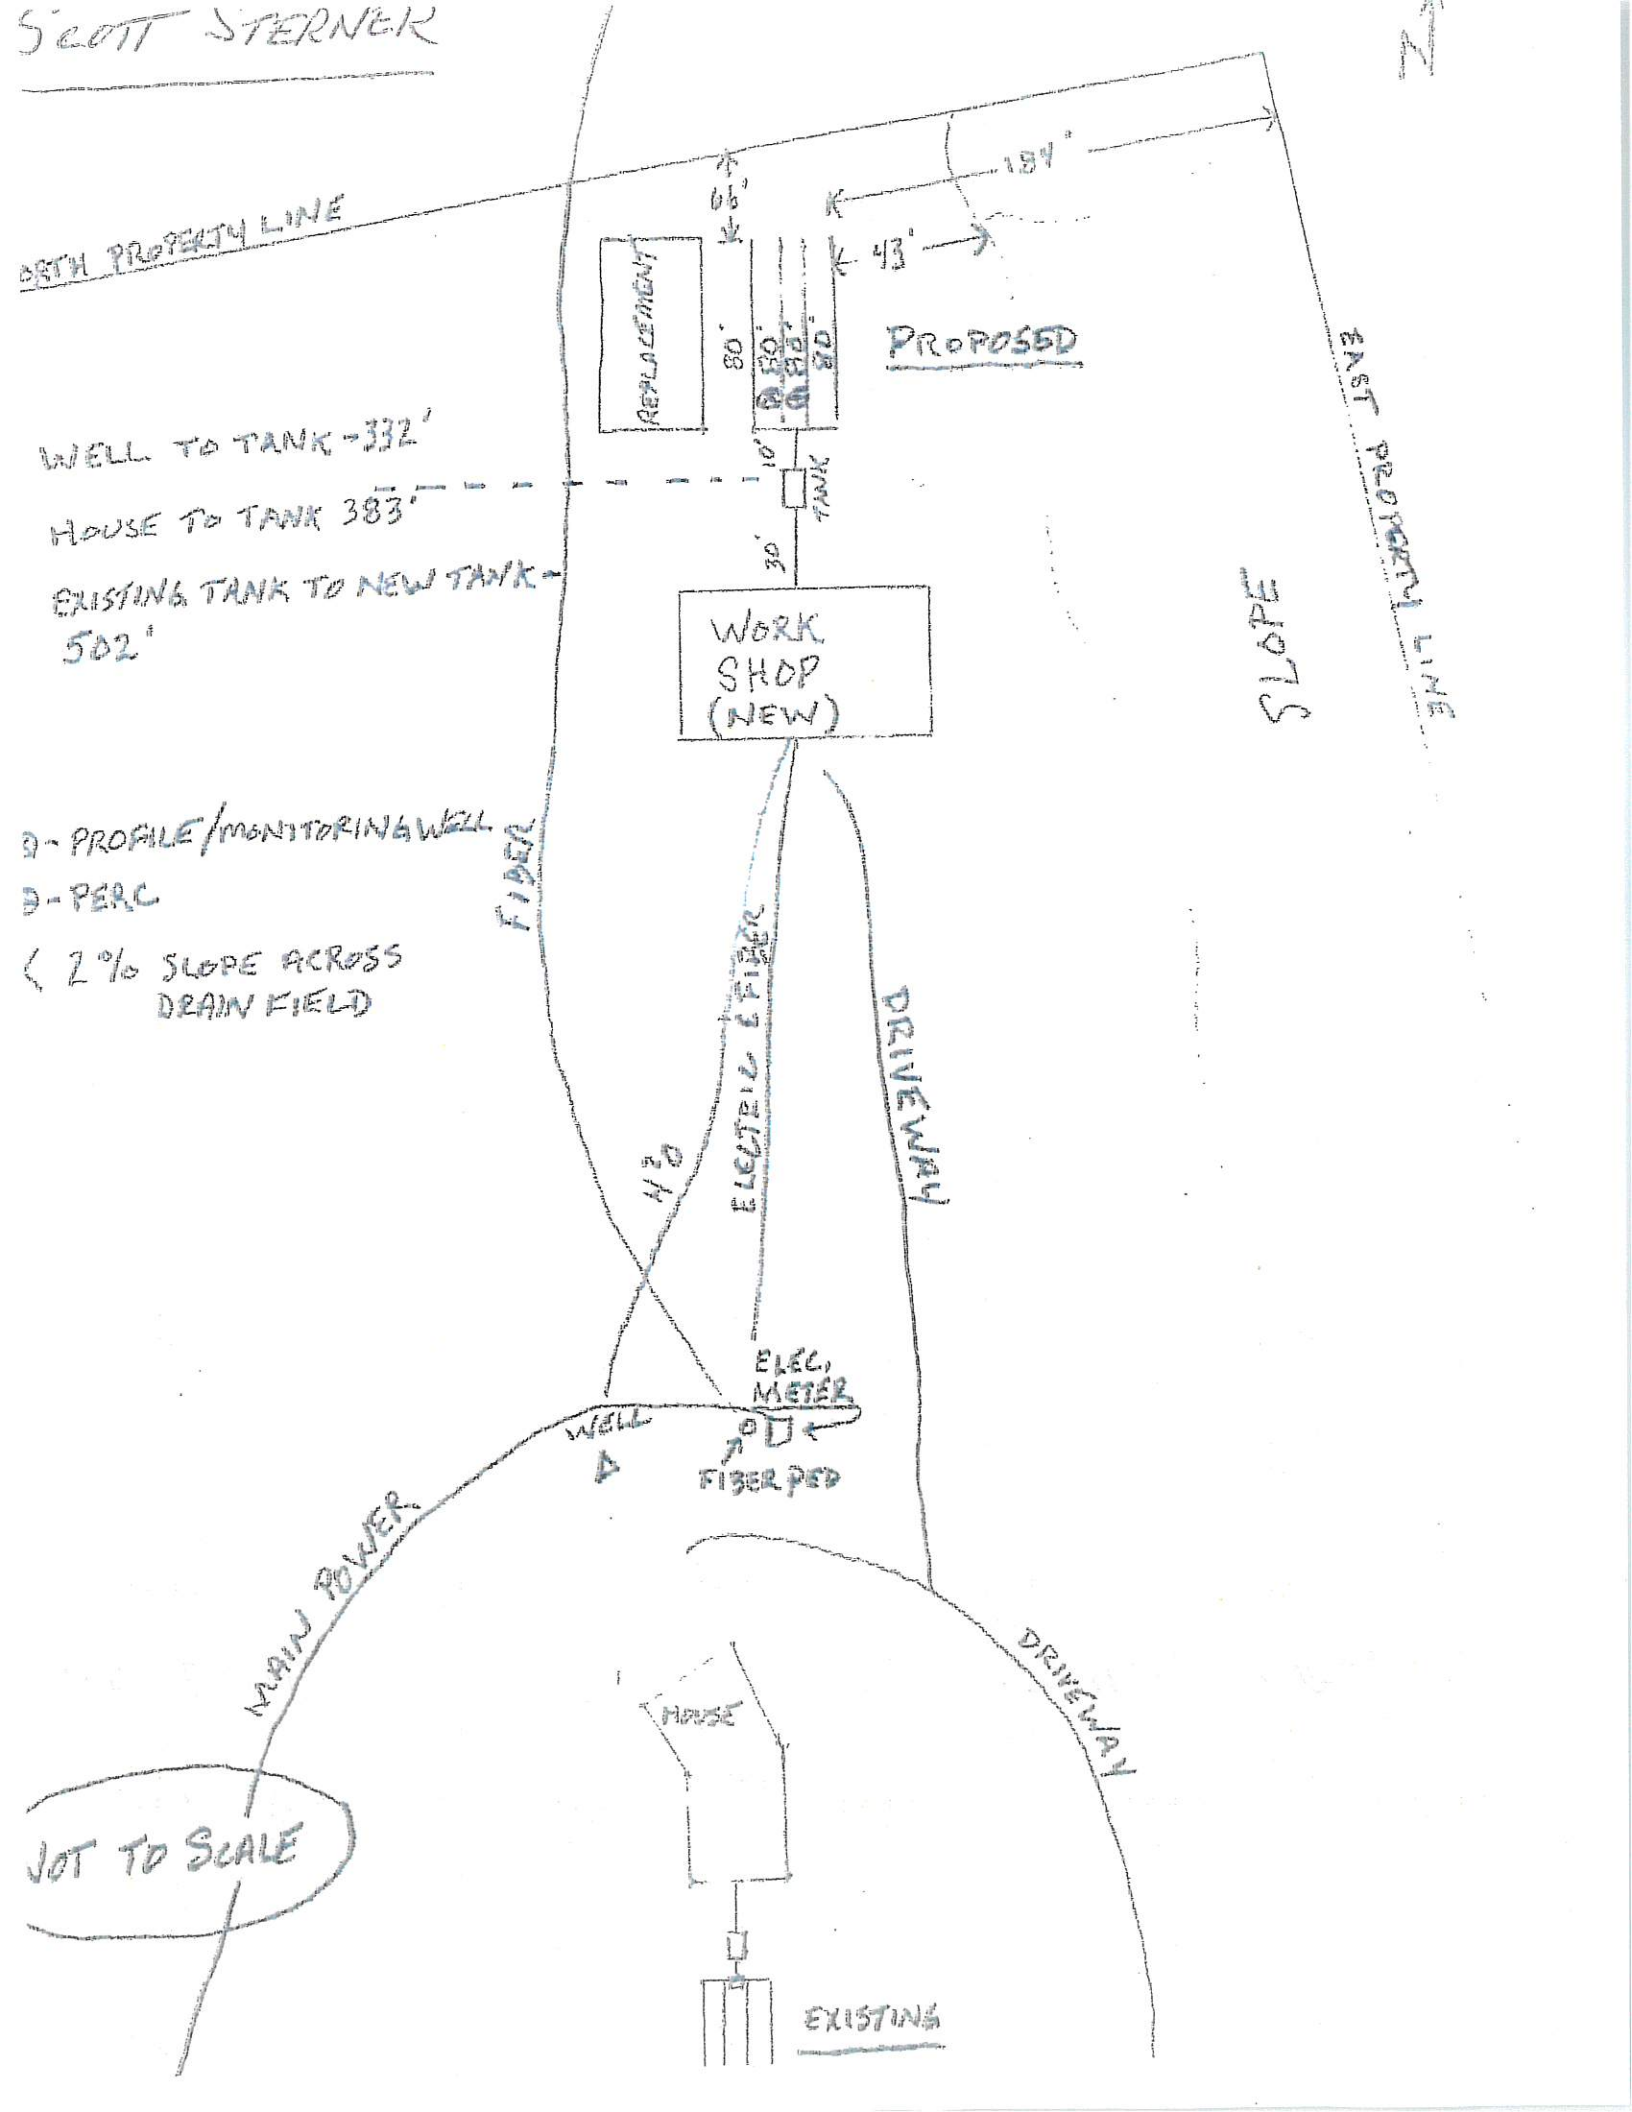
Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Robin Blumberg *Date:* 10/7/25

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.


SCOTT STERNER
NORTH PROPERTY LINE
66'
184'
43'
REPLACEMENT
80'
50'
30'
20'
PROPOSED
WELL TO TANK - 332'
HOUSE TO TANK 383'
EXISTING TANK TO NEW TANK - 502'
10'
TANK
30'
WORK SHOP (NEW)
SLOPE
EAST PROPERTY LINE
9 - PROFILE/MONITORING WELL
3 - PERC
< 2% SLOPE ACROSS DRAIN FIELD
FIBER
H2O
ELECTRIC & FIBER
DRIVEWAY
ELEC. METER
WELL
FIBER PED
MAIN POWER
HOUSE
DRIVEWAY
NOT TO SCALE
EXISTING