LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 12/08/2015 Expiration Date: 12/09/2016

Property Owner: Kit Stoken c/o:

Address: PO BOX 768

Telephone: (Home) [redacted] (Work)

Installer: K & D Hayes Dirtworks License No. 144

xx New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: 3 88' laterals using gravelless chambers. Size reduced per .5 app. Rate.

Parcel Description:

Legal: S3 T36 R27

Address or Location: [redacted]

Geo/Assessors code: 0000007411

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000 gallons Drainfield Size: 264 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes

Closure Statement:

I, M Kent Hayes, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: M. Kent Hayes Date: 4-29-2016

Title: installer License #144

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

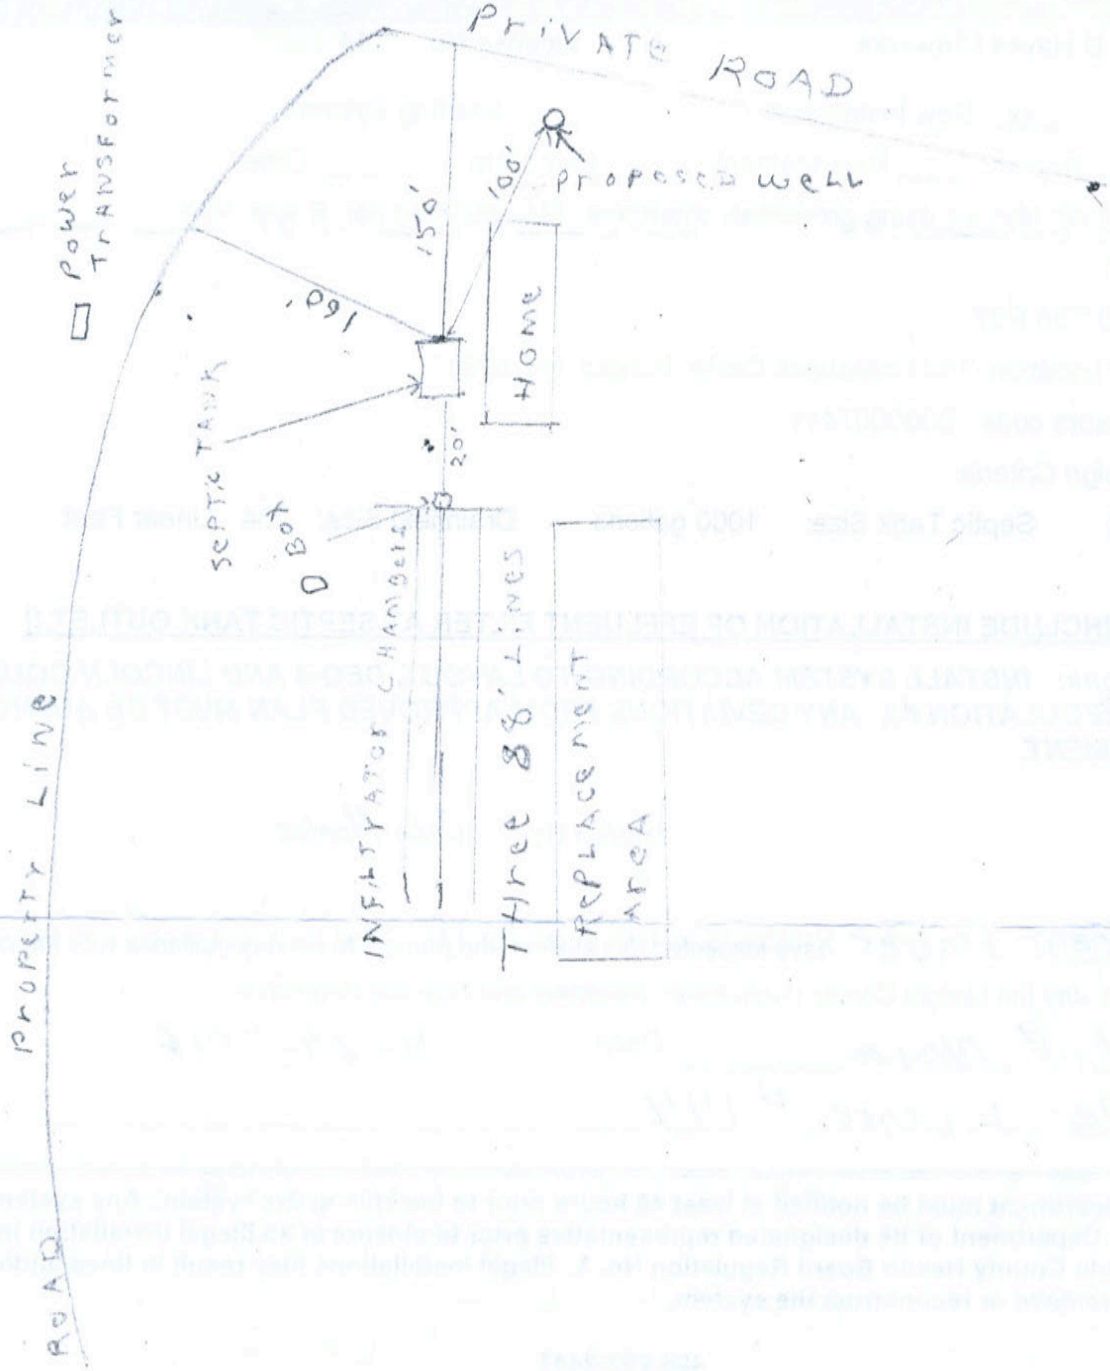
406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

E

LOT LAYOUT


PRIVATE ROAD
PROPOSED WELL
100'
150'
100'
POWER TRANSFORMER
HOME
SEPTIC TANK
20'
BOX
INFILTRATOR CHAMBERS
THREE 88' LINES
REPLACEMENT AREA
PROPERTY LINE
ROAD