LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 10/11/2017 Expiration Date: 10/11/2018

Property Owner: Paul Tisher c/o:

Address: PO BOX 1490, Libby, MT 59923

Telephone: (Home) (Work)

Installer: License No.

__xx__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: One 75' lateral using gravelless chambers.

Parcel Description:

Legal: S7 T26 R28

Address or Location: 173 Parkinson Lane (Shop Building)

Geo/Assessors code: 0000014448

Approved Design Criteria:

#150 gal/day Septic Tank Size: 1000 gallons Drainfield Size: 75 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Jake Mertes, R.S.*

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

Title: _____

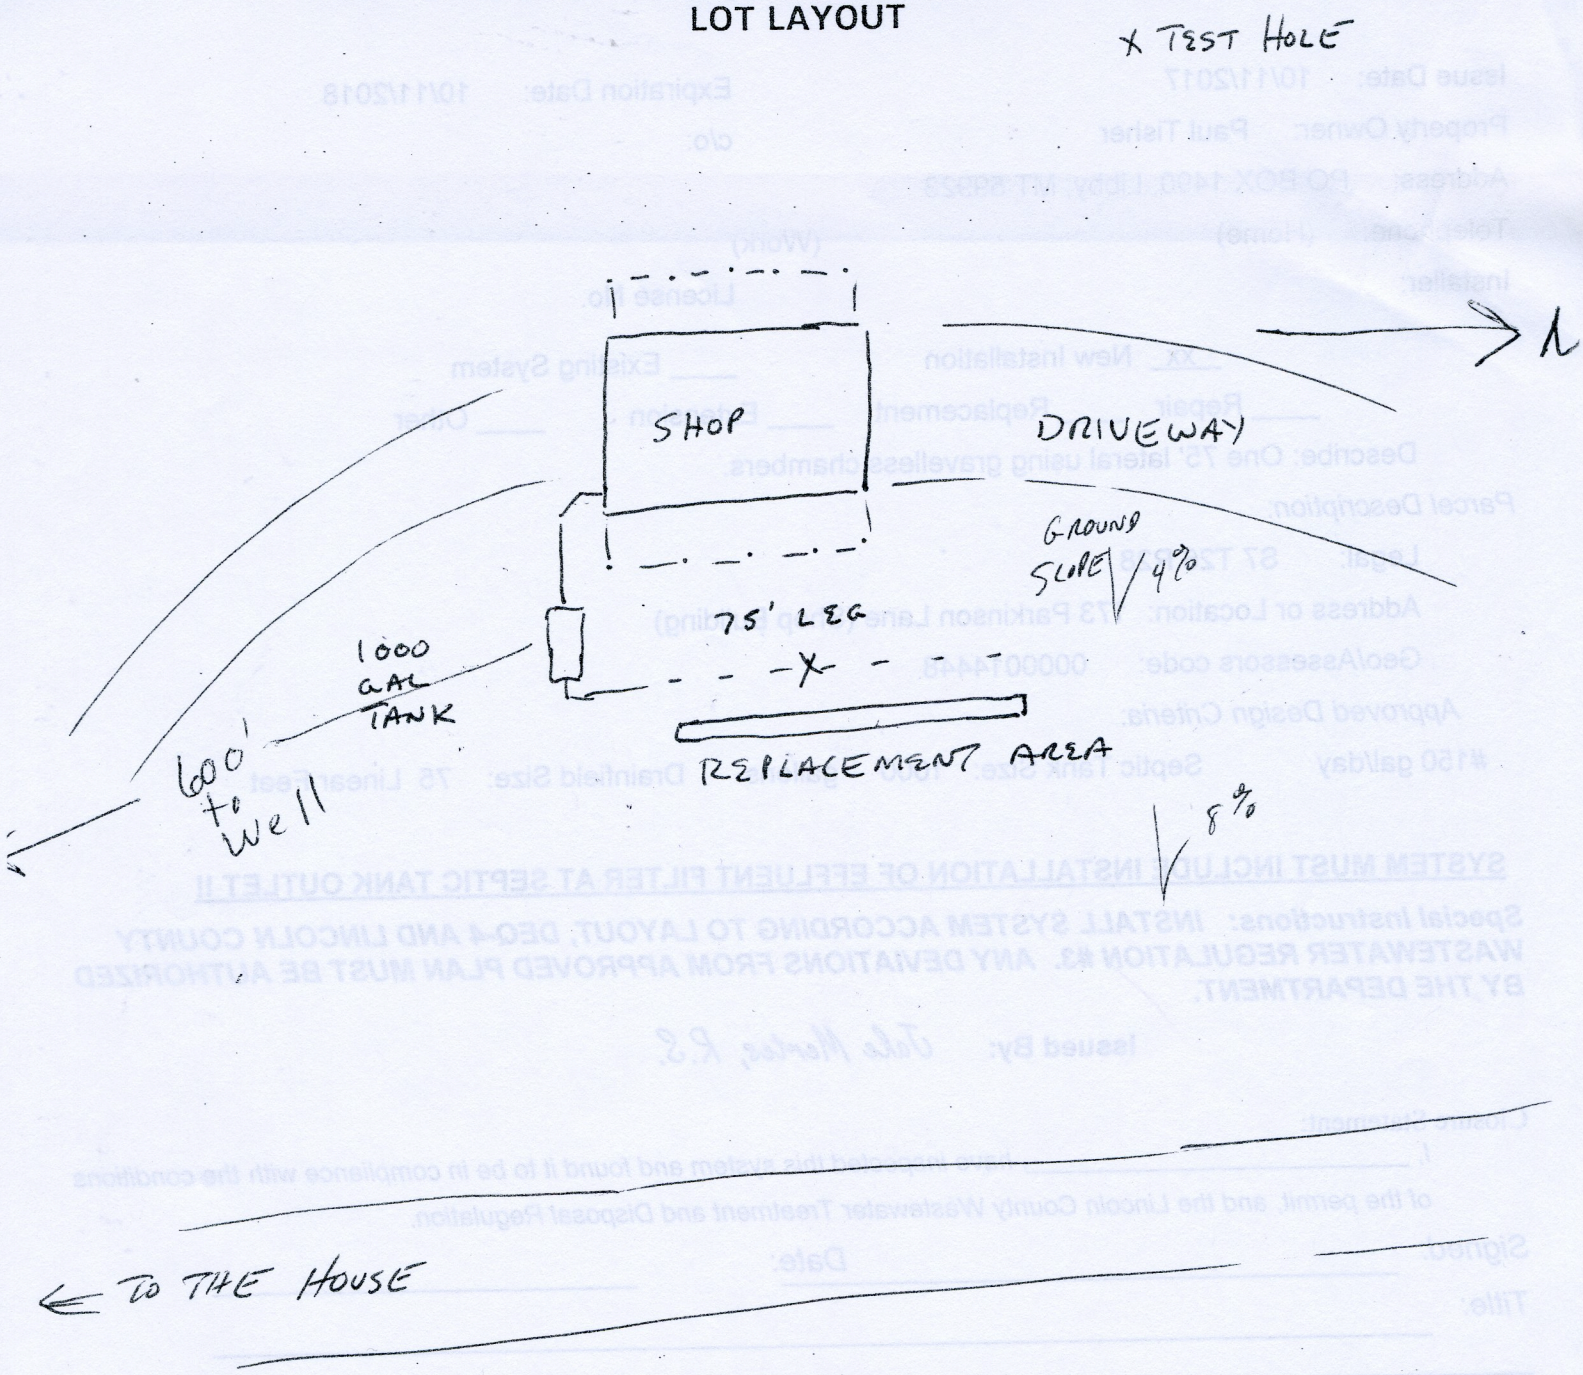
NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

LOT LAYOUT


X TEST HOLE
SHOP
DRIVEWAY
GROUND SLOPE 4%
75' LEG
1000 GAL TANK
600' to Well
REPLACEMENT AREA
8%
TO THE HOUSE