LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 10/26/2016 Expiration Date: 10/26/2017

Property Owner: Trego Pub and Store LLC c/o: Barb Renkema

Address: PO BOX 1693, Eureka, MT 59917

Telephone: (Home) [redacted] (Work)

Installer: Barb Renkema License No. 78

__xx__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Six 92' pressure dosed laterals using 3' wide trenches. Installed Per Engineered Plan

Parcel Description:

Legal: S18 T34 R25

Address or Location: Etter Subdivision Lot 1

Geo/Assessors code: 0000010243

Approved Design Criteria:

Bedrooms NA Septic Tank Size: 2000/1000 gallons Drainfield Size: 552 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442


DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

LOT 1 ETTER SUB., SWAN PROPERTY

LOT LAYOUT

SE4 SECTION 18-T34N-R25W
LINCOLN COUNTY

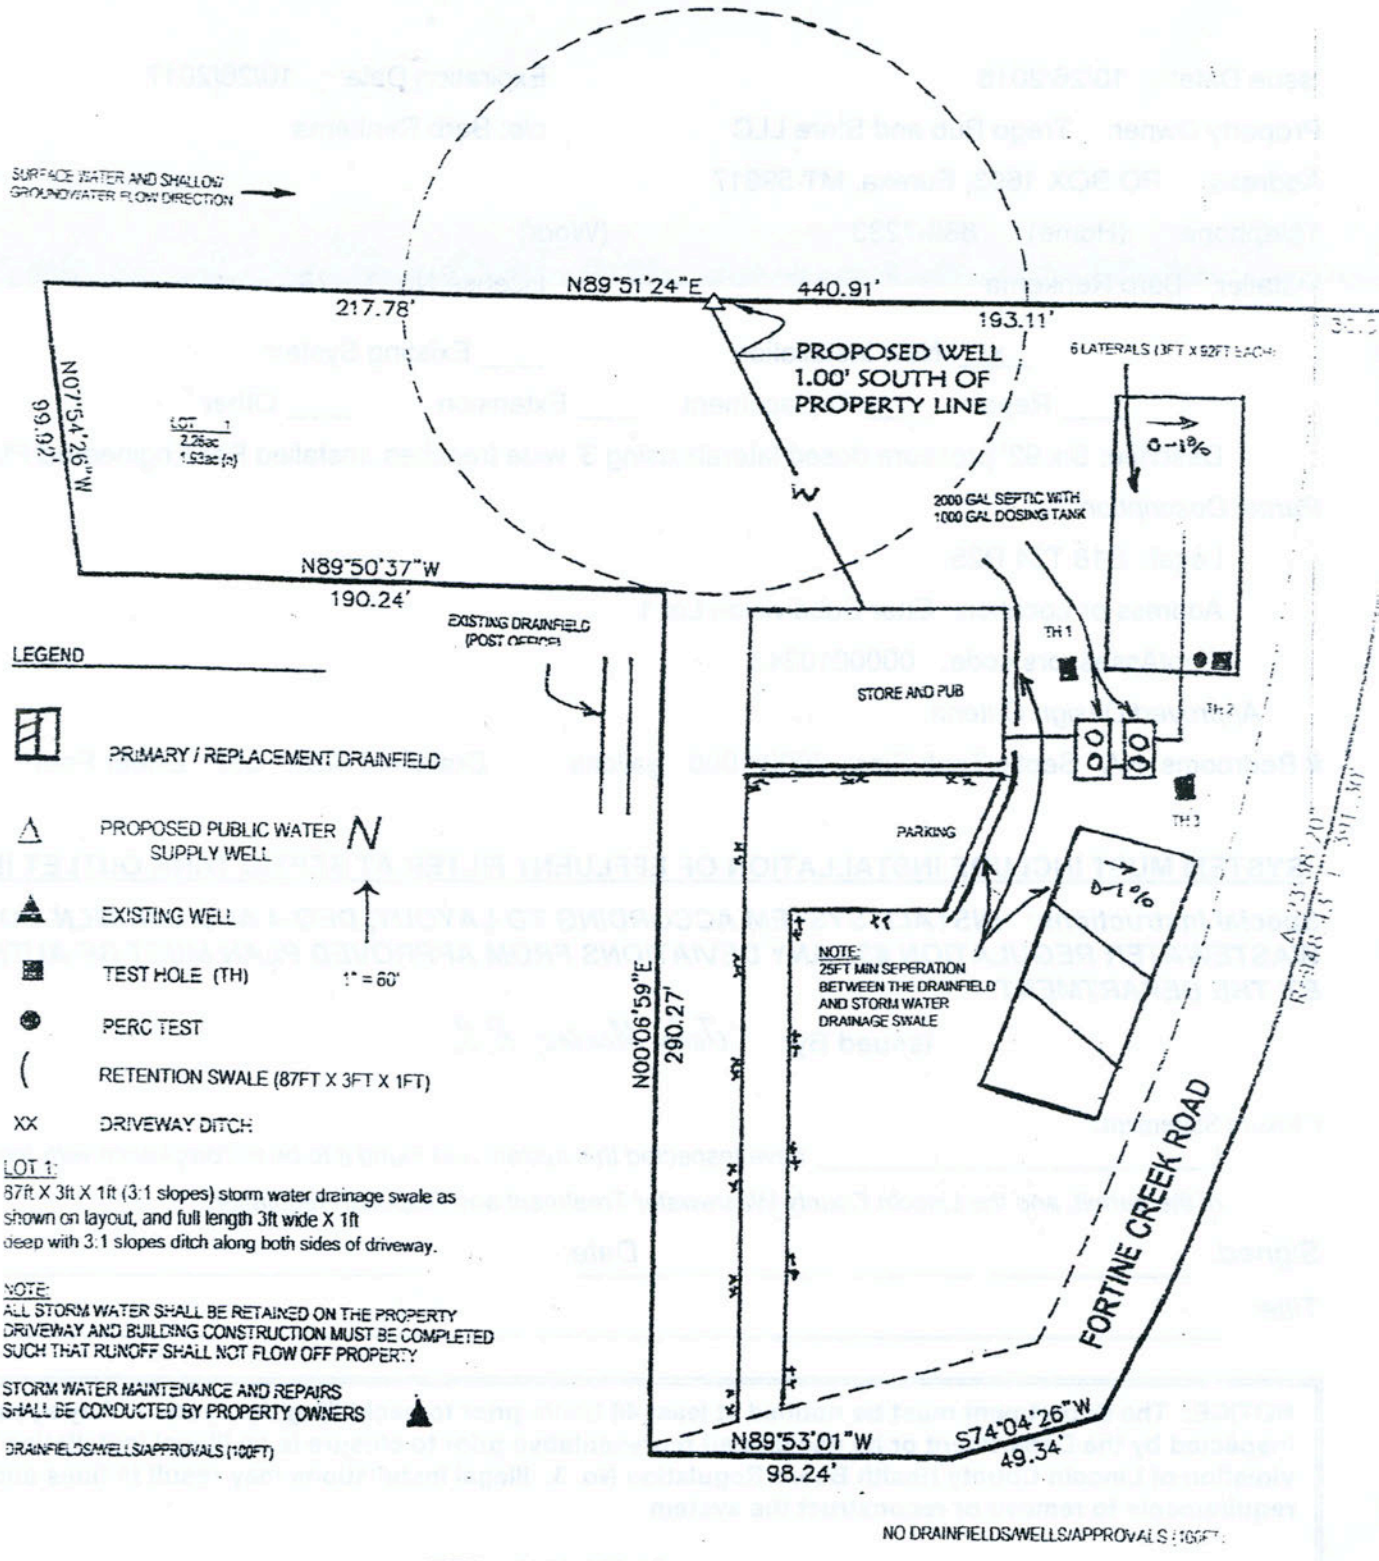

LEGEND

- PRIMARY / REPLACEMENT DRAINFIELD
- PROPOSED PUBLIC WATER SUPPLY WELL
- EXISTING WELL
- TEST HOLE (TH)
- PERC TEST
- RETENTION SWALE (87FT X 3FT X 1FT)
- XX DRIVEWAY DITCH

N

1" = 60'

LOT 1:
87ft X 3ft X 1ft (3:1 slopes) storm water drainage swale as shown on layout, and full length 3ft wide X 1ft deep with 3:1 slopes ditch along both sides of driveway.


NOTE:
ALL STORM WATER SHALL BE RETAINED ON THE PROPERTY
DRIVEWAY AND BUILDING CONSTRUCTION MUST BE COMPLETED SUCH THAT RUNOFF SHALL NOT FLOW OFF PROPERTY

STORM WATER MAINTENANCE AND REPAIRS SHALL BE CONDUCTED BY PROPERTY OWNERS

DRAINFIELDS/WELLS/APPROVALS (100FT)



STORMWATER DRAINAGE SWALE DETAIL
(GRASS SWALE)
CROSS SECTION FOR TRAPEZOIDAL CHANNEL



DRIVEWAY DRAINAGE DITCH
GRASS/GRAVEL ROADSIDE SWALE
CROSS SECTION FOR TRIANGULAR CHANNEL
3.0 CUFT/FT

Jere Johnson
Environmental Health Coord.
4572 Whitefish Stage Rd
Whitefish MT 59937