LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 8/10/2016 Expiration Date: 8/10/2017

Property Owner: Tungsten Holdings c/o:

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: Dan Halvorson License No. 161

___ New Installation __xx__ Existing System

____ Repair __xx__ Replacement ____ Extension ____ Other

Describe: Installing a 9' x 28' pressure dosed absorption bed to replace failed system

Parcel Description:

Legal: S3 T30 R31

Address or Location: Mountain View Park Block 3 Lot 10 & E2

Geo/Assessors code: 0000008754

Approved Design Criteria:

Bedrooms 1 Septic Tank Size: 1000/500 gallons Drainfield Size: 252 Square Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Dan Halvorson *, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: _____ *Date:* 8/19/16

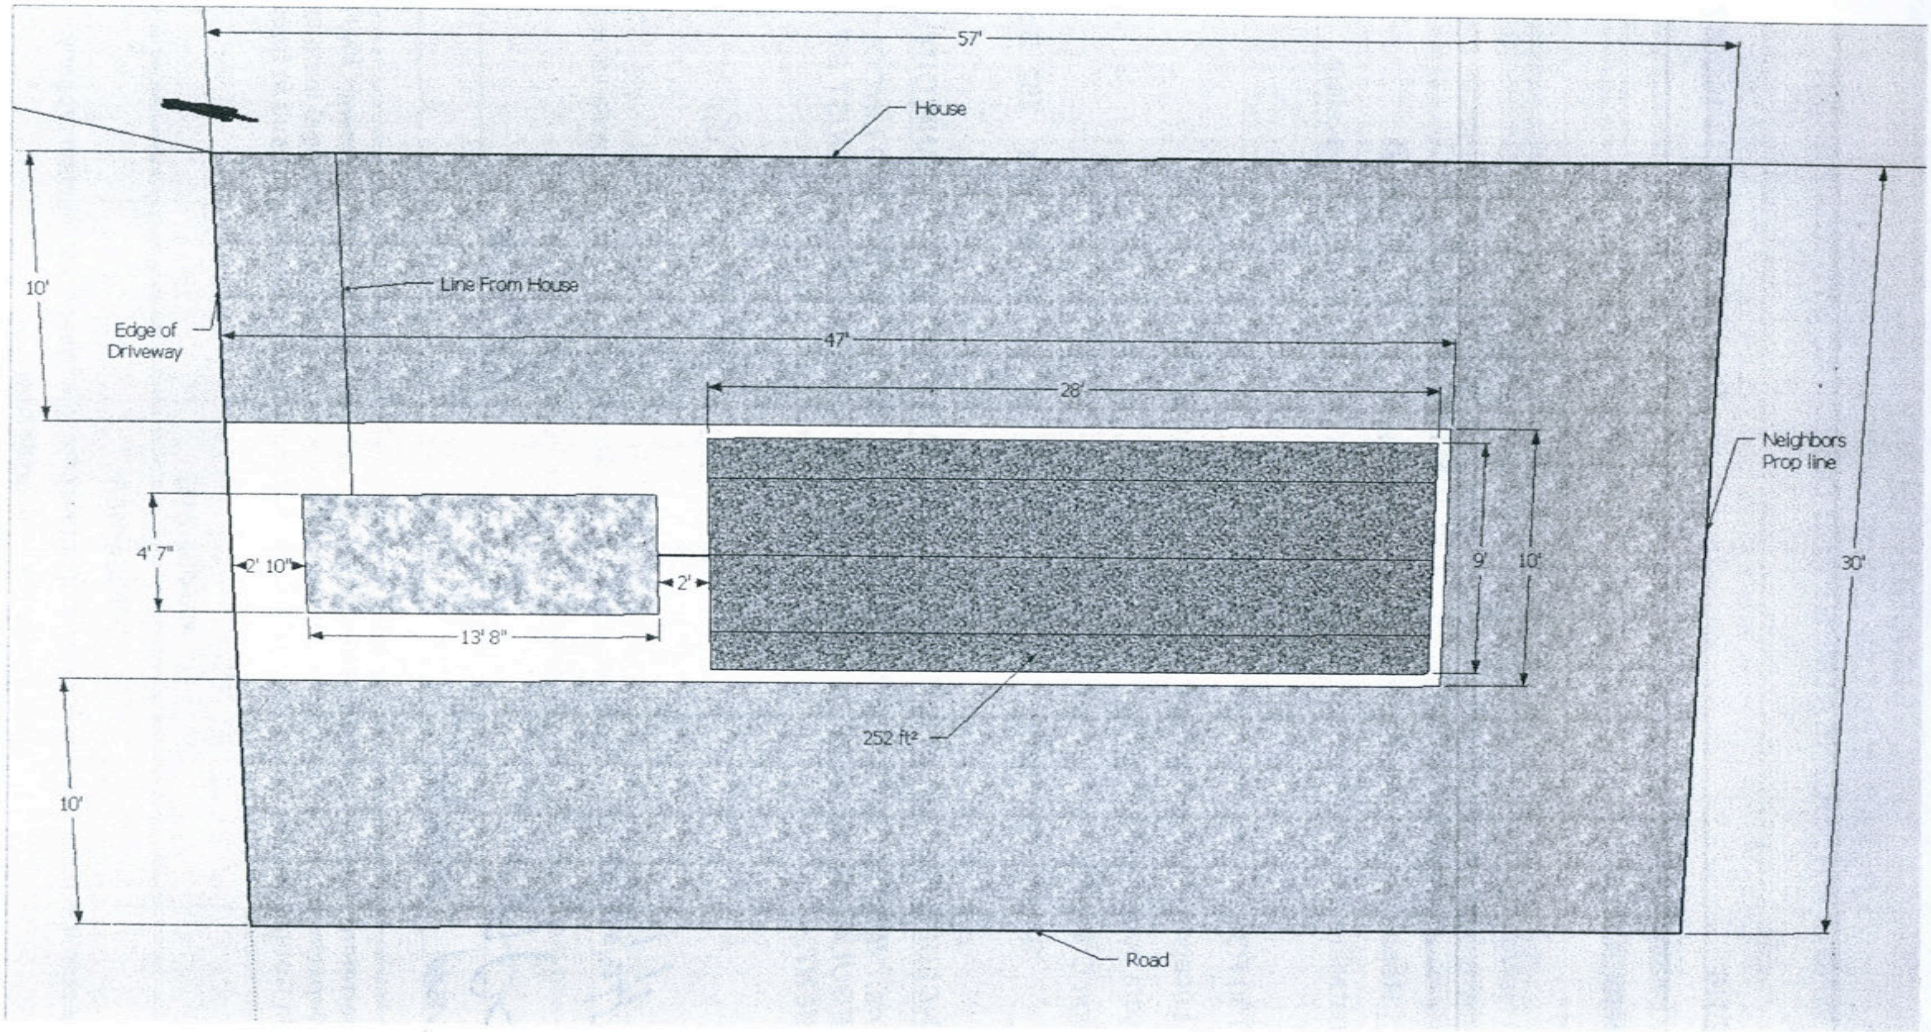
Title: Licensed installer

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


57'
House
10'
Line From House
Edge of
Driveway
47'
28'
Neighbors
Prop line
4' 7"
2' 10"
2'
13' 8"
9'
10'
30'
252 ft²
10'
Road