# LINCOLN COUNTY
# DEPARTMENT OF ENVIRONMENTAL HEALTH
# WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 4/21/2016 Expiration Date: 4/20/2017

Property Owner: Whitefish Credit Union c/o: Buck Schermerhorn

Address: PO BOX 37, Whitefish, MT 59937

Telephone: (Home) [redacted] (Work)

Installer: Koocanusa Excavating, Inc. License No. 135

___ New Installation ____ Existing System

____ Repair __XX__ Replacement ____ Extension ____ Other

Describe: Install 386' of pressure dosed lines in three foot trenches using gravelless chambers

*Parcel Description*:

Legal: S28 T35 R26

Address or Location: [redacted]

Geo/Assessors code: 0000014015

*Approved Design Criteria*: (ref: memo KEI01416, ref: Permit 2009 Claycolmb)

# Bedrooms 4 Septic Tank Size: 1500/500 gallons Drainfield Size: 386 Linear Feet

**SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!**

***Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.***

**Issued By:** Jake Mertes, R.S.

Closure Statement:

I, BUCK SCHERMERHORN, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

*Signed:* Buck Schermerhorn *Date:* 5/3/16


*Title:* PRESIDENT

**NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.**


**406-283-2442**

***DISCLAIMER***

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

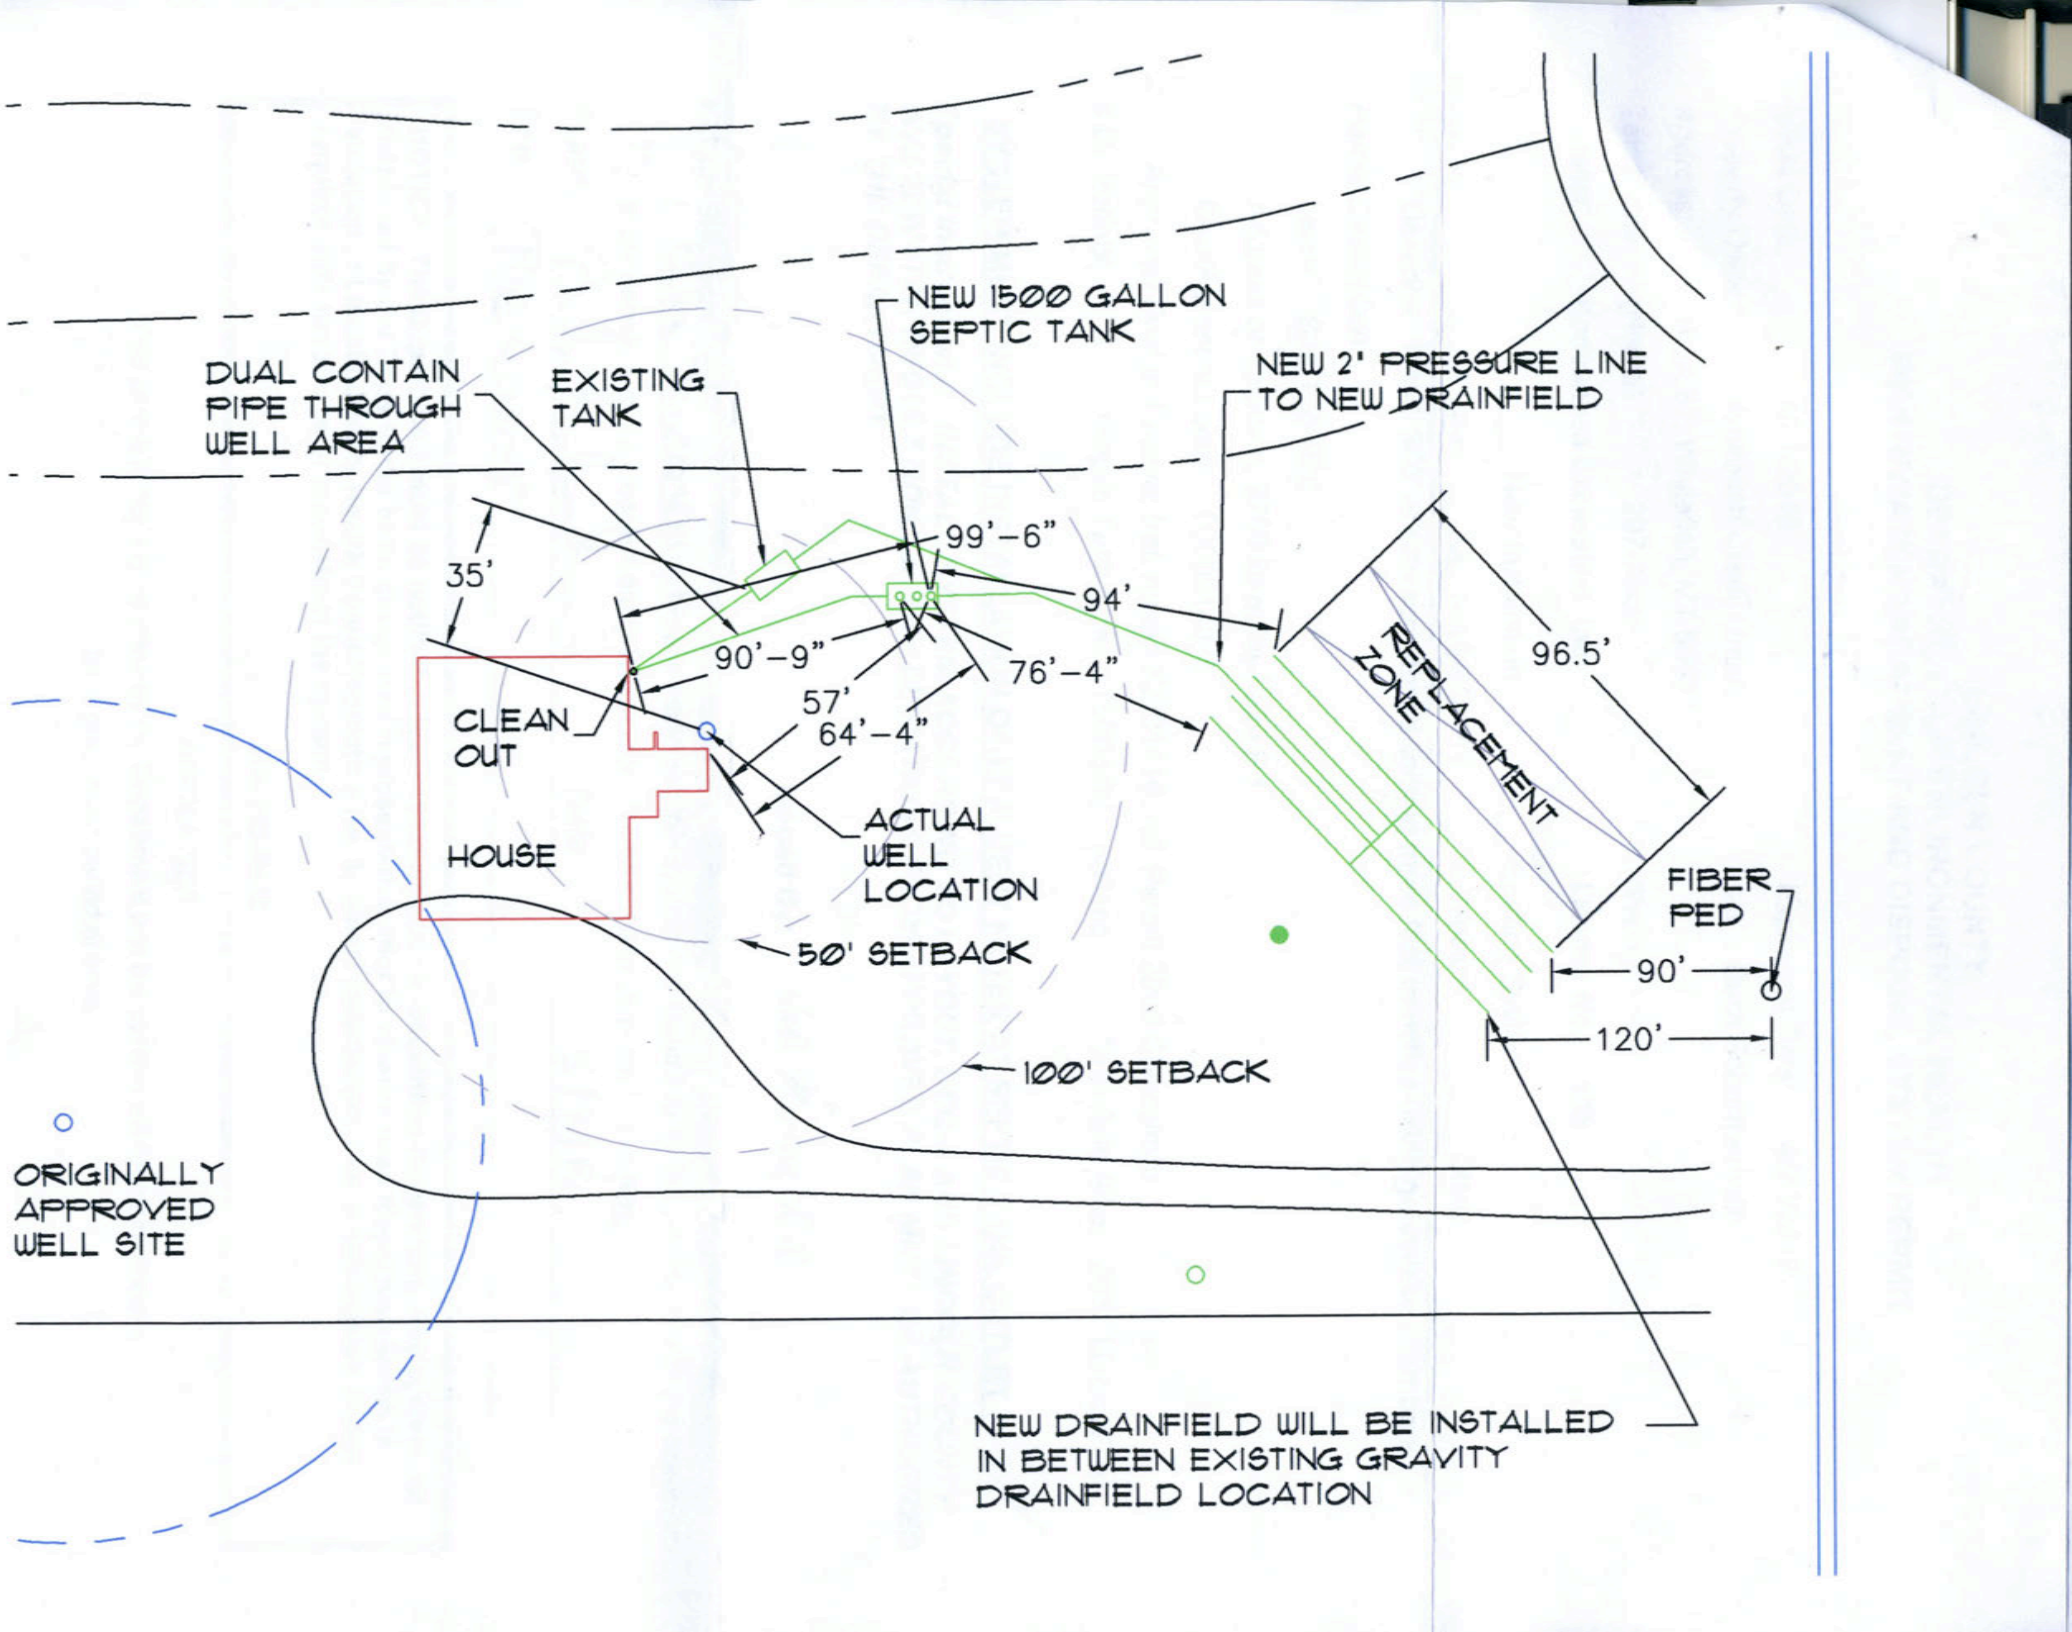
NEW 1500 GALLON
SEPTIC TANK
DUAL CONTAIN
PIPE THROUGH
WELL AREA
EXISTING
TANK
NEW 2" PRESSURE LINE
TO NEW DRAINFIELD
35'
99'-6"
94'
90'-9"
76'-4"
57'
64'-4"
96.5'
REPLACEMENT
ZONE
CLEAN
OUT
HOUSE
ACTUAL
WELL
LOCATION
FIBER
PED
50' SETBACK
90'
120'
100' SETBACK
ORIGINALLY
APPROVED
WELL SITE
NEW DRAINFIELD WILL BE INSTALLED
IN BETWEEN EXISTING GRAVITY
DRAINFIELD LOCATION

| REVISIONS | | | |
|---|---|---|---|
| REV | DESCRIPTION | BY/DATE | APRD/DATE |
| | | | |

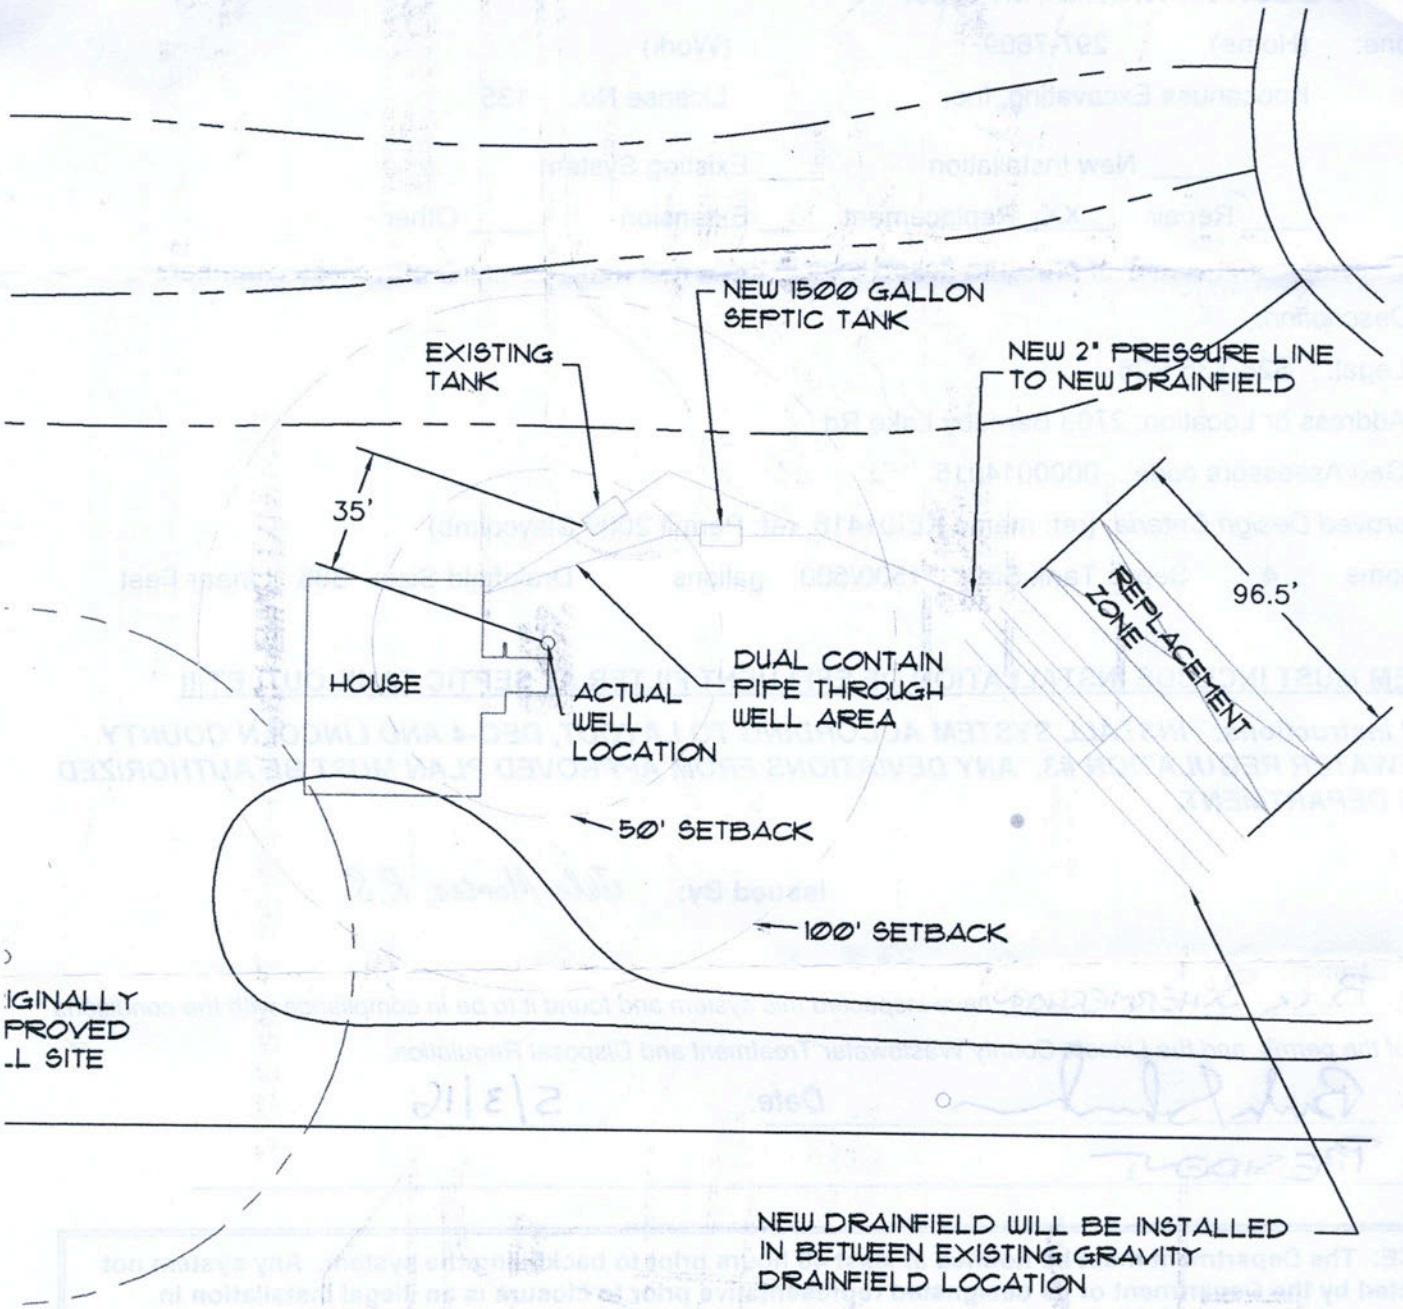


# PERMIT DRAWING

| REV | DATE | COMPANY | SCALE: | MONTANA DESIGN SERVICES, INC. P.O. BOX 1805 EUREKA, MT 59917 406-882-1121 | KOOCANUSA EXCAVATING BARNABY PROJECT |
|---|---|---|---|---|---|
| | | KEI | 1/15 & NOTED | | SEPTIC IMPROVE |
| | | CONTRACT: | DATE: | DWG TOLERANCES: .X= +/-0.5" .XX= +/-0.05" .XXX= +/-0.010" | DRAWN BY: SCHERMERHORN 3/14/16 |
| | | VERBAL | 3/11/16 | | APPROVED BY: J. MERTES 3/XX/16 |
| | | PLOT FILE: | WEIGHT | FINISH 125 | DWG FILE NAME: 00916-001 SHEET NO. 1 |
| | | PML-0001 | --- | | |