LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 3/11/2016 Expiration Date: 3/12/2017

Property Owner: James York c/o: Barb Renkema

Address: PO Box 1693, Eureka, MT 59917

Telephone: (Home) [redacted] (Work)

Installer: Bob Cuffe License No. 141

xx New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Four 85' trenches using gravelless chambers

Parcel Description:

Legal: S8 T36 R27

Address or Location: Parcel 2 CS# 2903 63640 US HWY 37

Geo/Assessors code: 0000053484

Approved Design Criteria:

Bedrooms 5 Septic Tank Size: 1500 gallons Drainfield Size: 340 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Robert Cuffe, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: [signature] *Date:* 6/7/16

Title: President


NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

James York
S 8 T36N R27W
32 A
CS 2903

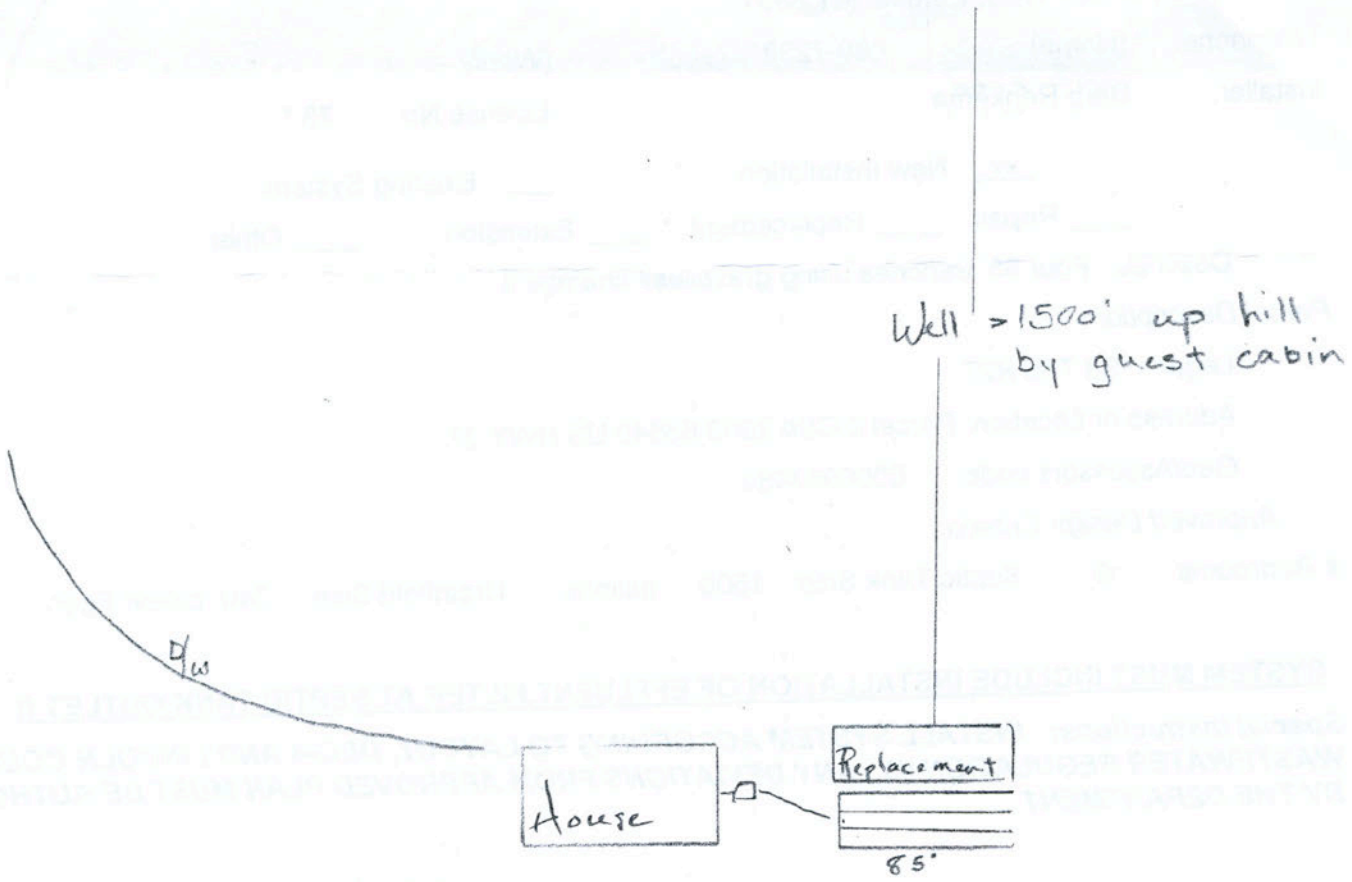

1" = 100'

N

Tobacco River flood plain