LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 10/29/2014 Expiration Date: 10/30/2015

Property Owner: Dan Anderson c/o:

Address: [redacted]

Telephone: (Home) (Work)

Installer: Terry Oedewaldt License No. 2

XX New Installation _____ Existing System

_____ Repair _____ Replacement _____ Extension _____ Other

Describe: Using gravelless chambers – sizing reduction allowed per "Drainfield Size below. System is for 3-bedroom home and shop with lavatory – 4-bedroom equivalent sizing.

Parcel Description:

Legal: SE-1/4 S28 T31 R33

Address or Location: Lot 1 in Wilderness Gateway

Approved Design Criteria:

Bedrooms: 4 Septic Tank Size: 1500 gallons Drainfield Size: 170 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Kendra J. Lind, R.S.

Closure Statement:

I, TERRY OEDEWALDT, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: _____ *Date:* 6/11/2015

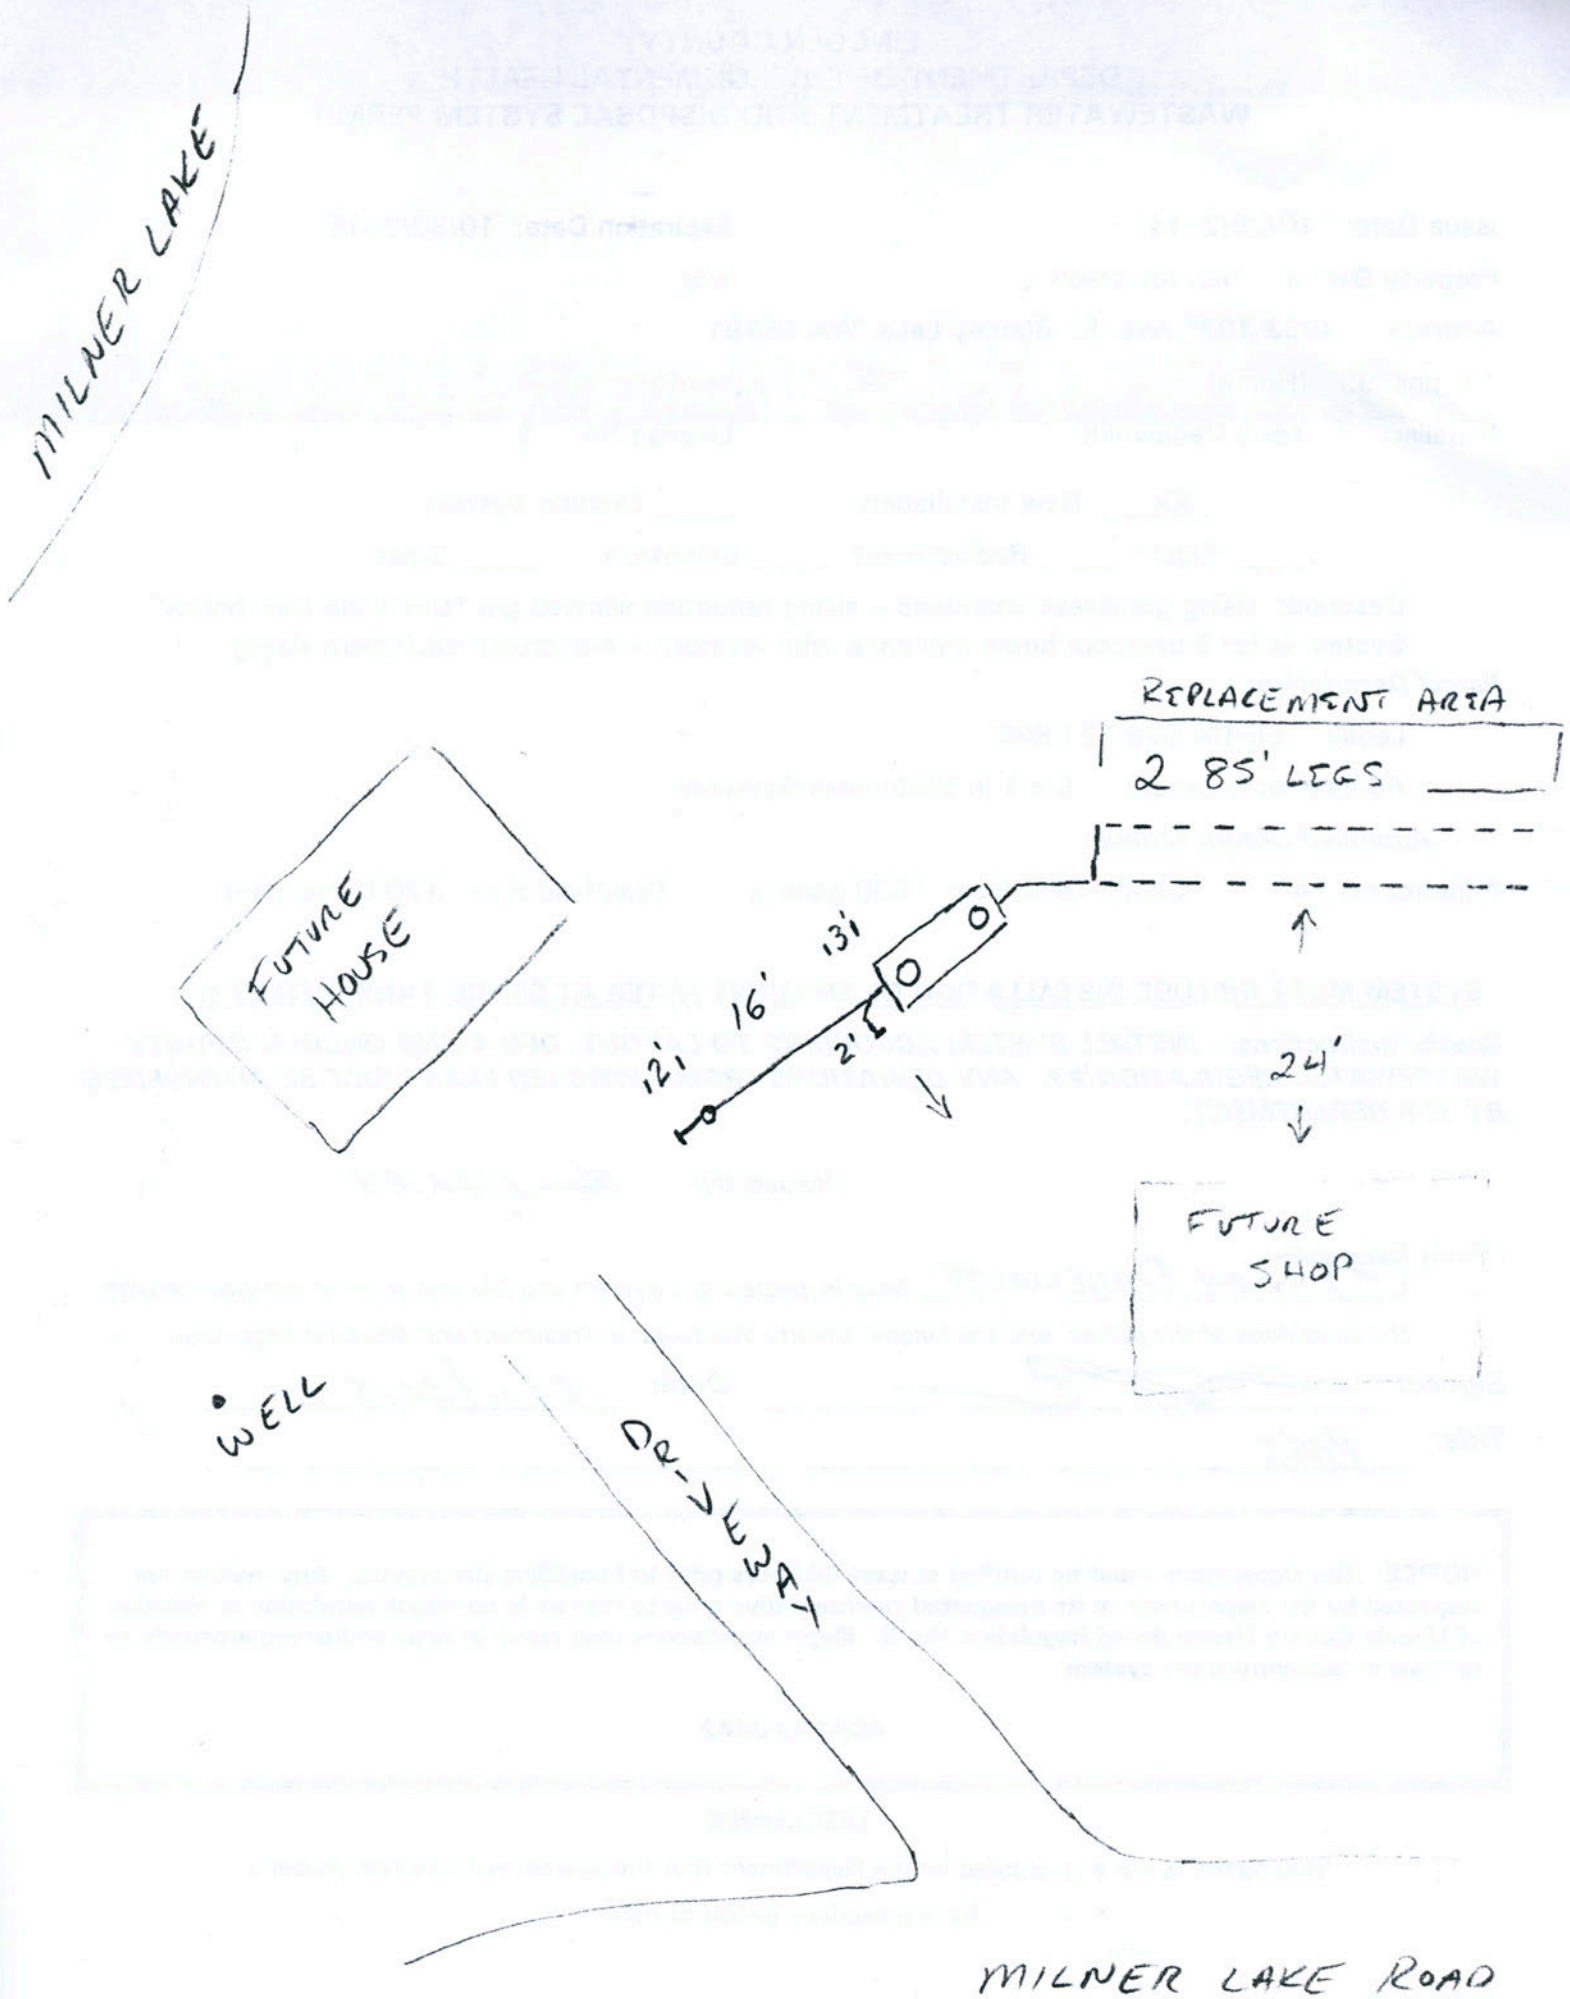
Title: PRES

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


MILNER LAKE
REPLACEMENT AREA
2 85' LEGS
FUTURE HOUSE
12'
16'
13'
2'
24'
FUTURE SHOP
WELL
DRIVEWAY
MILNER LAKE ROAD