file

LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 07/23/2014 Expiration Date: 07/24/2015

Property Owner: Justin Dall c/o: William Konshur

Address: [redacted]

Telephone: (Home) (Work)

Installer: Shayne Nelson License No. 118

_X_ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Shallow-capped gravelless chamber construction per DEQ approval – trench depth not to exceed 18 inches

Parcel Description:

Legal: S13 & S14 T27 R28

Address or Location: Lot 21 of Parkside at Fisher River – 1251 Rogers Mtn. Loop

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: ~~1500~~ 1000 gallons Drainfield Size: 210 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: [signature]

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____


Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

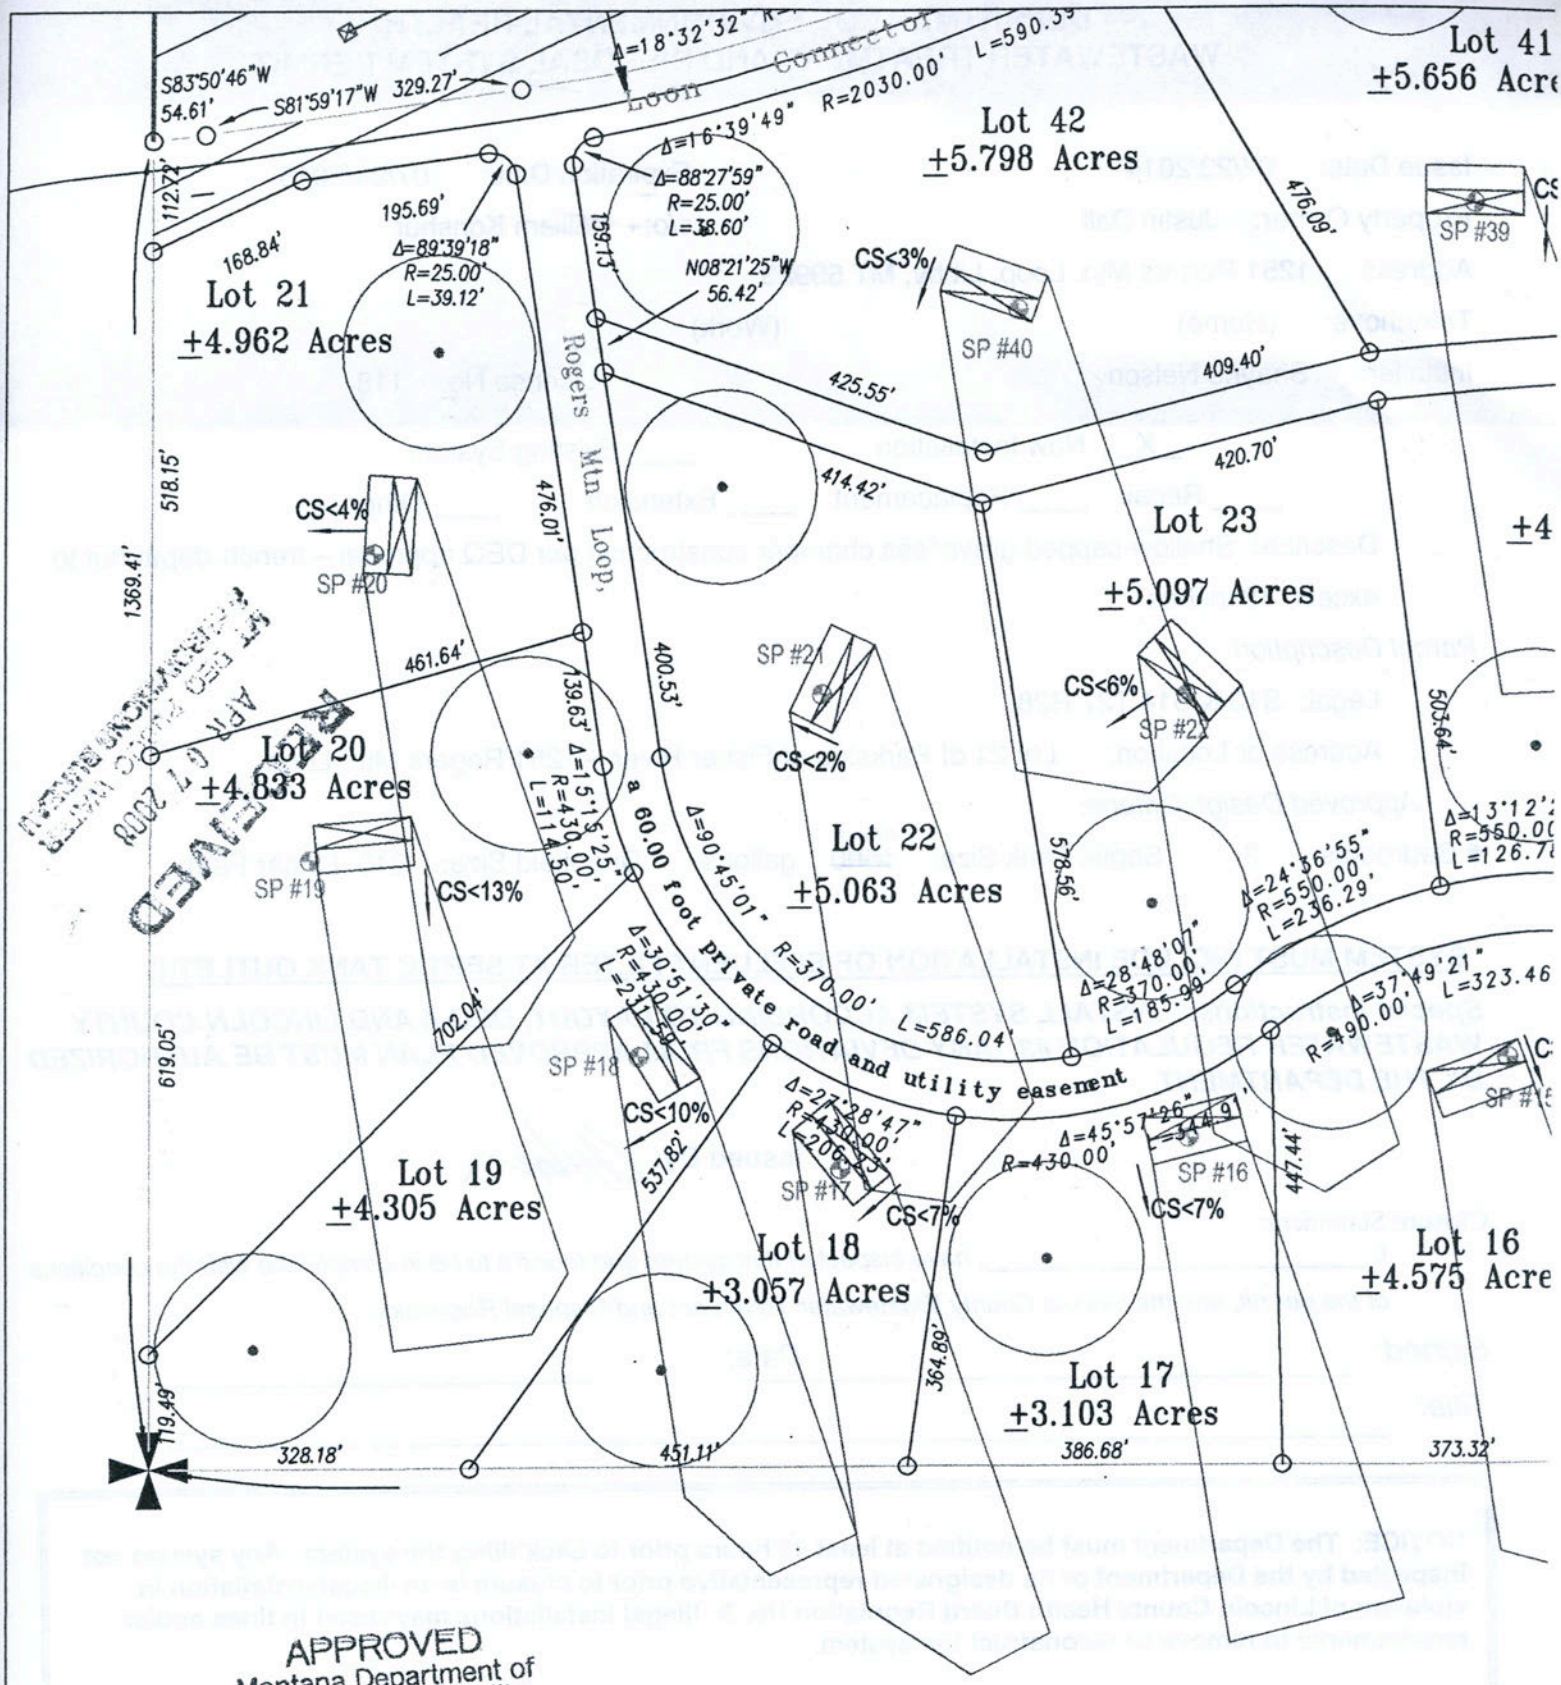

APPROVED
Montana Department of
Environmental Quality
Permitting and Compliance Division
MAS 04-18-08
Reviewer Date

RECEIVED
APR 07 2008
MT DEQ PUBLIC WATER SUPPLY SECTION

REC