LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 03/05/2015 Expiration Date: 03/06/2016

Property Owner: Jim Elias c/o: Koocanusa Excavating

Address: [redacted]

Telephone: (Home) [redacted] (Work) [redacted]

Installer: Koocanusa Excavating License No. 135

__XX__ New Installation _____ Existing System

_____ Repair _____ Replacement _____ Extension _____ Other

Describe: Installing pressure-dosed system (siphon) for one 3-bedroom residence & appurtenant garage with a 1-bedroom guest sleeping suite and one 2-bedroom guest house

Parcel Description:

Legal: S14 T36 R28

Address or Location: Lot 3a of Skyview Unit 1

Approved Design Criteria:

Bedrooms: 6 Septic Tank Size: 2000 gallons Drainfield Size: 280 Linear Feet

Siphon Dosing Tank Size: 1000 gallons

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL PRESSURE-DOSED SIPHON SYSTEM ACCORDING TO DEQ APPROVED PLANS, LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kendra J. Lind, R.S.*

Closure Statement:

I, BUCK SCHERMERHORN *, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Buck Schermerhorn *Date:* 3-13-15


Title: PRESIDENT

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

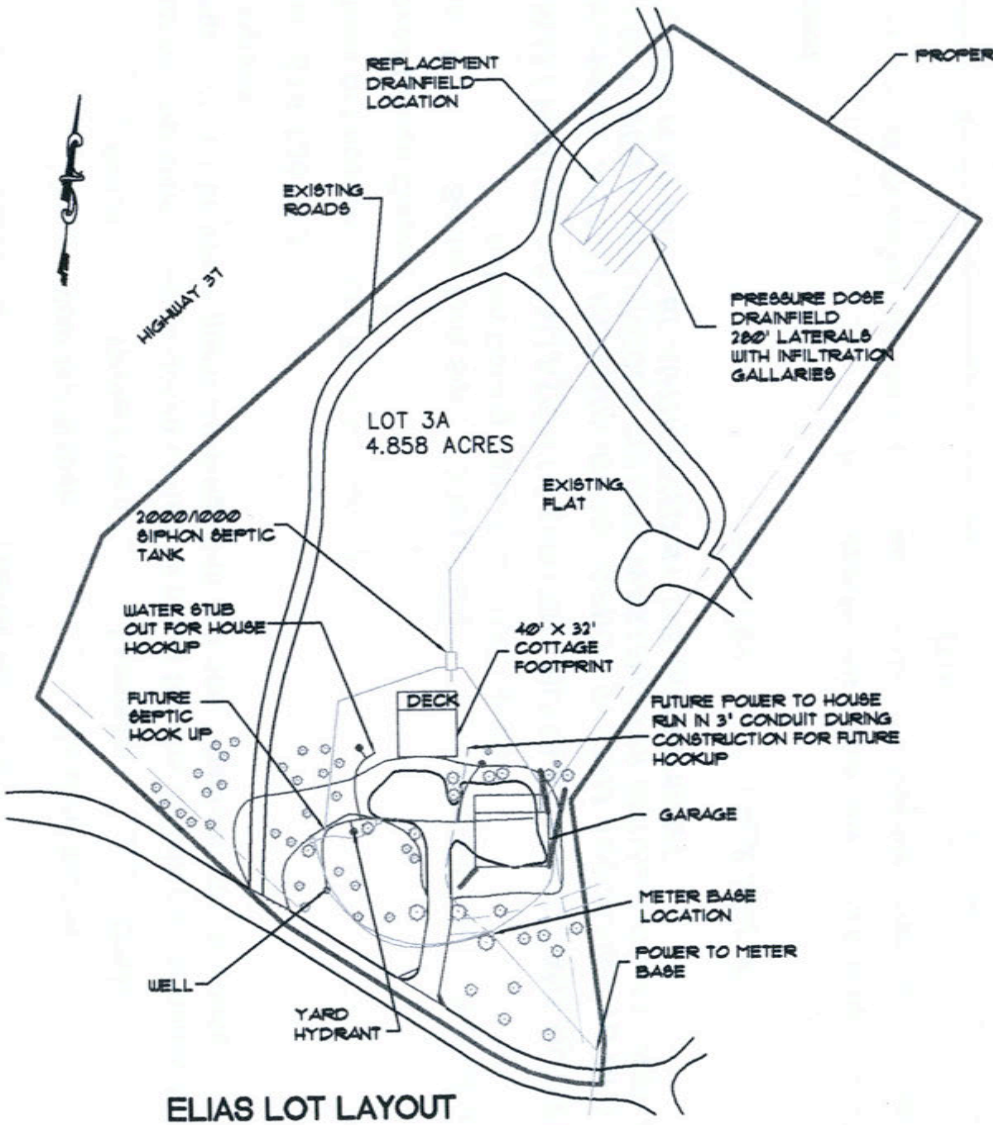

ELIAS LOT LAYOUT

REV	DESCRIPTION	BY/DATE	APPD/DATE

COMPANY	KEI	SCALE	1/16 & NOTED
CONTRACT	KD17414	DATE	10/21/14
PLOT FILE	PML-0001	WEIGHT	---

KIOCANUSA EXCAVATING
ELIAS PROJECT
SEPTIC PERMIT
3/3/15
K. LMS
3/3/15
06214-004
1

THIS DRAWING IS PROPERTY OF KEI ENGR. CONTRACT AND SUCH RECEIVED WITHOUT WRITTEN CONSENT IS NOT TO BE LOANED, NOT BE SUBMITTED TO ANY OTHER PARTIES WITHOUT WRITTEN APPROVAL FROM KEI ENGINEERING