LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 07/31/2014 Expiration Date: 08/01/2015

Property Owner: Mikel & Gail Parrish c/o:

Address: P.O. Box 5004 Kalispell, MT 59903

Telephone: (Home) [redacted] (Work) [redacted]

Installer: Murphy Wagar License No. 72

____ New Installation __XX__ Existing System

_____ Repair __XX__ Replacement _____ Extension _____ Other

Describe: Installing pressure-dosed system – 3-foot wide trenches.

Parcel Description:

Legal: S30 T27 R27

Address or Location: Lot 10 of Upper Lakeshore Lots -- 895 Lakeshore Drive

Approved Design Criteria:

#Bedrooms: 2 Septic Tank Size: 1000 gallons Drainfield Size: 94 Linear Feet

Dosing Tank Size: 500 gallons

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL PRESSURE-DOSED SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kendra J. Lind, R.S.*

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

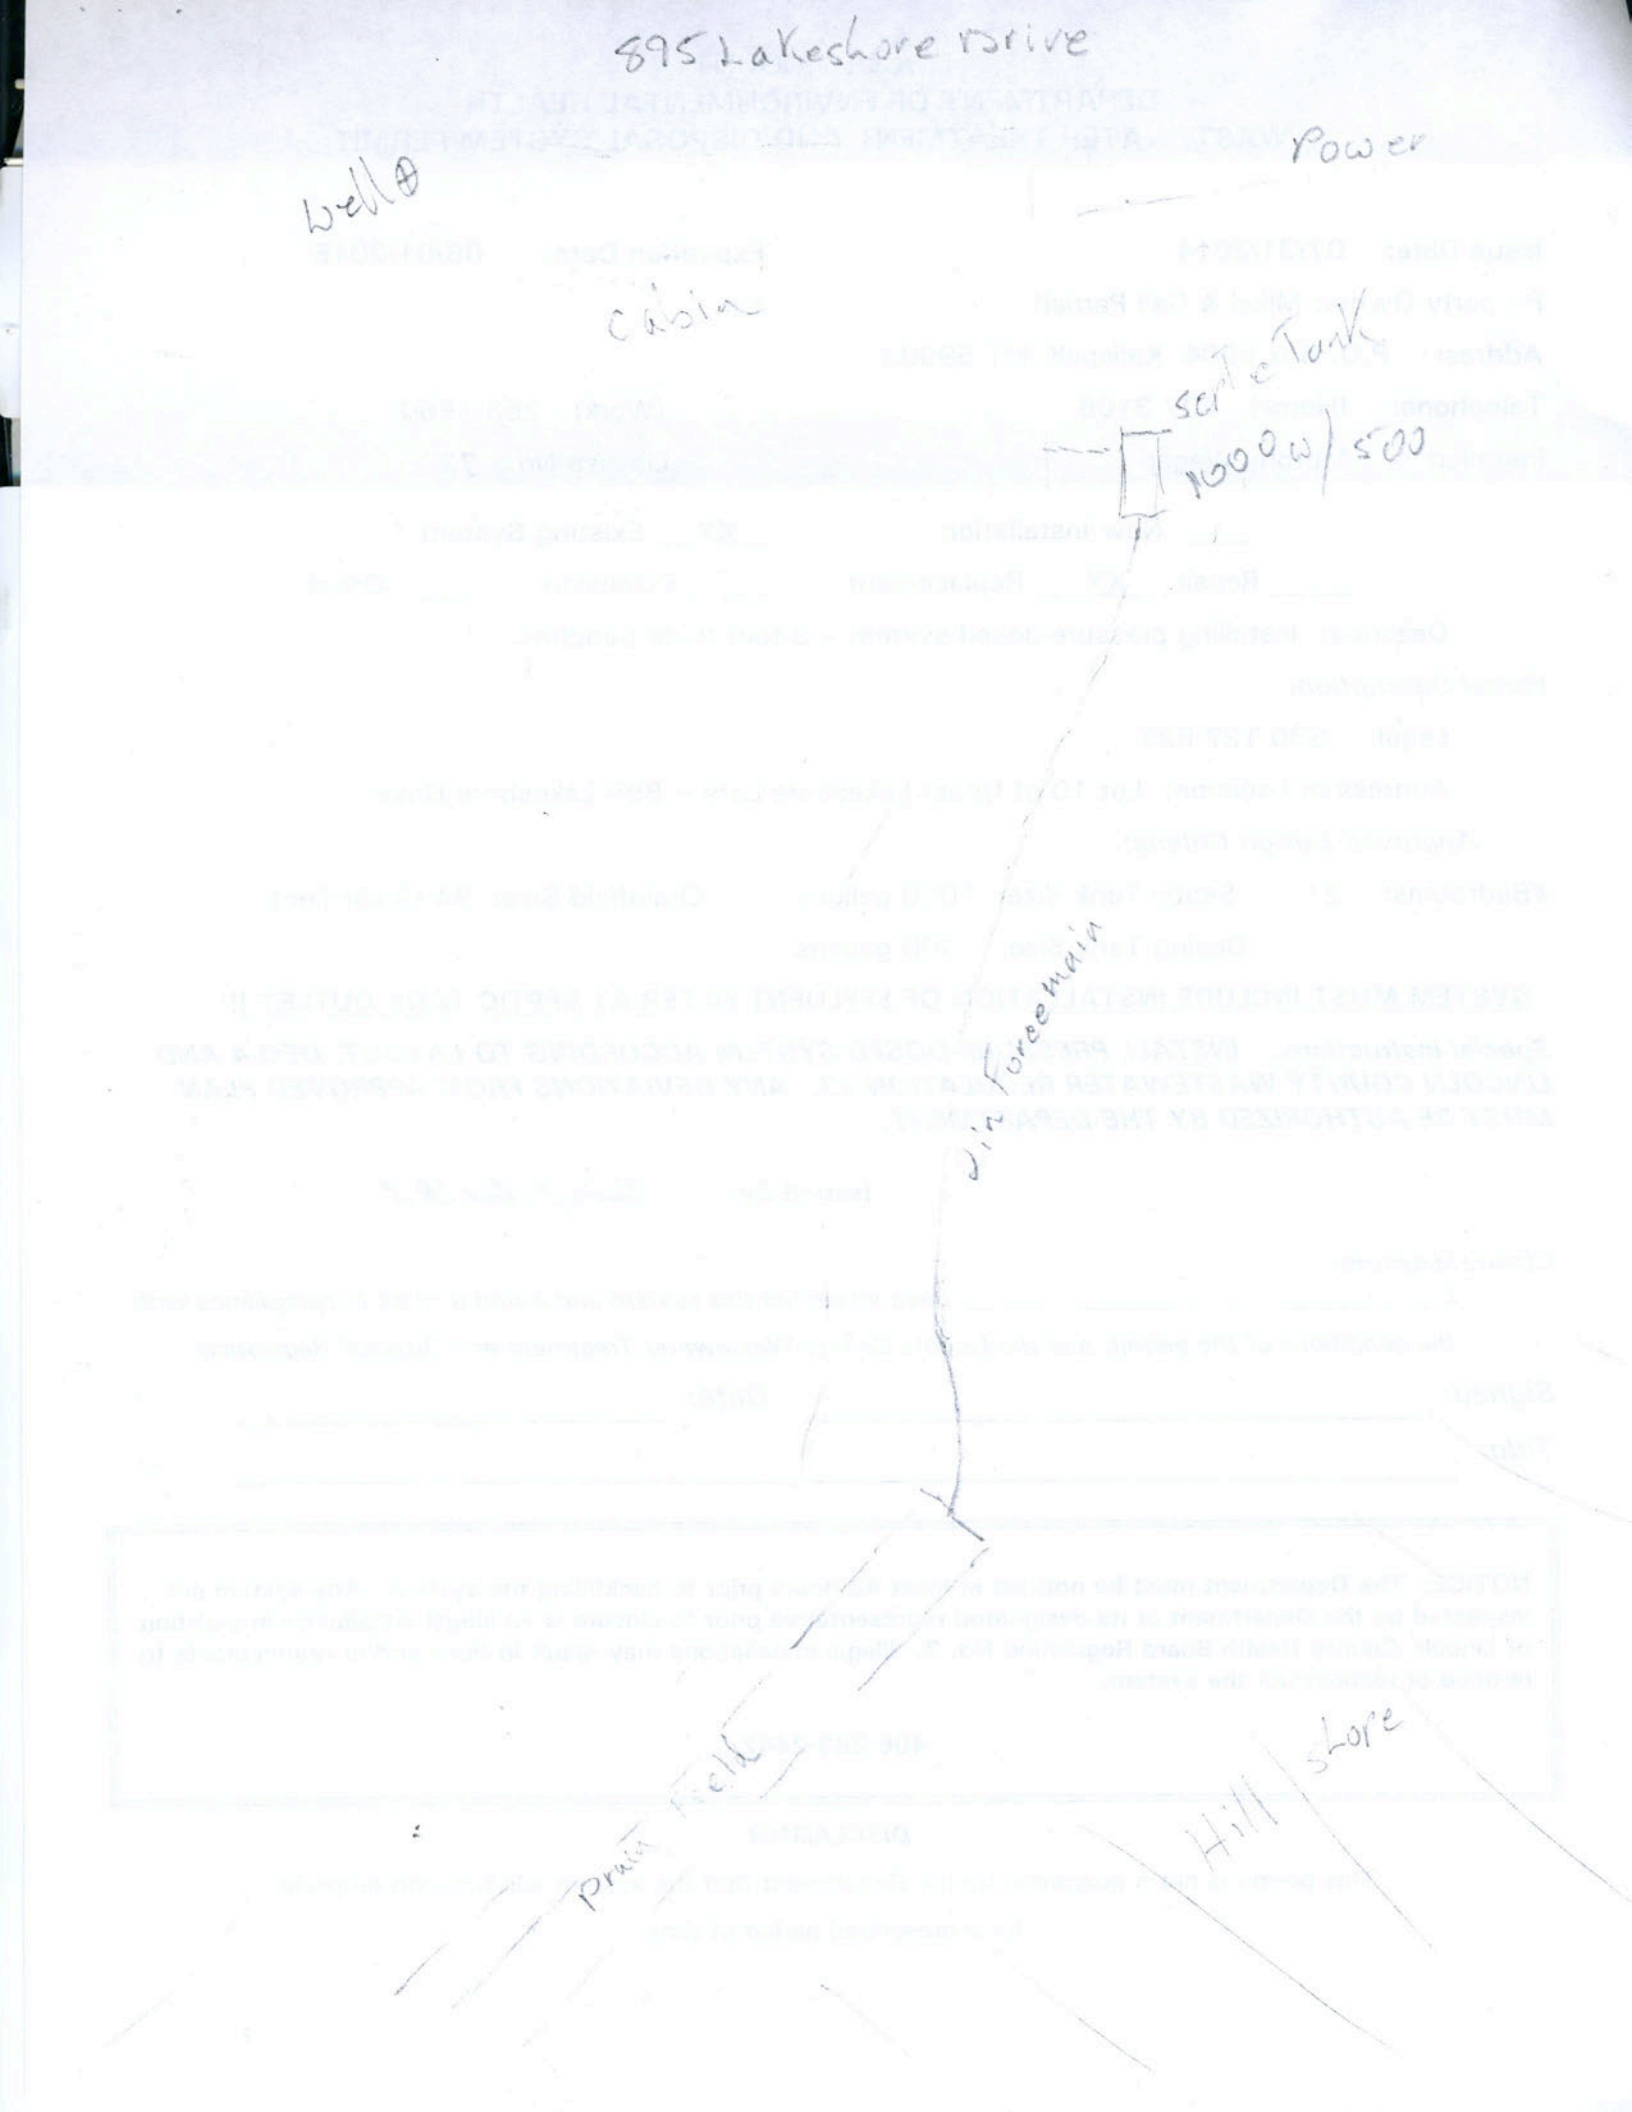
Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


895 Lakeshore Drive
Well
Power
Cabin
Septic Tank
1000 w / 500
2in Forcemain
Prairie Field
Hill
Shore