LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 05/05/2015 Expiration Date: 05/06/2016

Property Owner: Morod Radmacher c/o: Koocanusa Excavating, Inc.

Address: [redacted]

Telephone: (Home) [redacted] (Work) [redacted]

Installer: Koocanusa Excavating, Inc. License No. 135

__XX__ New Installation _____ Existing System

_____ Repair _____ Replacement _____ Extension _____ Other

Describe: Installing pressure-dosed system for 3-bedroom residence and appurtenant garage with one guest bedroom and one 1-bedroom guest cabin with sleeping and lavatory facilities only.

Parcel Description:

Legal: S15 T36 R28

Address or Location: Parcel B of Ecklund Family Transfer -- COS 2545

Approved Design Criteria:

Bedrooms: 5 Septic Tank Size: 1500 gallons each Drainfield Size: 270 Linear Feet

Dosing Tank Size: 500 gallons

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL PRESSURE-DOSED SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kendra J. Lind, R.S.*

Closure Statement:

I, BUCK SCHERMERHORN *, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: [signature] *Date:* 5/5/15


Title: PRESIDENT

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

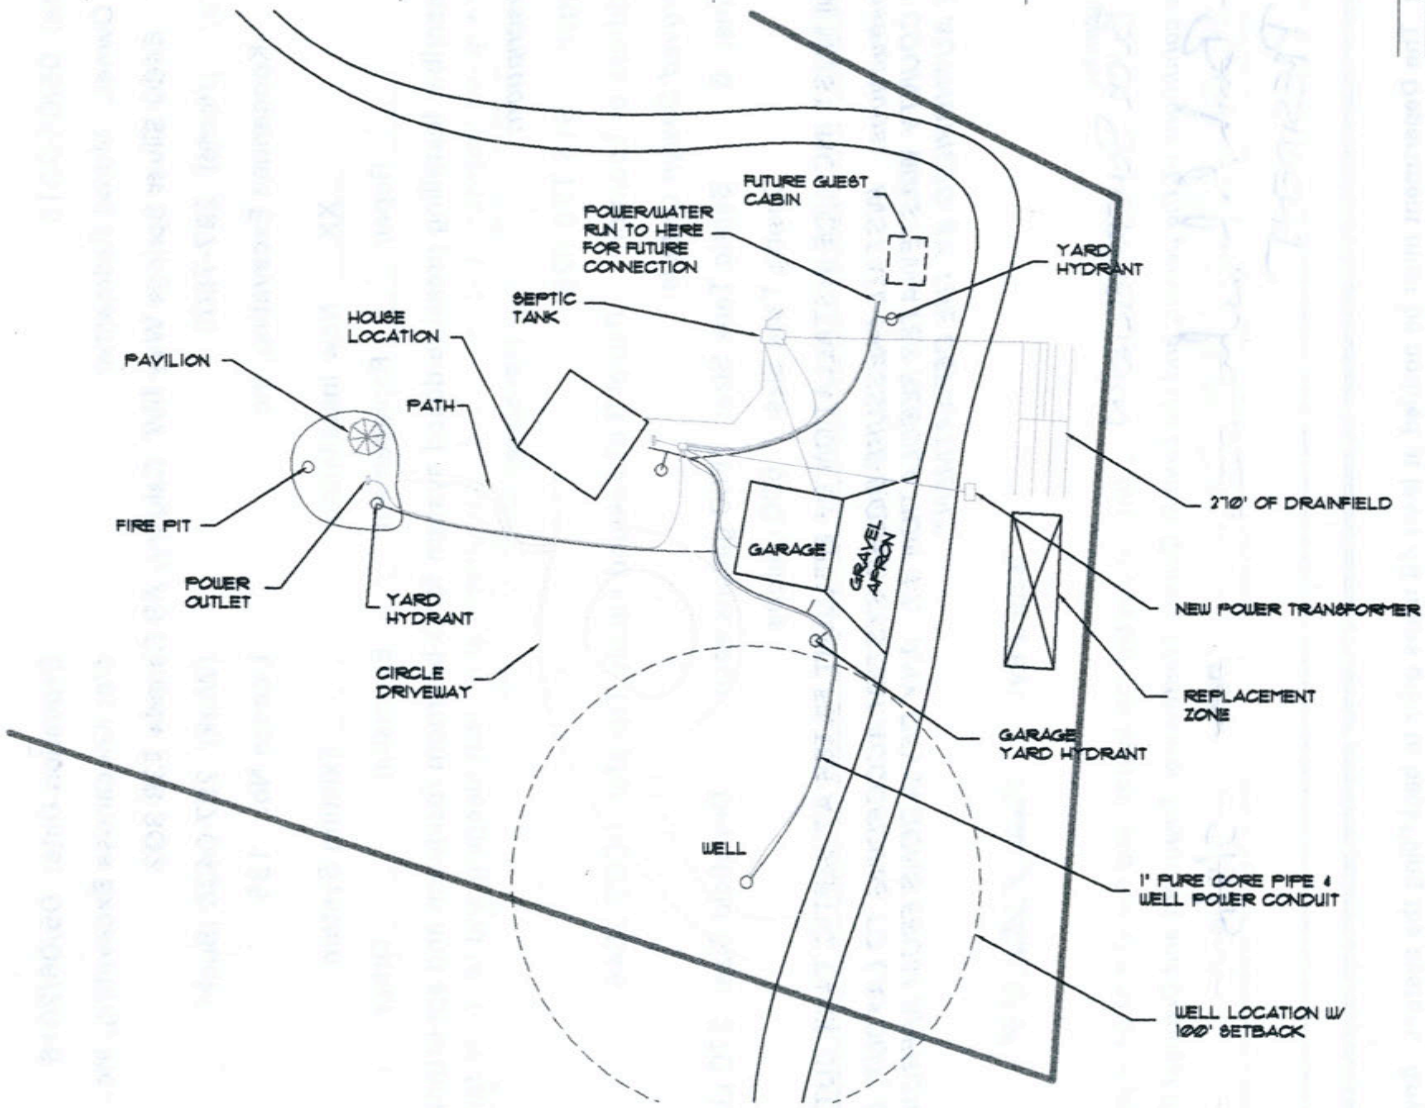

RADMACHER SITE LAYOUT

REV	DESCRIPTION	BY/DATE	APPD/DATE

COMPANY	KEI	SCALE	1/16 & 1/32
DRAWN BY		DATE	
VERIFIED		DATE	3/15/15
PLOT FILE	PAL-0001	WEIGHT	----

KOOCANUSA EXCAVATING
RADMACHER PROJECT
SITE LAYOUT
DRAWING NO. 00815-001
REV 1