LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

EXTENDED

Issue Date: 02/17/2015 Expiration Date: ~~02/18/2016~~ 8/30/2016

Property Owner: Rusher Family Trust c/o: David Rusher

Address: [redacted]

Telephone: (Home) [redacted] (Work) [redacted]

Installer: License No.

____ New Installation XX Existing System

____ Repair XX Replacement____ Extension ____ Other

Describe: Pressure-dosed system to accommodate 5-bedroom primary residence, 1-bedroom guest/caretaker house, and boat-house lavatory.

Parcel Description:

Legal: S1 T31 R34

Address or Location: 431 River Road Troy, MT

Approved Design Criteria:

Max Flows: 600 GPD Septic Tank Sizes: 1000 gallons each for guest house and boat-house; 1500 gallons for primary residence Effluent Lift Tank Sizes: 500 gallons for each unit
Pressure Dosing Tank Size: 500 gallons Drainfield Size: 1008 Square Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL PRESSURE-DOSED SYSTEM ACCORDING TO LAYOUT, PLAN DETAILS, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kendra J. Lind, R.S.*

Closure Statement:
I, Keith Mack *, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: [signature] *Date:* 8-3-16

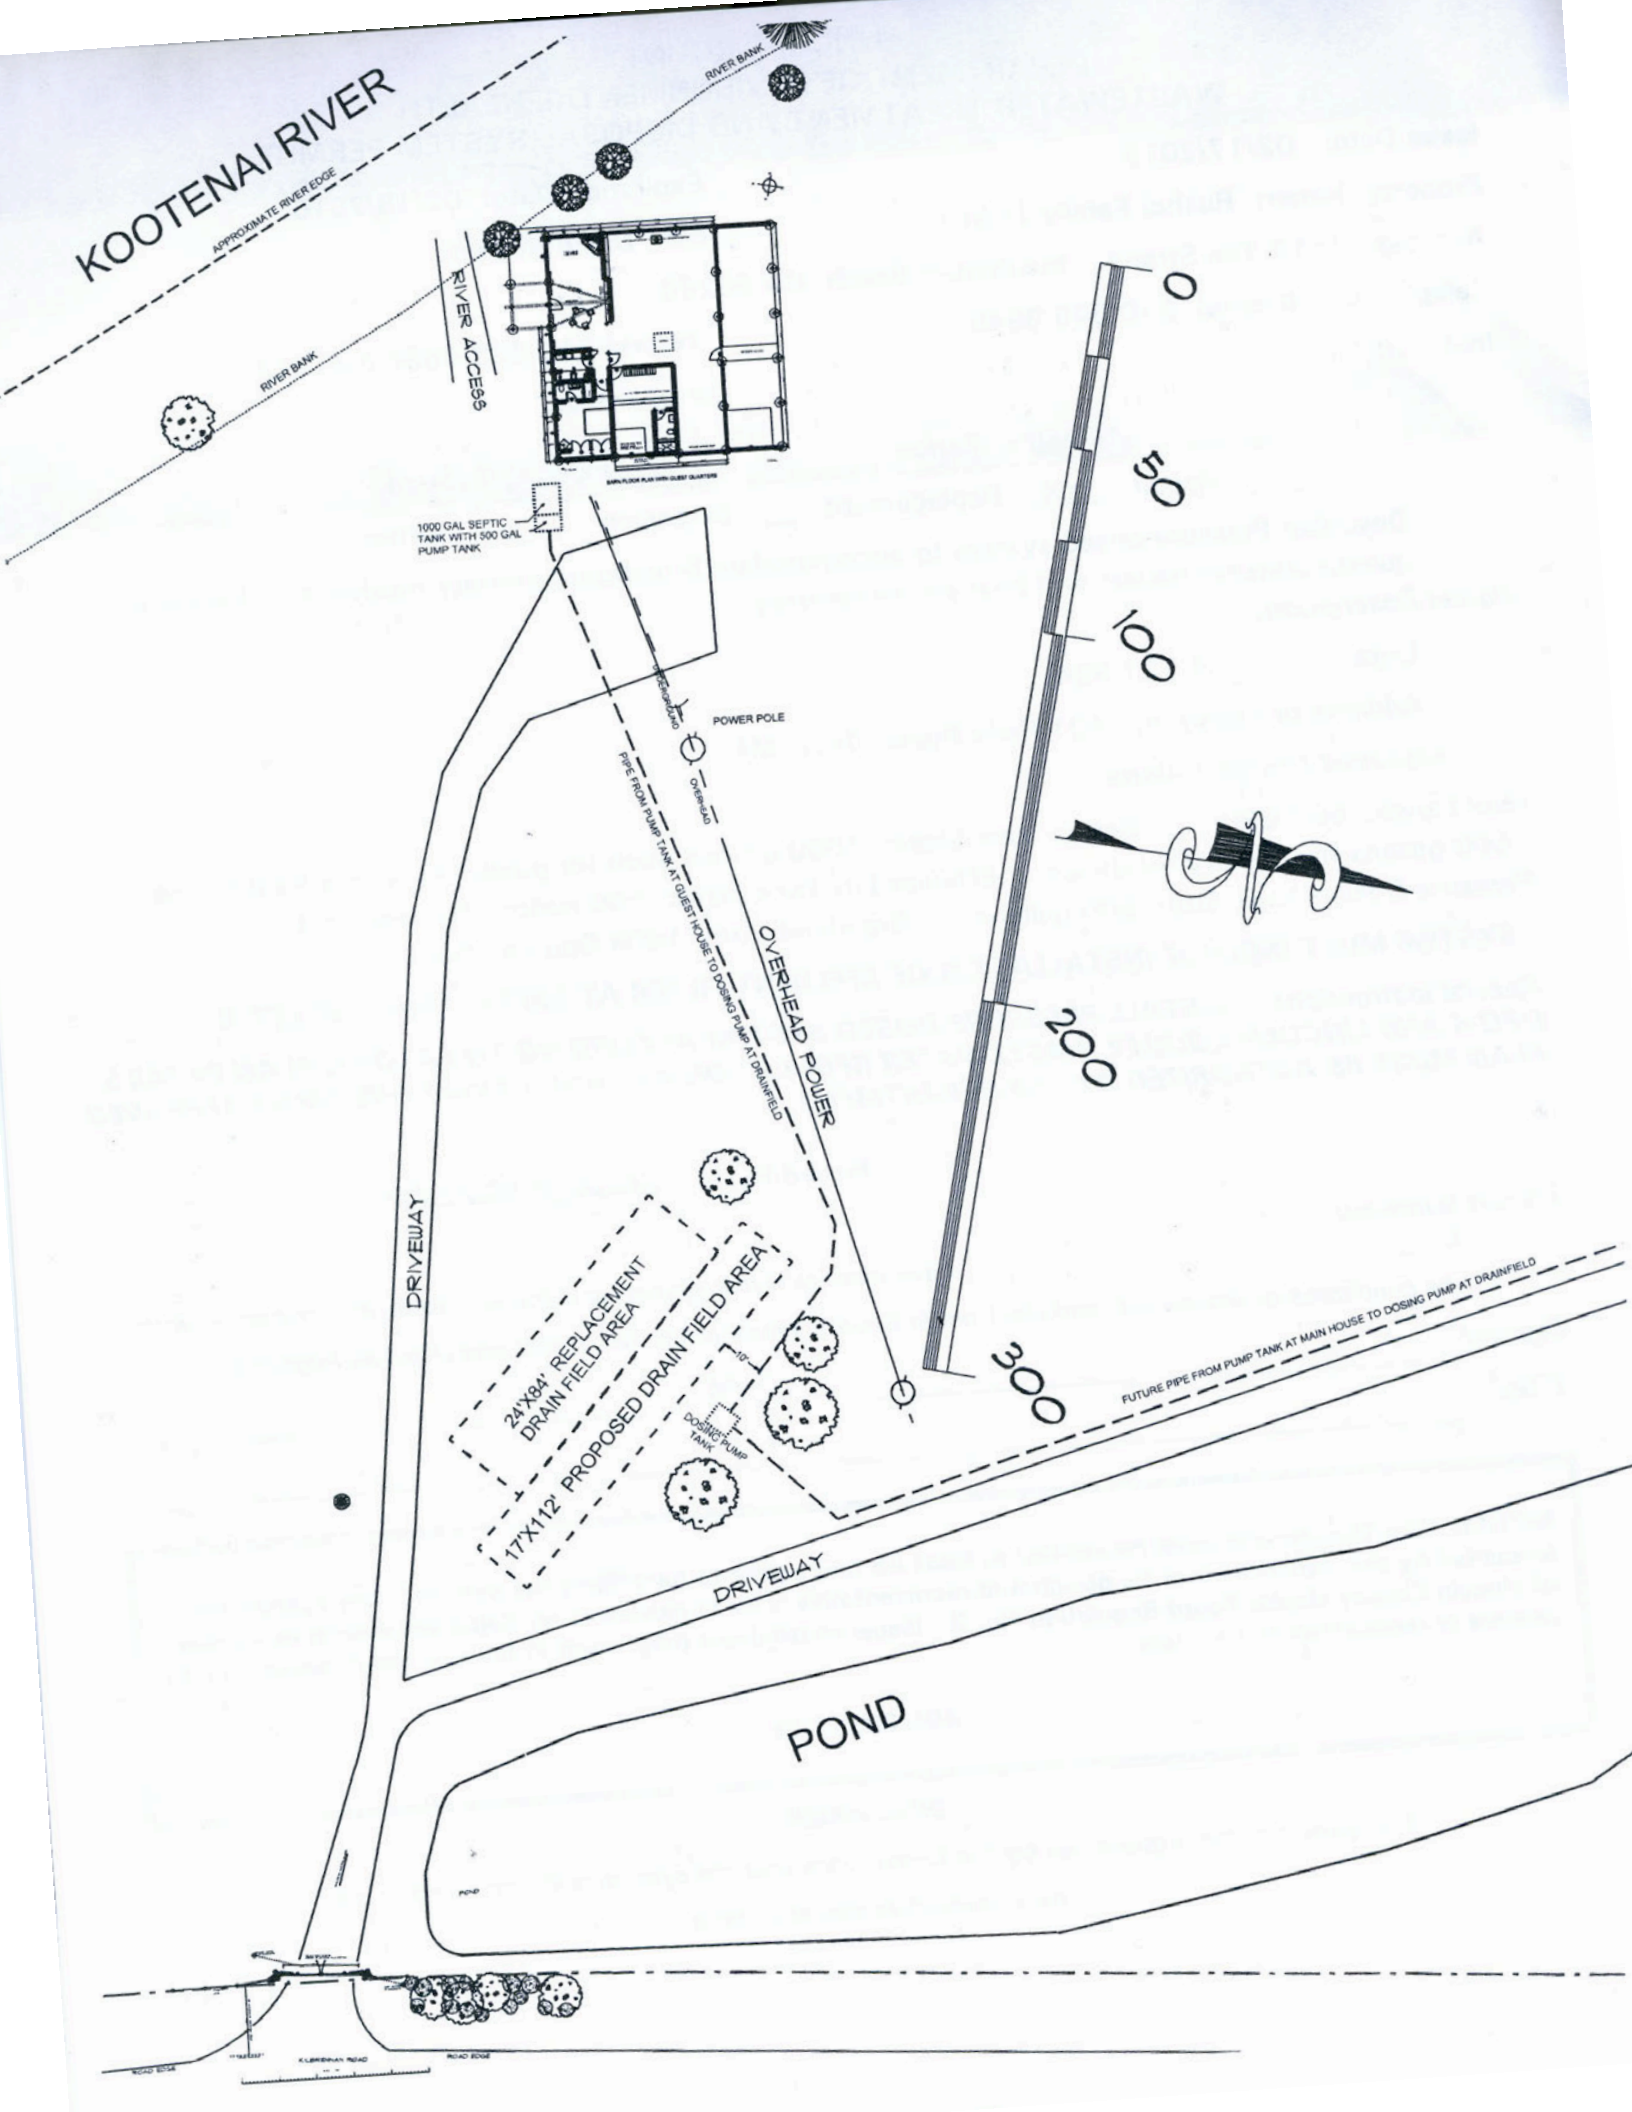
Title: Installer

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


KOOTENAI RIVER
APPROXIMATE RIVER EDGE
RIVER BANK
RIVER BANK
RIVER ACCESS
1000 GAL SEPTIC TANK WITH 500 GAL PUMP TANK
POWER POLE
OVERHEAD
PIPE FROM PUMP TANK AT GUEST HOUSE TO DOSING PUMP AT DRAINFIELD
OVERHEAD POWER
DRIVEWAY
24'X84' REPLACEMENT DRAIN FIELD AREA
17'X112' PROPOSED DRAIN FIELD AREA
10'
DOSING PUMP TANK
FUTURE PIPE FROM PUMP TANK AT MAIN HOUSE TO DOSING PUMP AT DRAINFIELD
DRIVEWAY
POND
0
50
100
200
300