LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 05/14/2014 Expiration Date: 05/15/2015

Property Owner: Rob Scott c/o: Koocanusa Plumbing & Electric, Inc.

Address: [redacted]

Telephone: (Home) (Work) [redacted]

Installer: Koocanusa Plumbing License No. 8

_____ New Installation __XX__ Existing System

__XX__ Repair _____ Replacement _____ Extension _____ Other

Describe: Pressure-dosed system. Relocating drainfield to new site on adjacent lot. Utilizing existing tank & pump to provide lift. Installing new tank and pump for pressurized replacement system.

Parcel Description:

Legal: NE-1/4 S27 T36 R26

Address or Location: 1200 Fleming Road

Approved Design Criteria:

Bedrooms: 4 Septic Tank Size: 1000 gallons Drainfield Size: 504 Linear Feet

Dosing Tank Size: 500 gallons

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL PRESSURE-DOSED SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kendra J. Lind, R.S.*

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.


406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

LOT LAYOUT

Riley F/T
LINCOLN Co.
NE¼ Sec 27-T36N-R26W
11/00

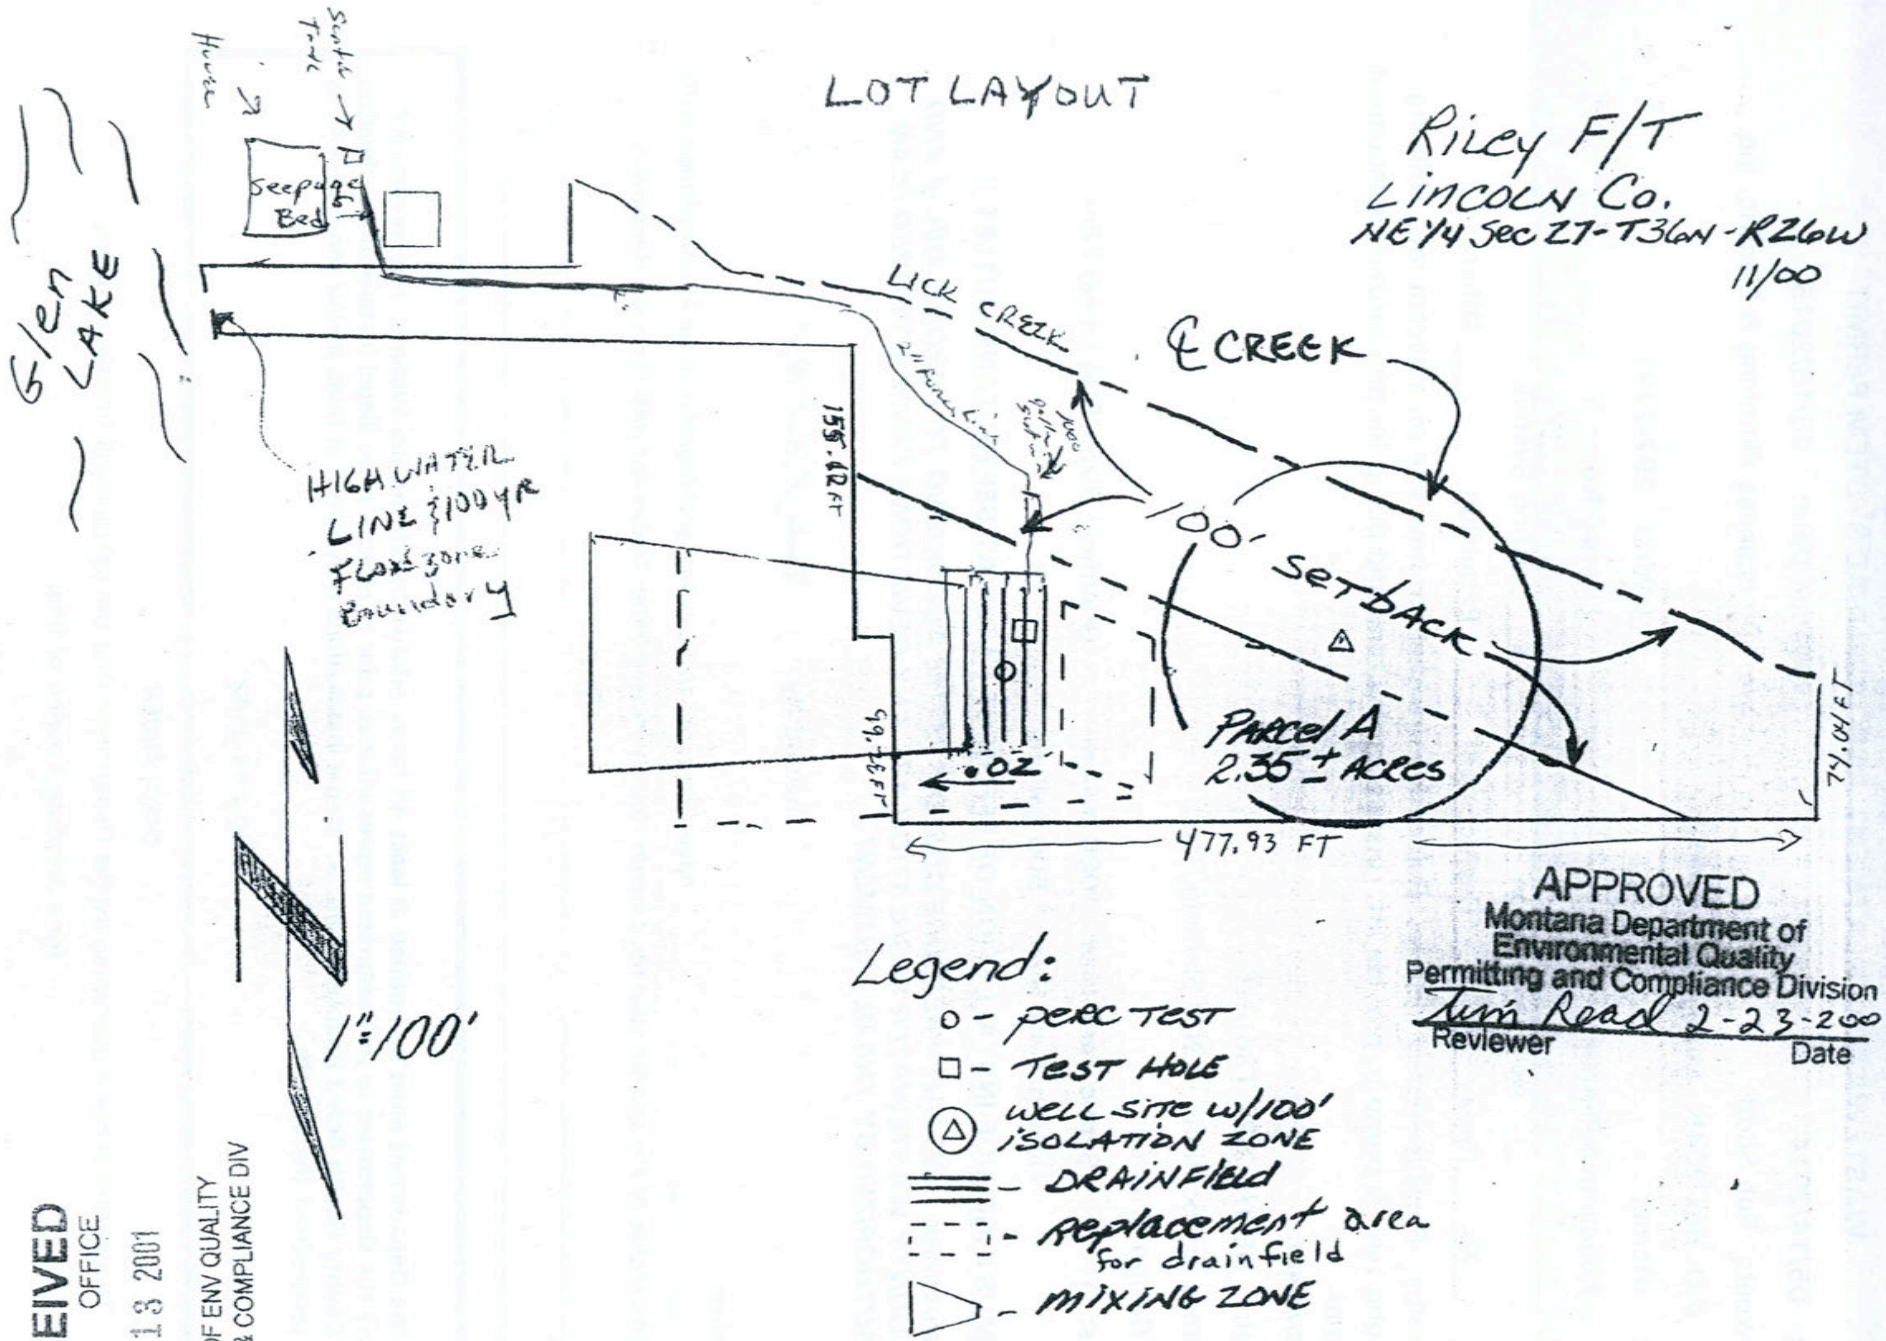

Legend:

- o - PERC TEST
- □ - TEST HOLE
- △ - WELL SITE W/100' ISOLATION ZONE
- ≡ - DRAINFIELD
- ⋮⋮ - REPLACEMENT AREA FOR DRAINFIELD
- ▷ - MIXING ZONE

APPROVED
Montana Department of Environmental Quality
Permitting and Compliance Division
Tim Read 2-23-2001
Reviewer Date

RECEIVED
OFFICE
FEB 13 2001
MT DEPT OF ENV QUALITY
PERMITTING & COMPLIANCE DIV