LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 07/16/2014 Expiration Date: 07/17/2015

Property Owner: George Snyder, Jr. c/o:

Address: [redacted]

Telephone: (Home) (Cell) [redacted]

Installer: Owner License No.

XX New Installation _____ Existing System

_____ Repair _____ Replacement _____ Extension _____ Other

Describe: Using gravelless chambers – sizing reduction allowed per "Drainfield Size" below.

Parcel Description:

Legal: S5 T30 R33 Lot 1A of Lake Creek Hideaway (Court Ordered Division)

Address or Location: 3199 Lake Creek Road

Approved Design Criteria:

Bedrooms: 2 Septic Tank Size: 1000 gallons Drainfield Size: 112 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kendra J. Lind, R.S.*

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

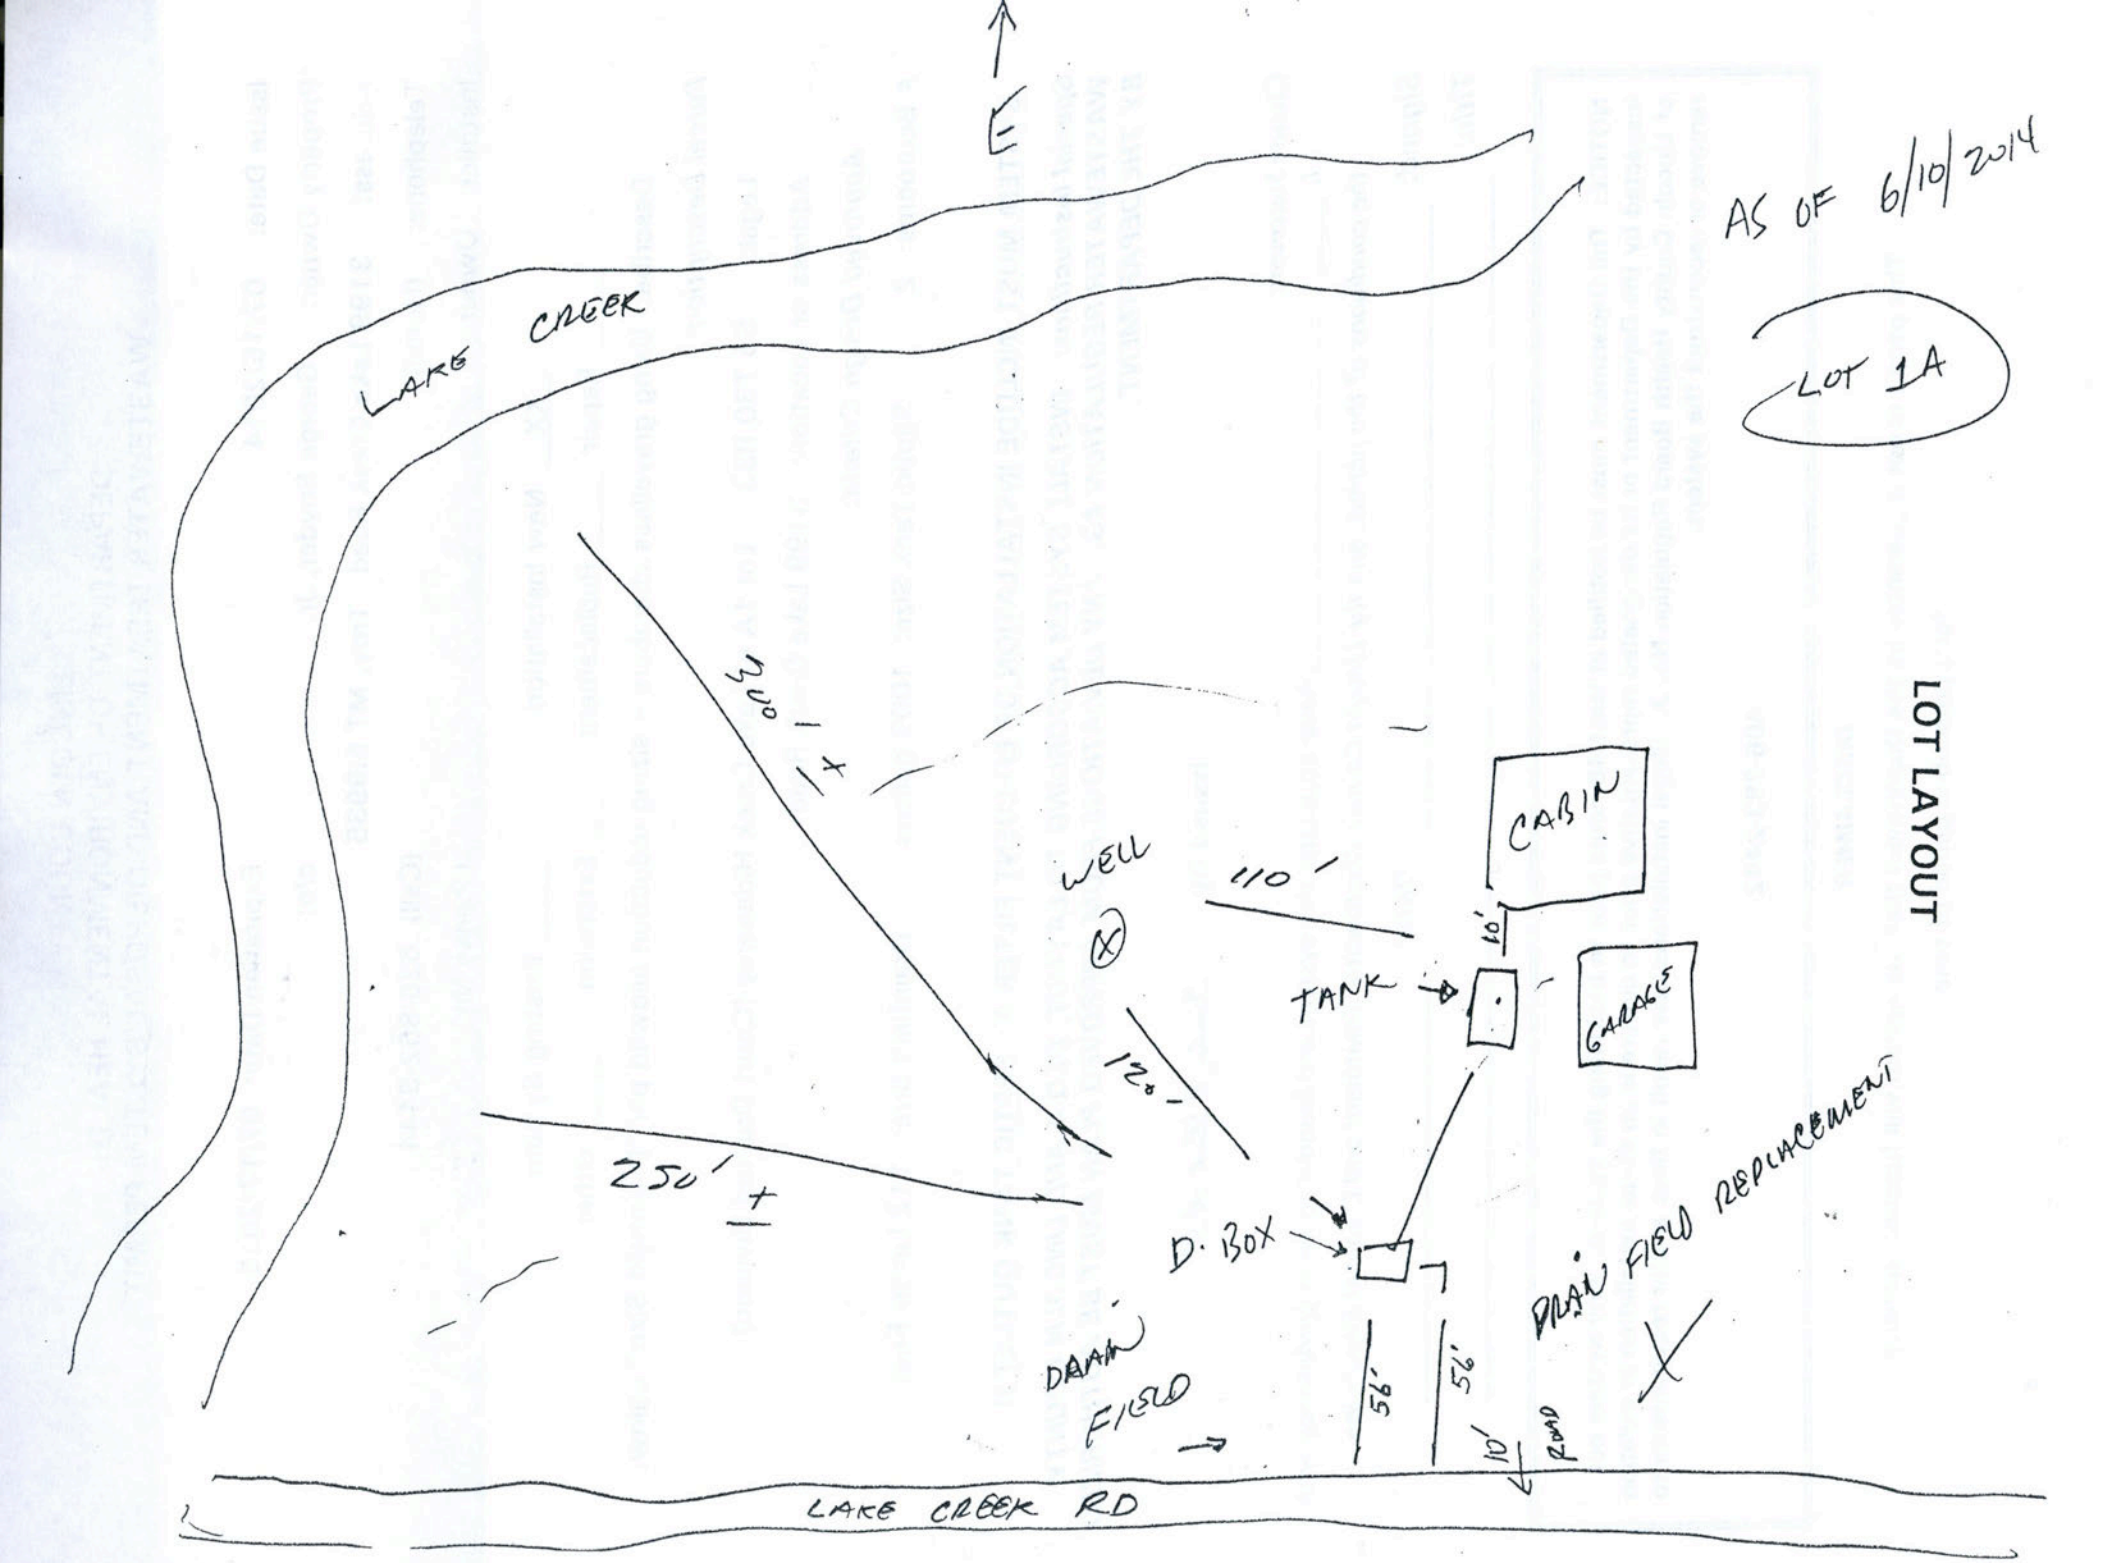
Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


AS OF 6/10/2014
LOT 1A
LOT LAYOUT
LAKE CREEK
300' +/-
WELL
110'
CABIN
10'
TANK
GARAGE
120'
250' +/-
D. BOX
DRAIN FIELD REPLACEMENT
DRAIN FIELD
56'
56'
10'
ROAD
LAKE CREEK RD